

Approx. mass ±110 (LBS)		Center of gravity ±2 (inch)	
Type	Pack	W	Pack
ZT15	2150	20.4	
ZT18	2194	33.0	
ZT22	2207	25.2	

**Note X:**  
 - Dimension drawing standardized  
 - Air inlet flange details added  
 - Mk-IV Elektronikon changed to Mk5

Ed.	Post-Nom.	See Note X	Gewijzigd van Modified from	2011-05-20 Datum Date	Ingevoerd door Int./Appr.



Note:  
 \* With full open door








All materials supplied are in compliance with the requirements of the List of Prohibited Substances



9820576700

Parent 3D model


Tolerances, if not indicated, according to:		ATLAS COPCO STANDARD CLASS	
Name	DIMENS.	ZT15-22 MED	Secrecy Class
Material	NOT APPLICABLE		1121/3
Treatment	Not Applicable		INV
Scale	1:10	Family	A/Compare
Drawn by	staman,	Blank no.	Replaces
Version Dwg	02.11	Blank wt.	0 kg
Des checked.	Prod checked.	Approved.	Date
			284.217 Kg
			2009-07-07
STATUS		Designation	9820576700
Approved		Sheet	1 / 1






- Notes:
1. ALLOW 36 INCHES IN FRONT OF CONTROL PANEL AND 24 INCHES ON ALL OTHER SIDES OF DRYER PACKAGE FOR PROPER VENTILATION AND MAINTENANCE.
  2. SHIPPING WEIGHT: ~900 LBS.
  3. SYSTEM CAPACITY: 137 CFM.
  4.  INDICATES CENTER OF GRAVITY.
  5.  INDICATES LIFTING POINTS
  6. SEE SHEET 2 FOR DRYER INLET/OUTLET PIPING DETAILS.

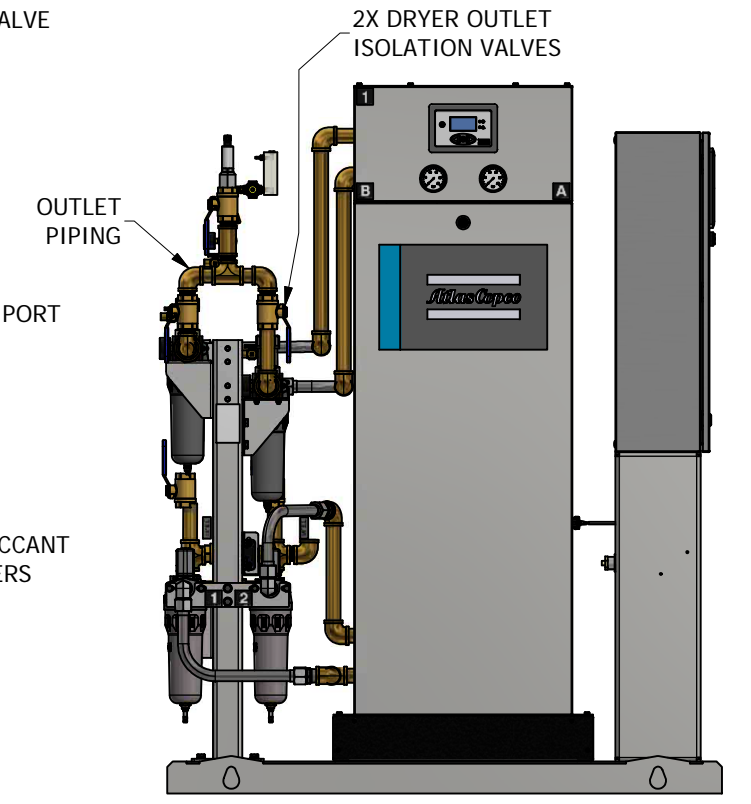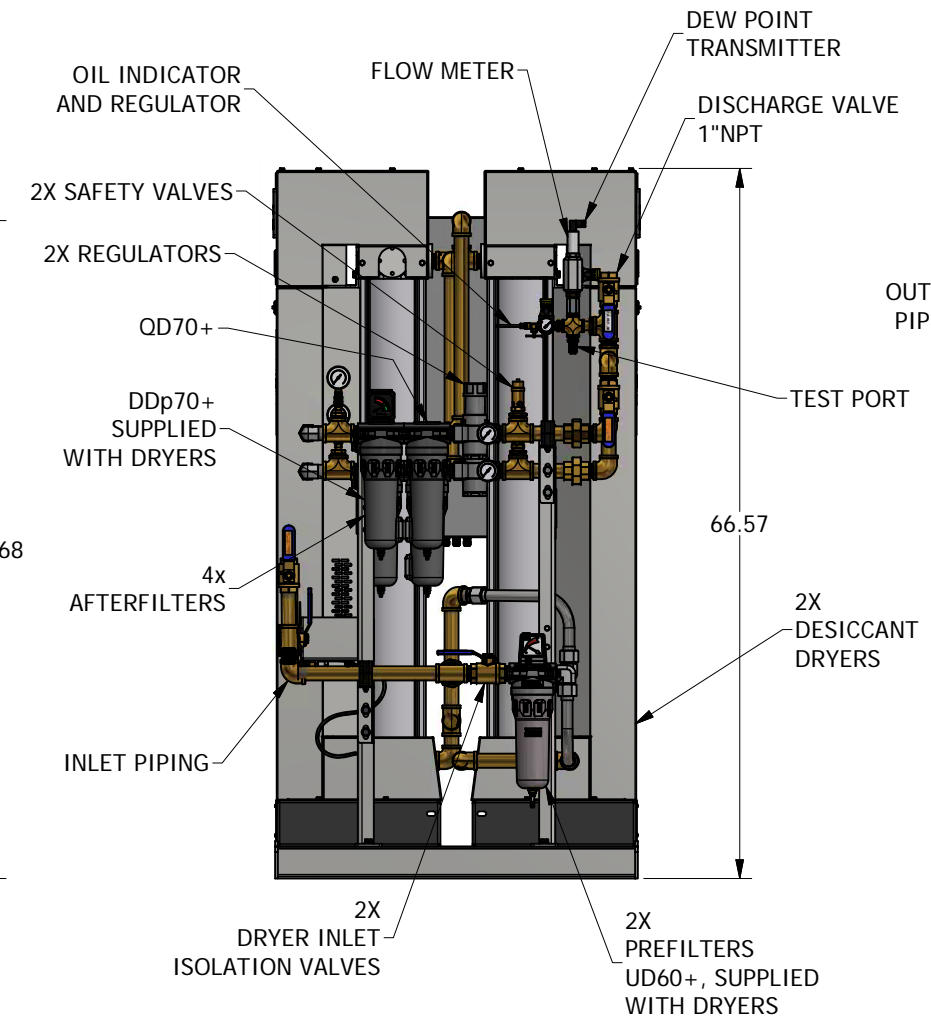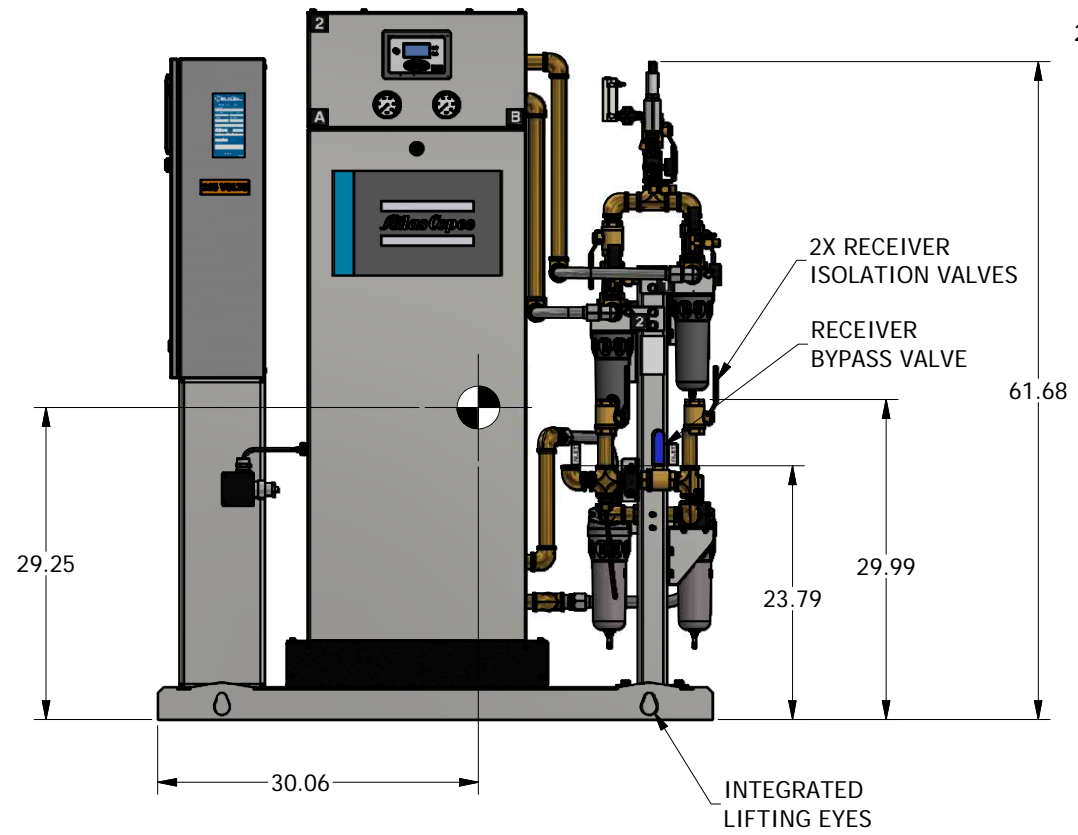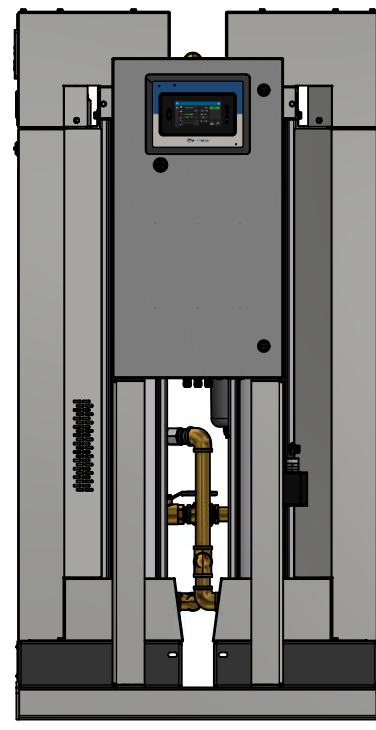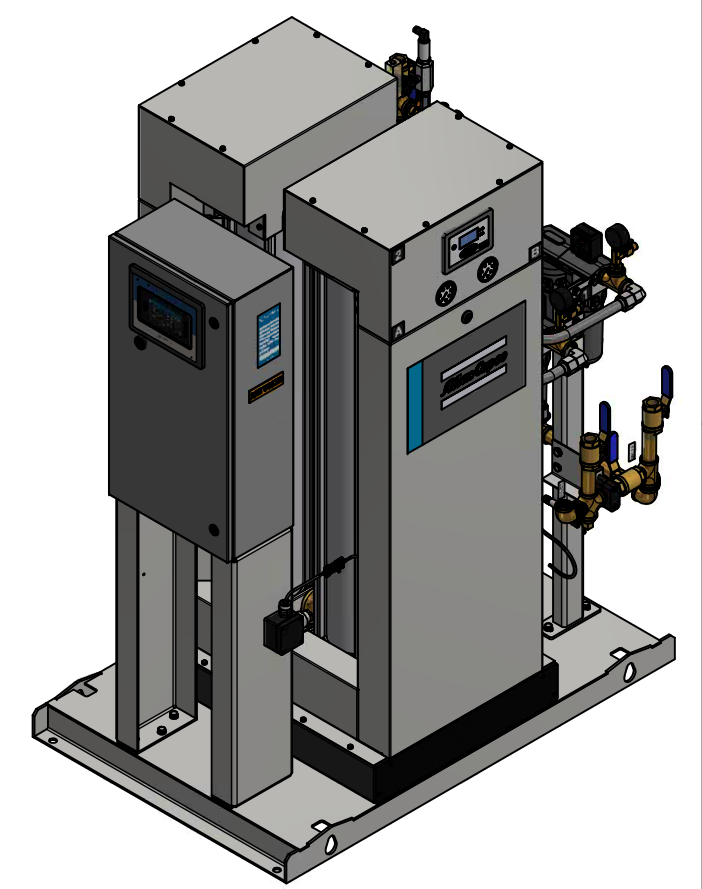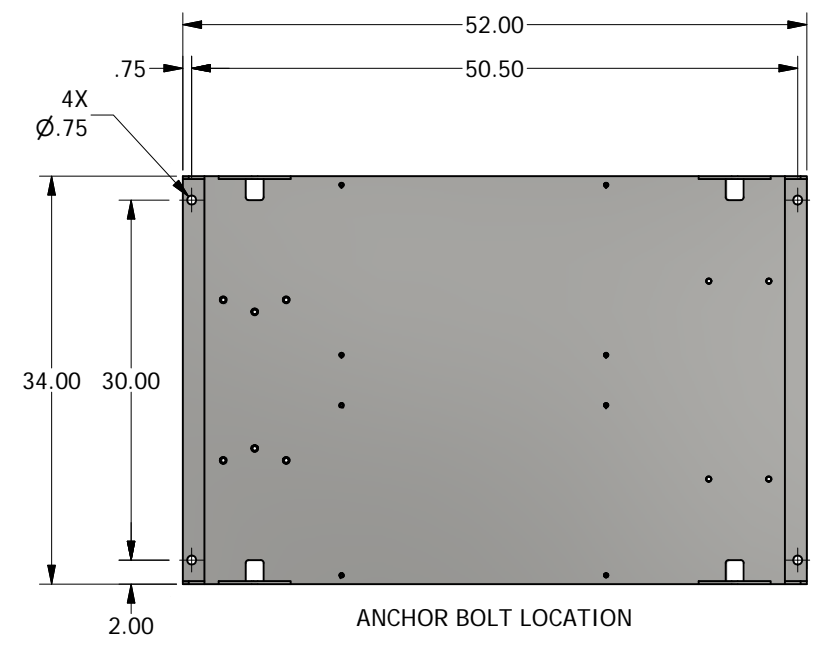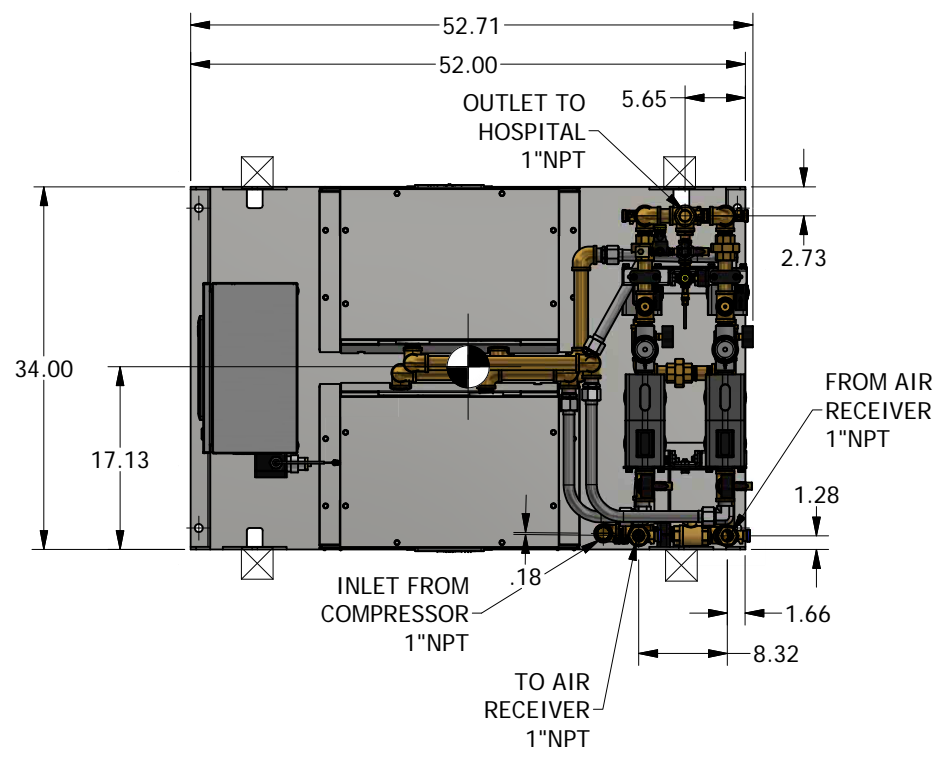


Revised:	Date:	Drawn:	Date:
		MDB	9/30/2020
		This drawing and the information contained therein remain the property of BeaconMedes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedes Engineering.	
Description: GENERAL ASSEMBLY CD65 DRYER MODULE 137CFM Z-MED MEDICAL AIR SYSTEM MK5 TOUCH		Drawing Number: 4107 8563 67	Scale: 1:9 
Sheet 1 of 2		Rev: 00	DO NOT SCALE THIS DOCUMENT

Notes:

1. ASME CODE CONSTRUCTION.
2. DESIGN PRESSURE: 200 PSI AT 400°F.
3. NATION BOARD REGISTERED.
4. ALL OPENINGS ARE NPT THREADED.
5. WEIGHT: 520 LBS (TANK) AND 22 LBS (SIGHT GLASS ASM).
6.  DENOTES CENTER OF GRAVITY.

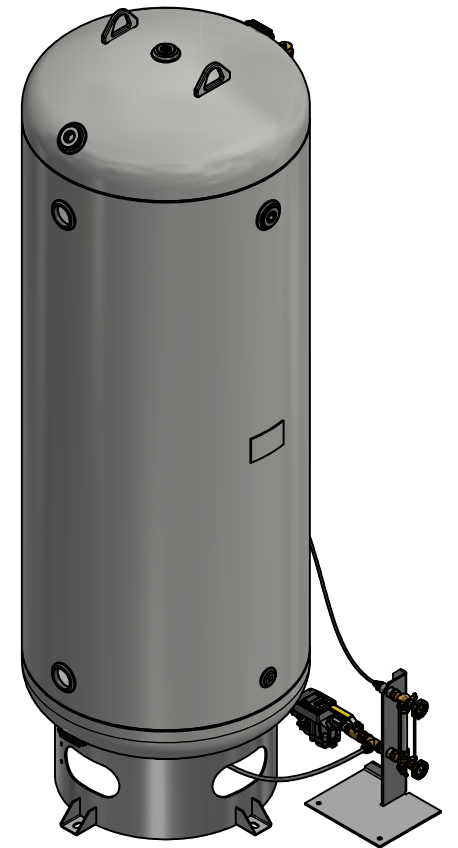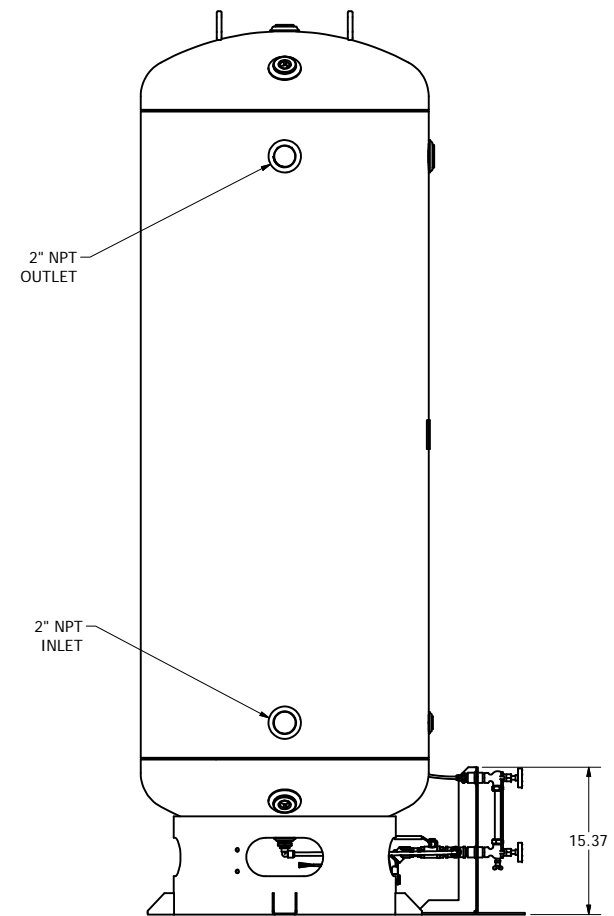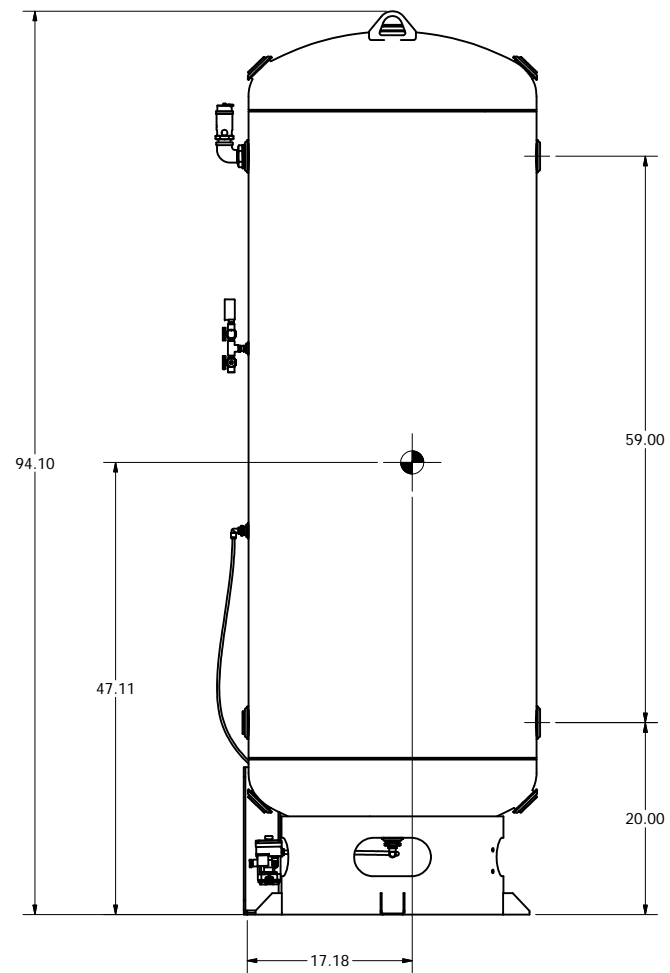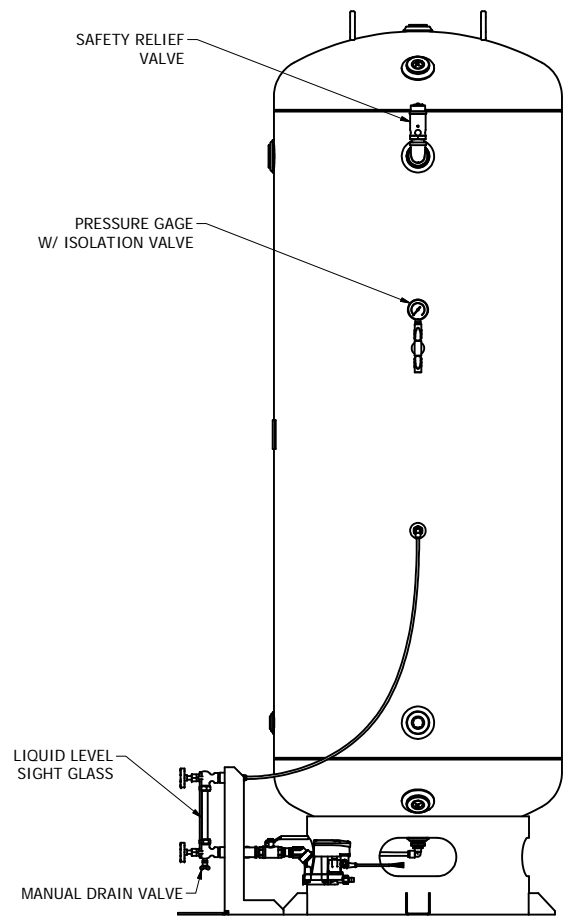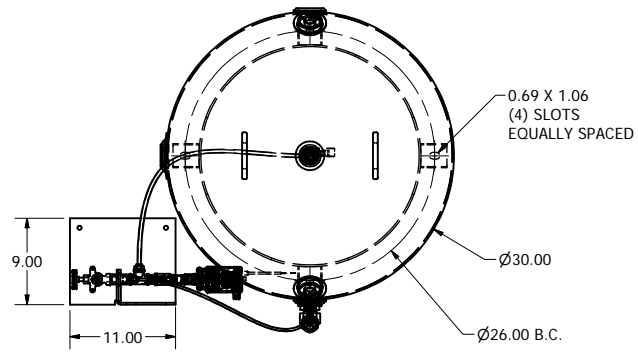

Revised:	Date:	Drawn: MDB	Date: 7/8/2021
		This drawing and the information contained therein remain the property of BeaconMedes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedes Engineering.	
Description: AIR RECEIVER TANK - 240 GALLON W/STAND ALONE SIGHT GLASS & DRAIN		Drawing Number: 4107 0082 31	Scale: 1/10
DN: HOP211010		Rev: 00	DO NOT SCALE THIS DOCUMENT.
Sheet 1 of 1		1	