Notes:

1. DISCHARGE MUFFLER WILL BE SHIPPED LOOSE.
2. PUMP MODULE WEIGHT: 1,988 LBS (INCLUDES FUTURE EXPANSION PUMP).
   120G TANK WEIGHT: 393 LBS.
3. ⊠ INDICATES LIFTING POINT.
4. ⊕ DENOTES CENTER OF GRAVITY (INCLUDES FUTURE EXPANSION PUMP).

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN LOCATION

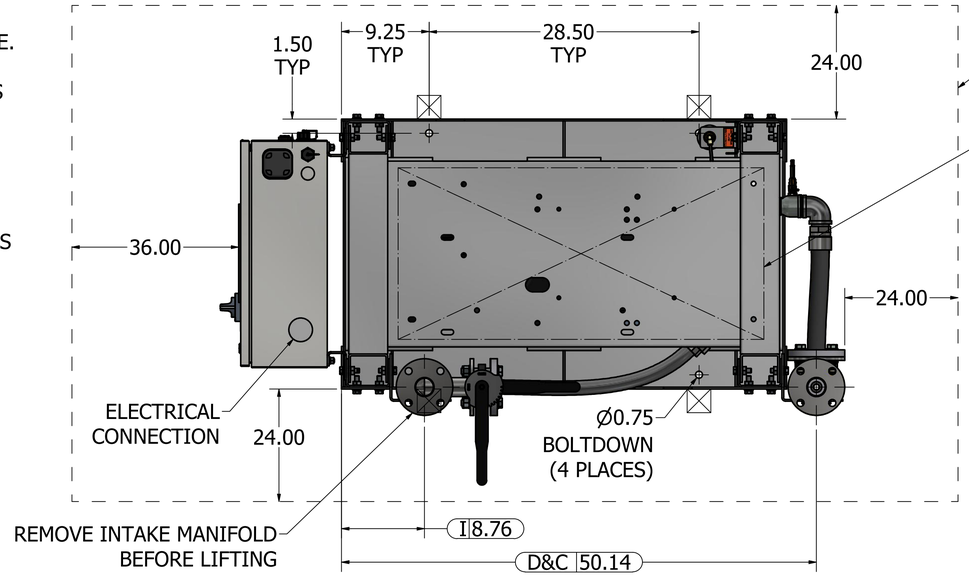

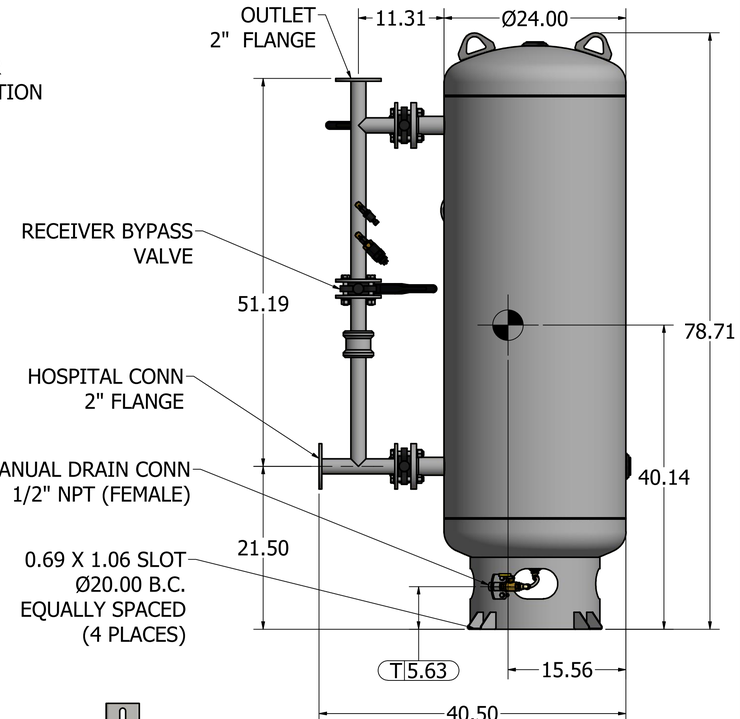

120 GAL VACUUM RECEIVER
2" FLANGED CONNECTIONS
(SCALE 1:10)

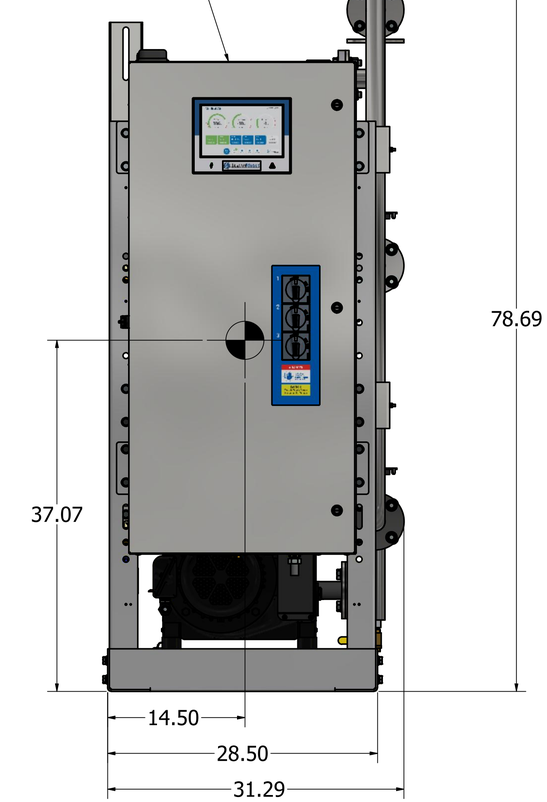

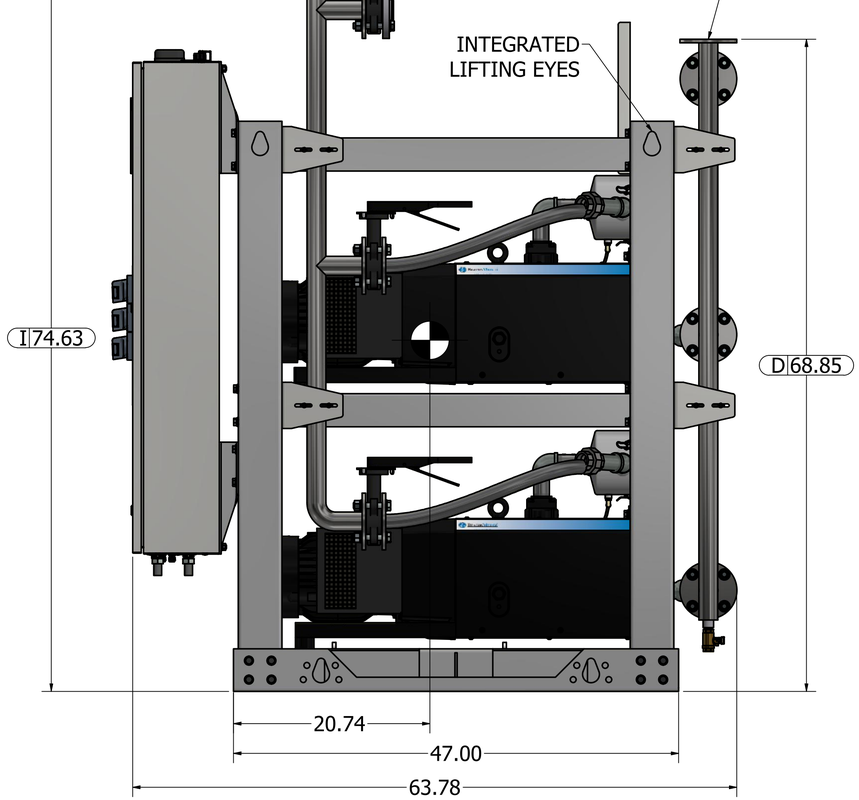

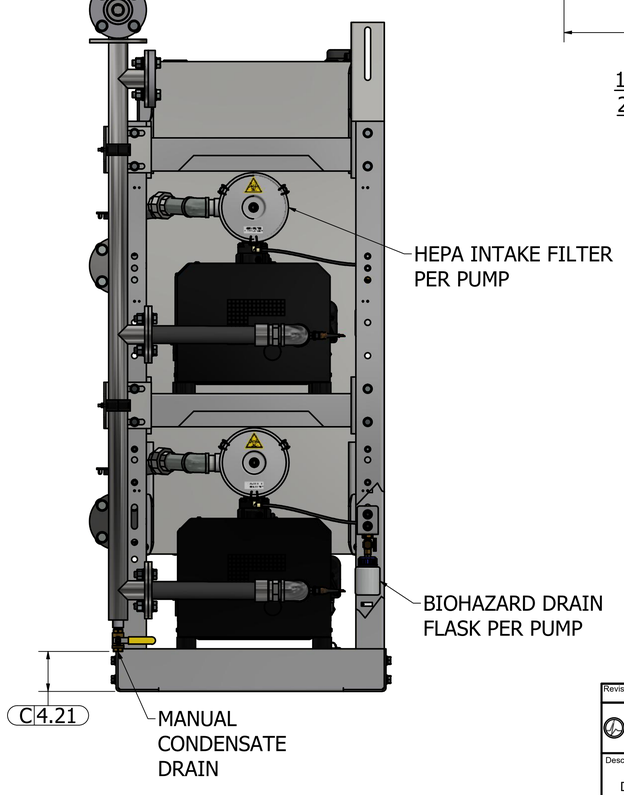

Revised: a00545201	Date: 3/30/2023	Drawn: usnbw	Date: 3/29/2010
BEACONMEDAES	This drawing and the information contained thereon remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering.		Scale: D
Description: GENERAL ASSEMBLY 5.4HP DX-X-TX CLAW VAC MOD 120G RECEIVER STANDARD AND O2 ASSURED		Part Number: 4107 8514 83	
		DN: HOP230841	Rev: 03
		Sheet 1 of 1	DO NOT SCALE THIS DOCUMENT