Notes:

1. DISCHARGE MUFFLER WILL BE SHIPPED LOOSE.
2. PUMP MODULE WEIGHT: 1,988 LBS (INCLUDES FUTURE EXPANSION PUMP).
   240G TANK WEIGHT: 693 LBS
3. ⊠ INDICATES LIFTING POINT.
4. ⊕ DENOTES CENTER OF GRAVITY (INCLUDES FUTURE EXPANSION PUMP).

| SYSTEM CONNECTIONS | |
|---|---|
| ID | DESCRIPTION |
| I | INLET LOCATION |
| C | DISCHARGE LOCATION |
| D | CONDENSATE DRAIN LOCATION |
| T | TANK DRAIN LOCATION |







240 GAL VACUUM RECEIVER
2" FLANGED CONNECTIONS
(SCALE 1:10)





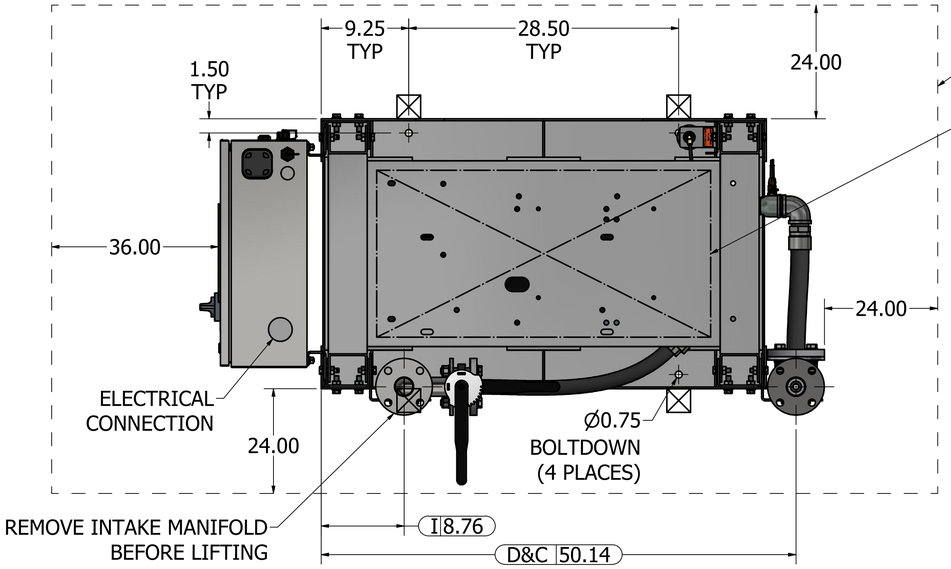

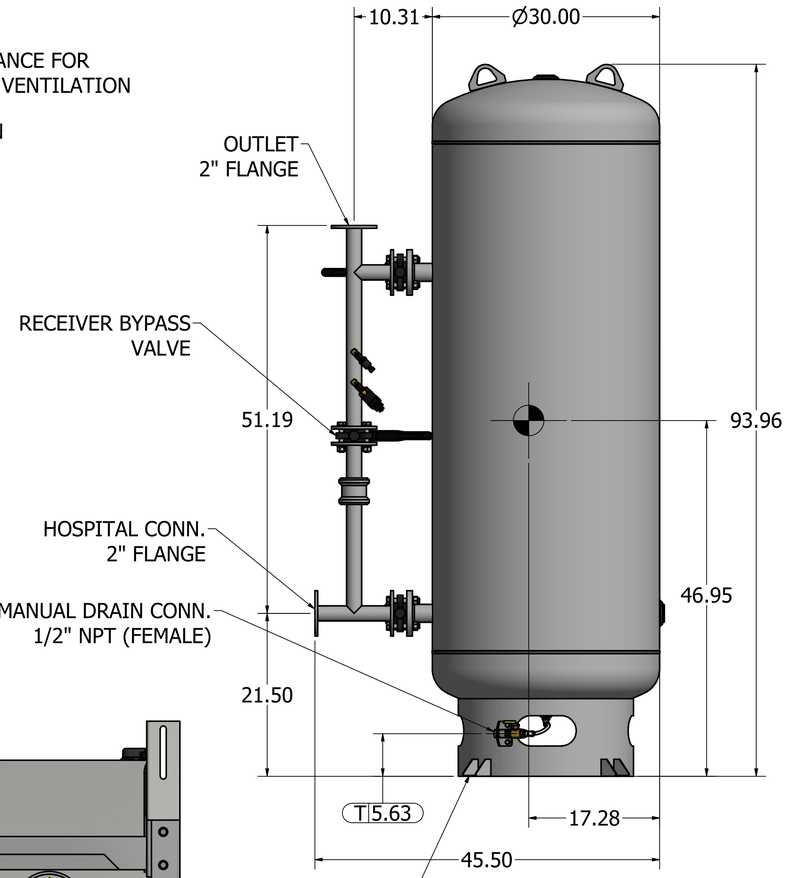


| | | | |
|---|---|---|---|
| Revised: a00545201 | Date: 3/31/2023 | Drawn: usnbw | Date: 3/29/2010 |
| BeaconMedaes | This drawing and the information contained thereon remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering. | | Scale: D |
| Description: GENERAL ASSEMBLY 5.4HP DX-X-TX CLAW VAC MOD 240G RECEIVER STANDARD AND O2 ASSURED | | Part Number: 4107 8514 85 | |
| | | DN: HOP230841 | Rev: 03 |
| | | Sheet 1 of 1 | DO NOT SCALE THIS DOCUMENT |