

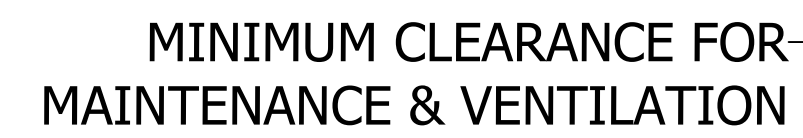


Notes:

1. SYSTEM WEIGHT: 6,930 LBS.
(INCLUDES FUTURE EXPANSION PUMP)
2.  INDICATES LIFTING POINT.
3.  DENOTES CENTER OF GRAVITY.
(INCLUDES FUTURE EXPANSION PUMP)

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN LOCATION

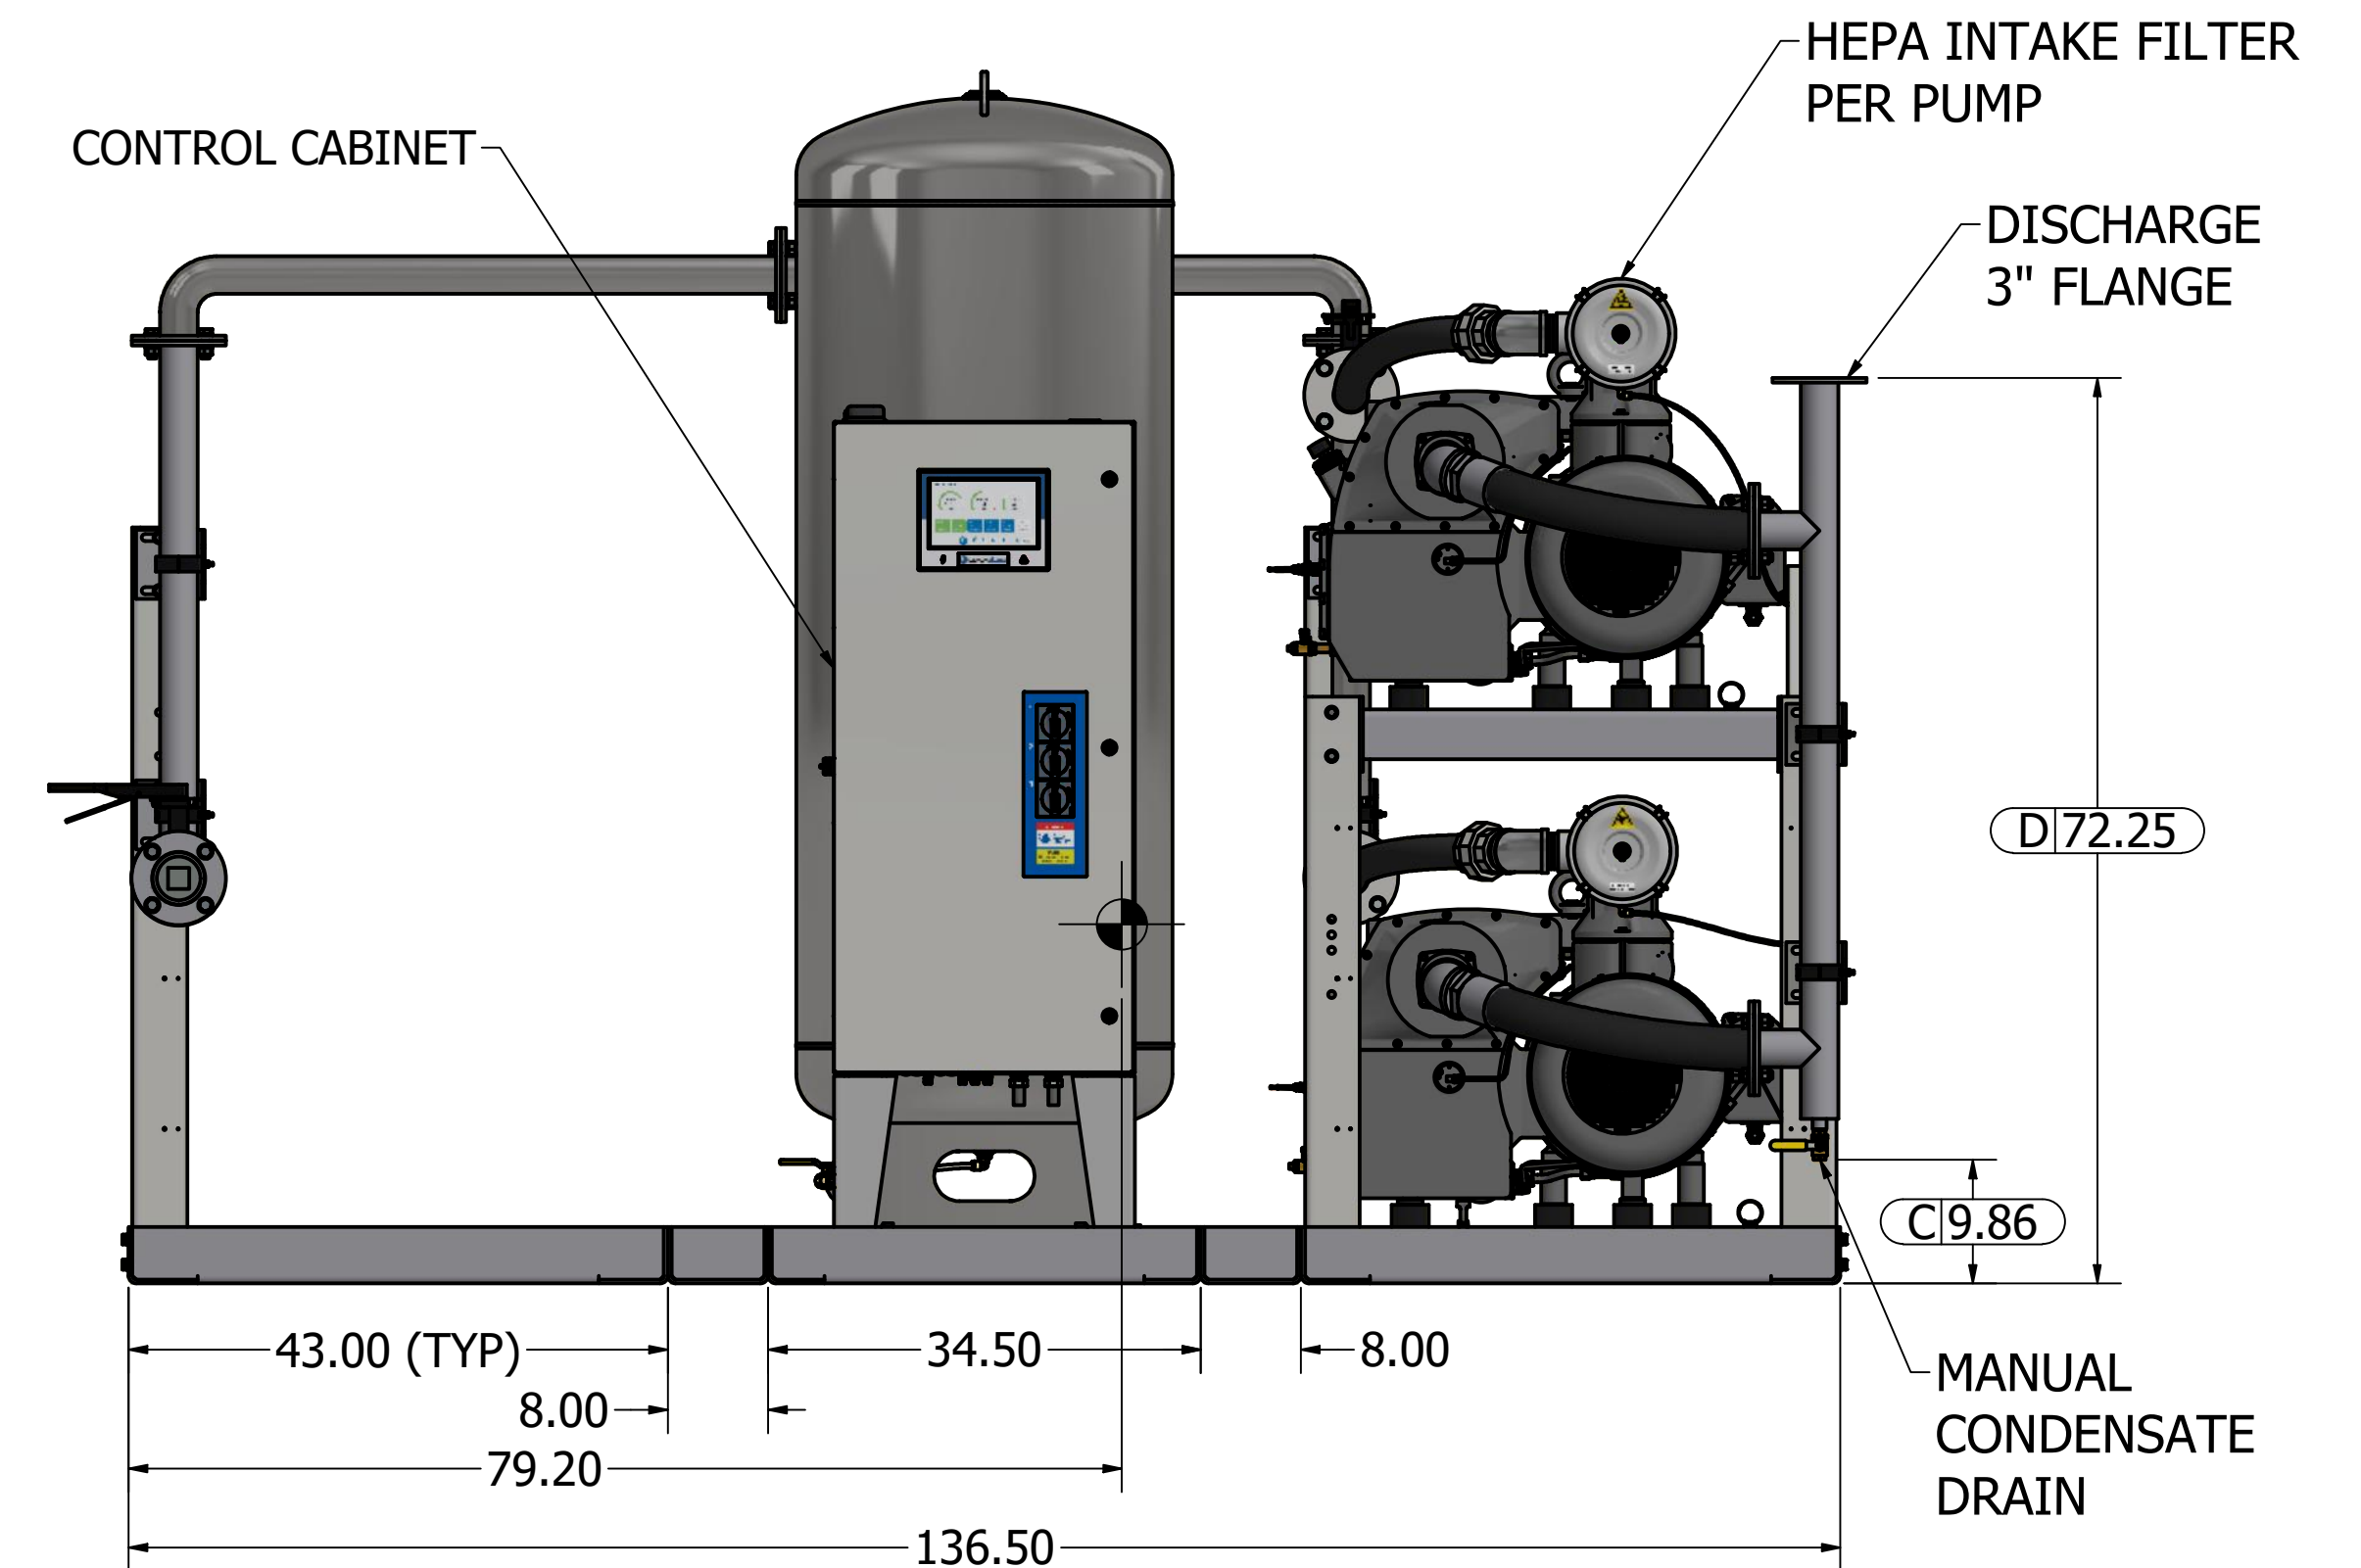
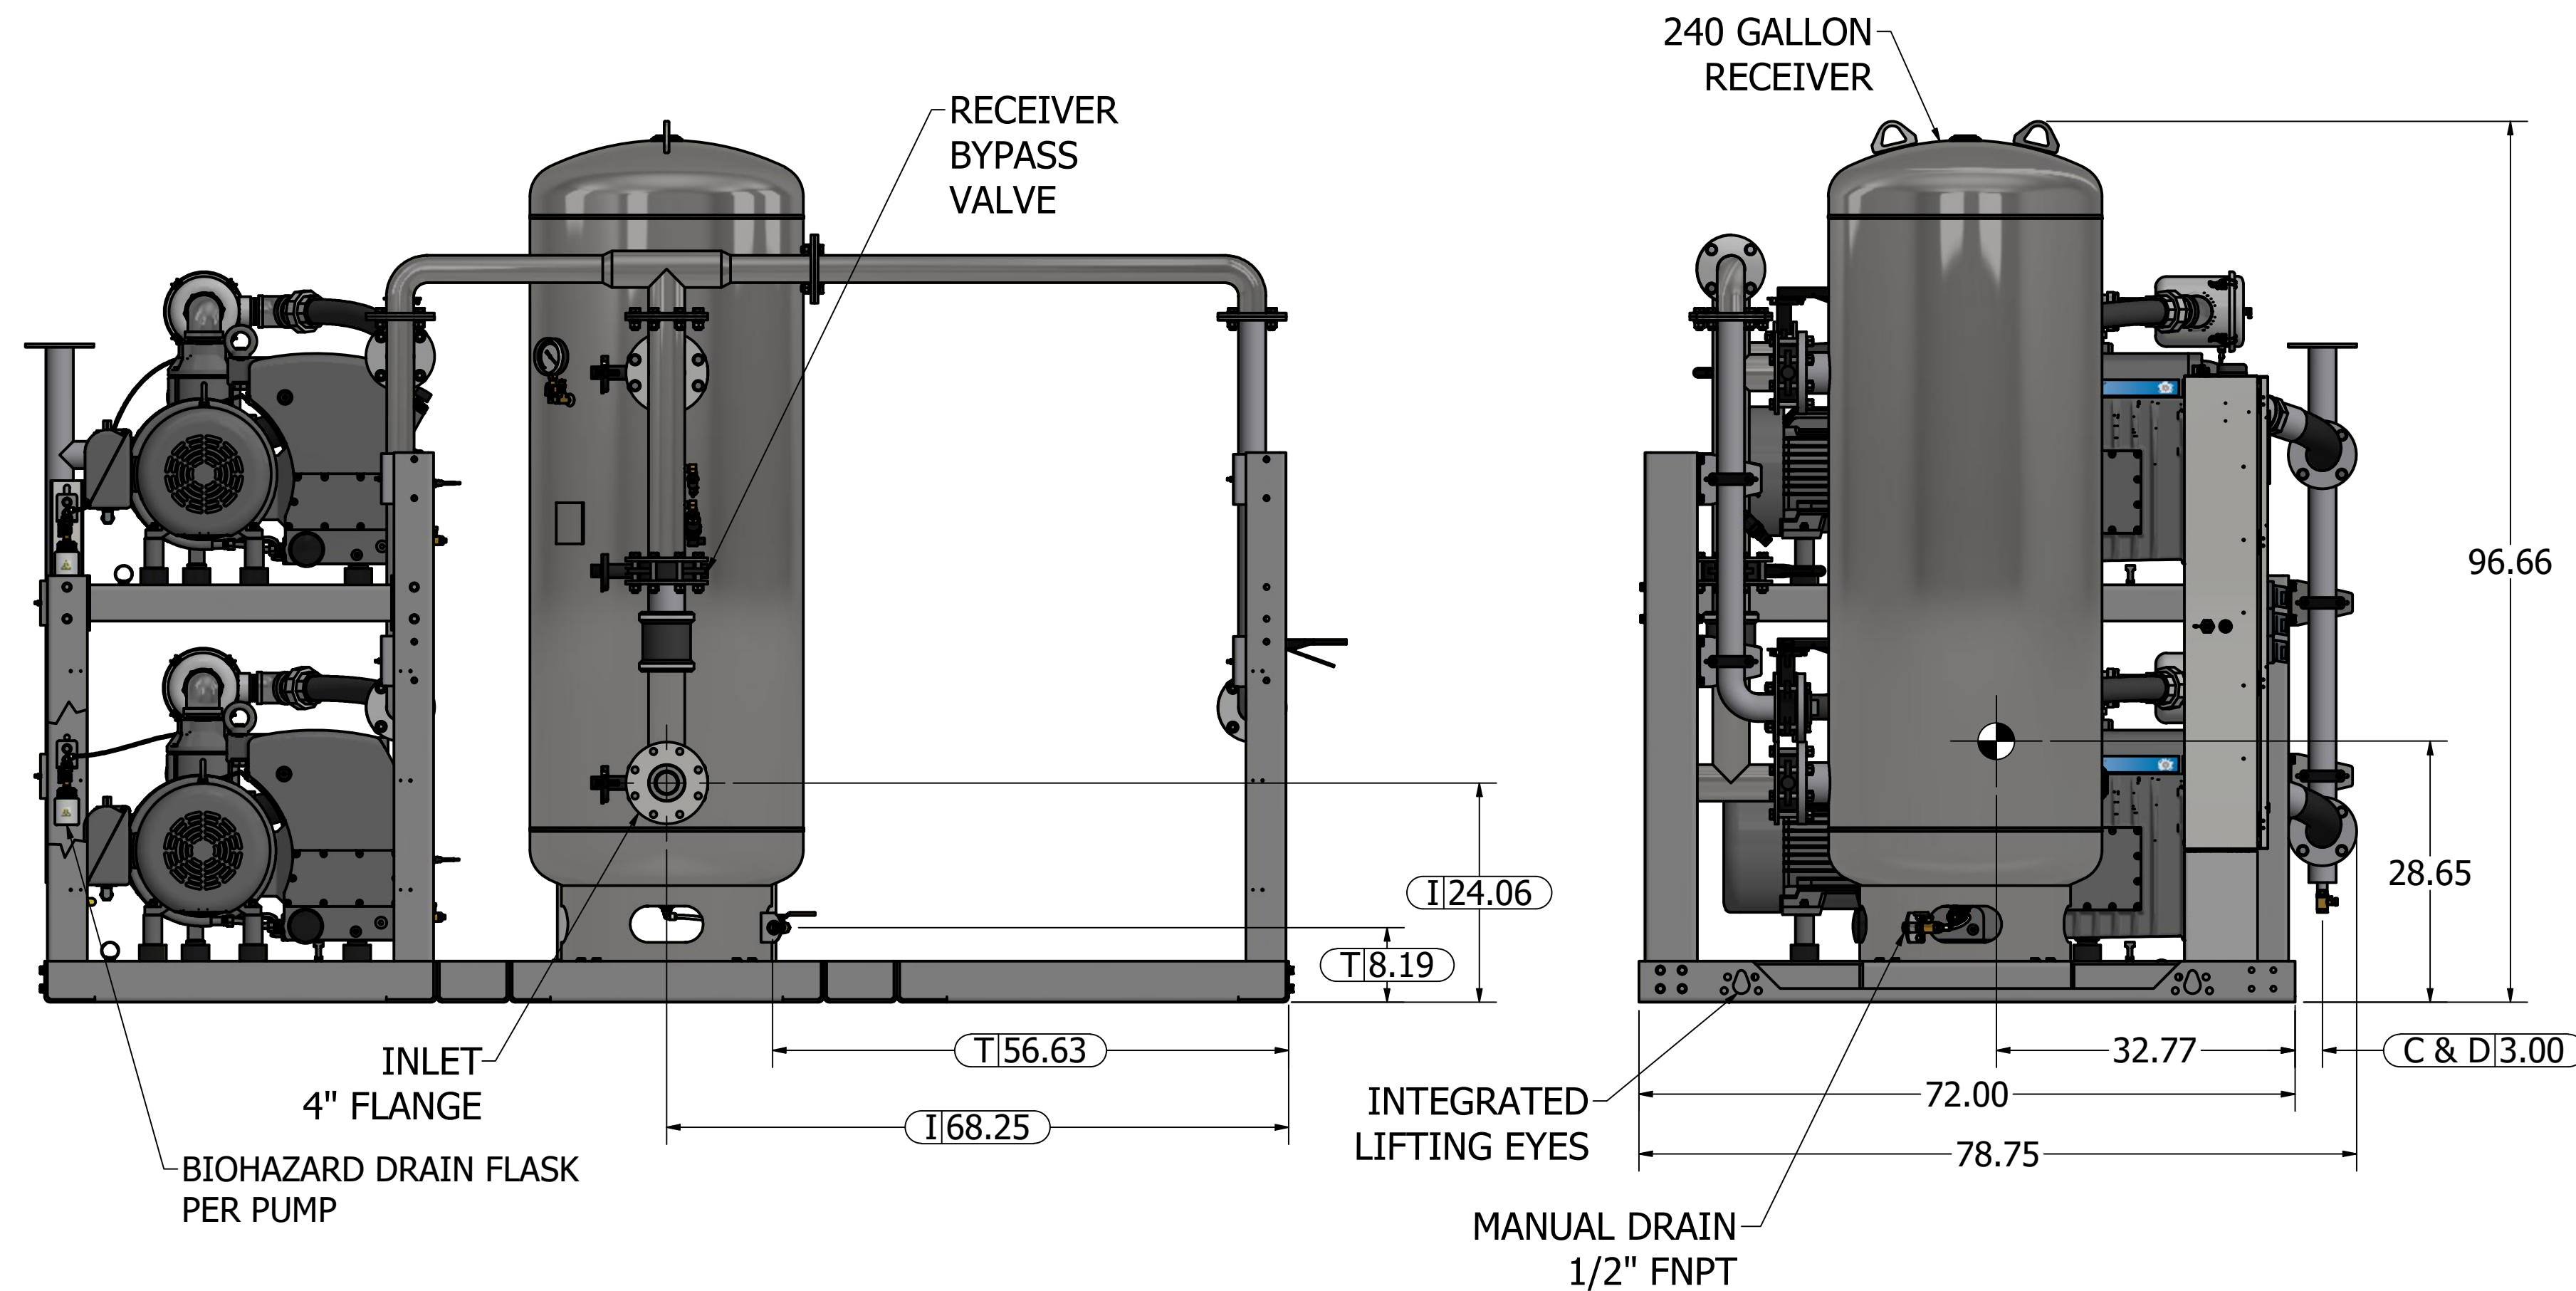




INTAKE ISOLATION
VALVE FOR FUTURE
EXPANSION PUMP

FUTURE-
EXPANSION
PUMP

ELECTRICAL
CONNECTION

—Ø0.75
BOLTDOWNS
(8 PLACES)



Revised:	APS	Date:	3/22/2023	Drawn:	MDB	Date:	10/4/2010
 BEACONMEDICS		This drawing and the information contained therein remain the property of BeaconMedics and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedics Engineering.				Scale:	
Description:		Part Number:		4107 8522 88			
GENERAL ASSEMBLY 15HP DX-EXP-TX LUBE VAC SPC 240G RECEIVER		DN: HOP230842		Rev: 03			
		Sheet 1 of 1		DO NOT SCALE THIS			