



Notes:


1. SYSTEM WEIGHT: 5,220 LBS.
2.  INDICATES LIFTING POINT.
3.  DENOTES CENTER OF GRAVITY.

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATON
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN LOCATION

MINIMUM CLEARANCE FOR
MAINTENANCE & VENTILATION


Ø0.75 BOLTDOWNS
(8 PLACES)

ELECTRICAL
CONNECTION

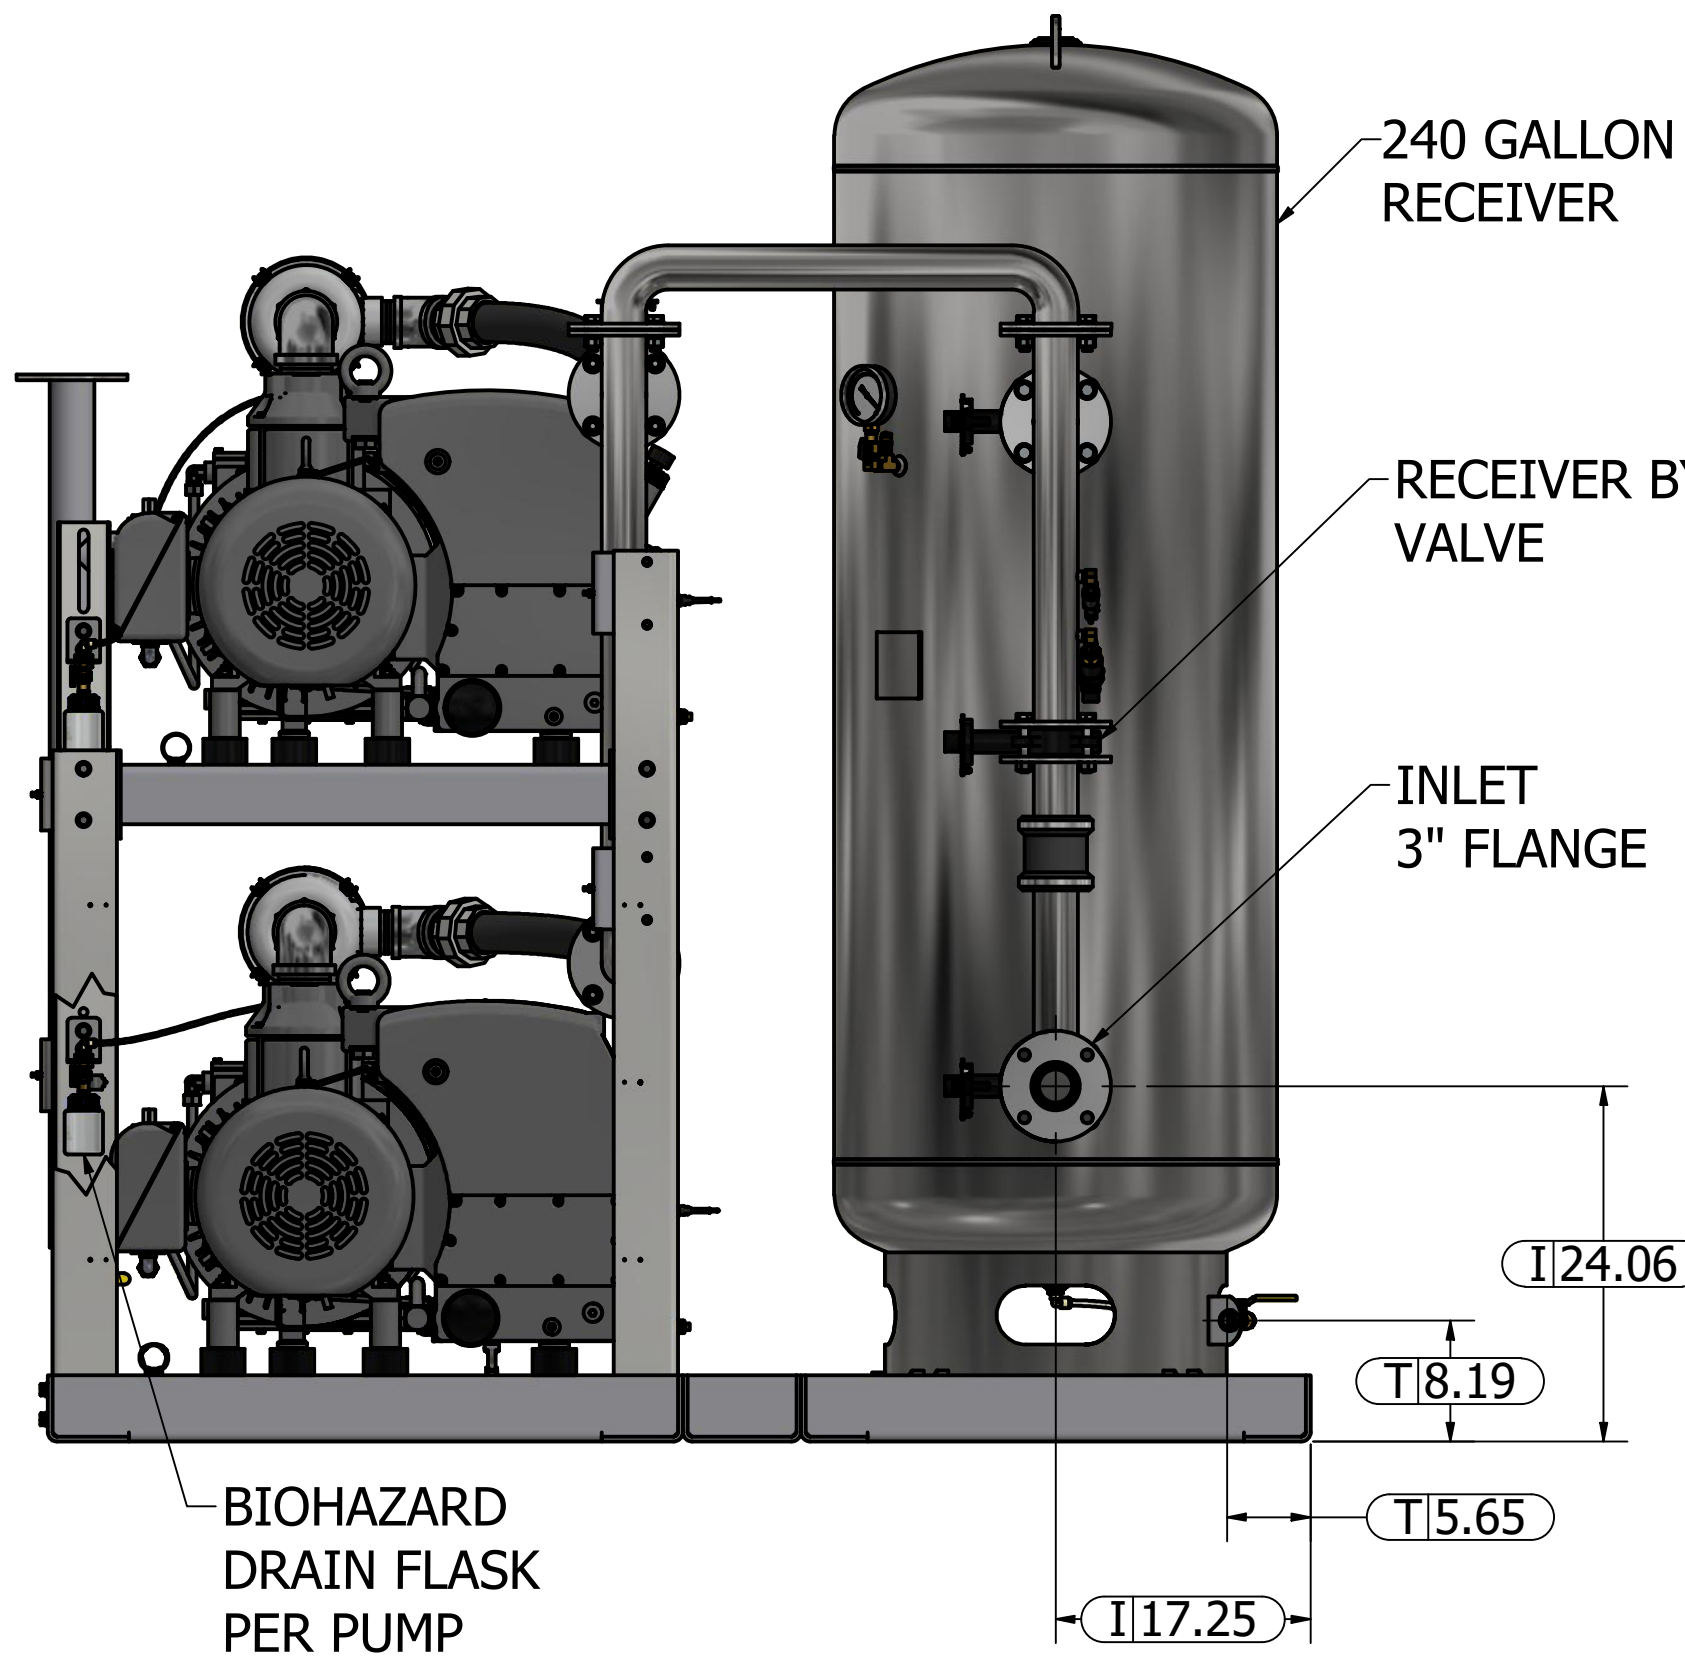

MANUAL DRAIN
1/2" NPT


INTEGRATED
LIFTING EYES

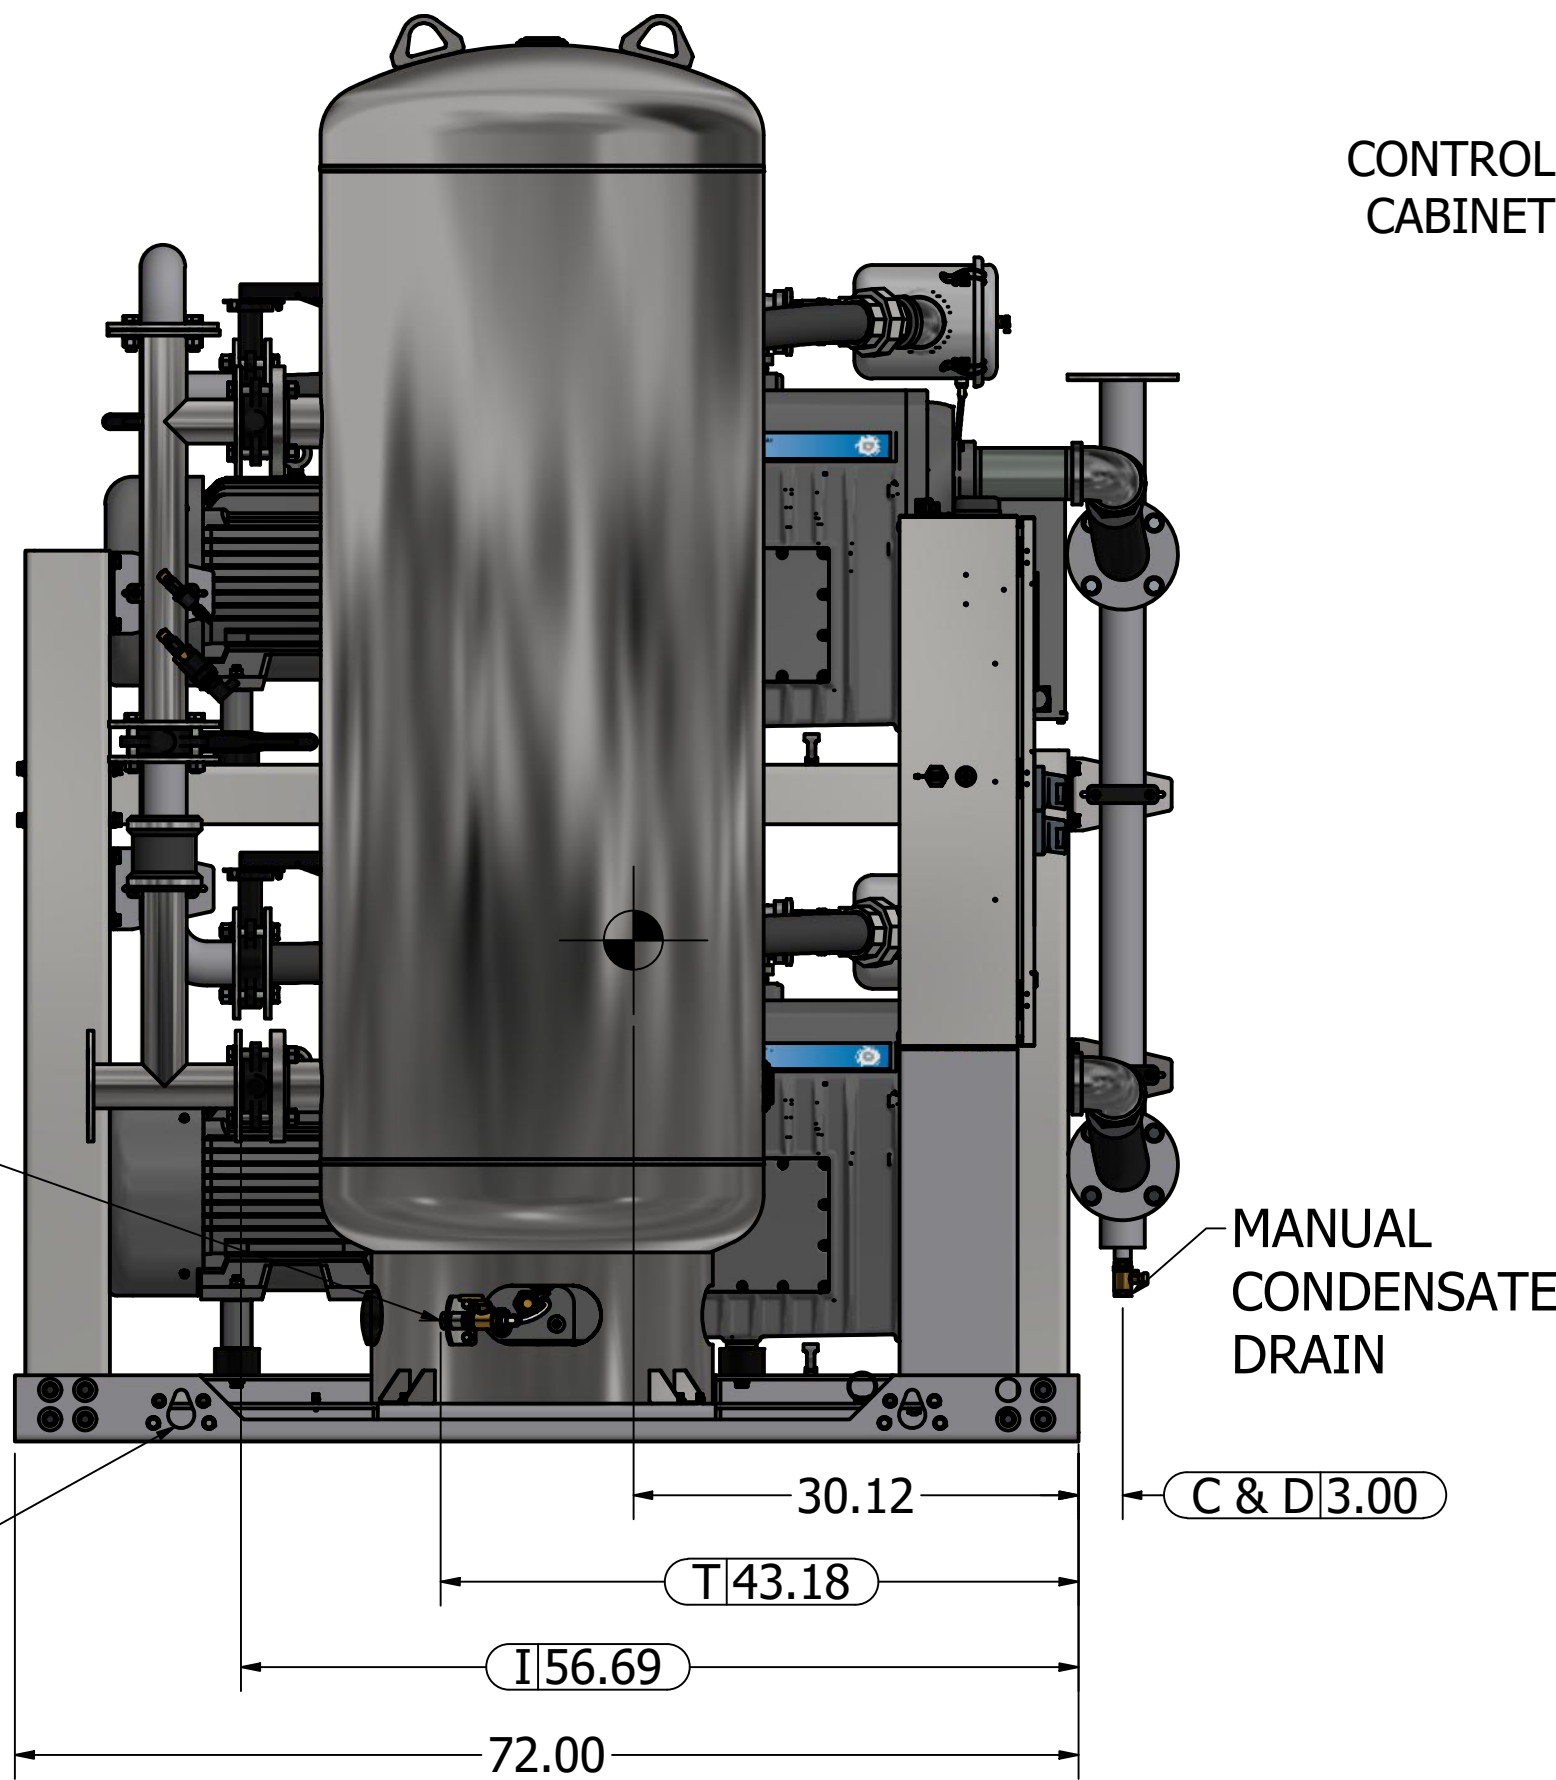


CONTROL
CABINET

HEPA INTAKE FILTER
PER PUMP

DISCHARGE
3" FLANGE

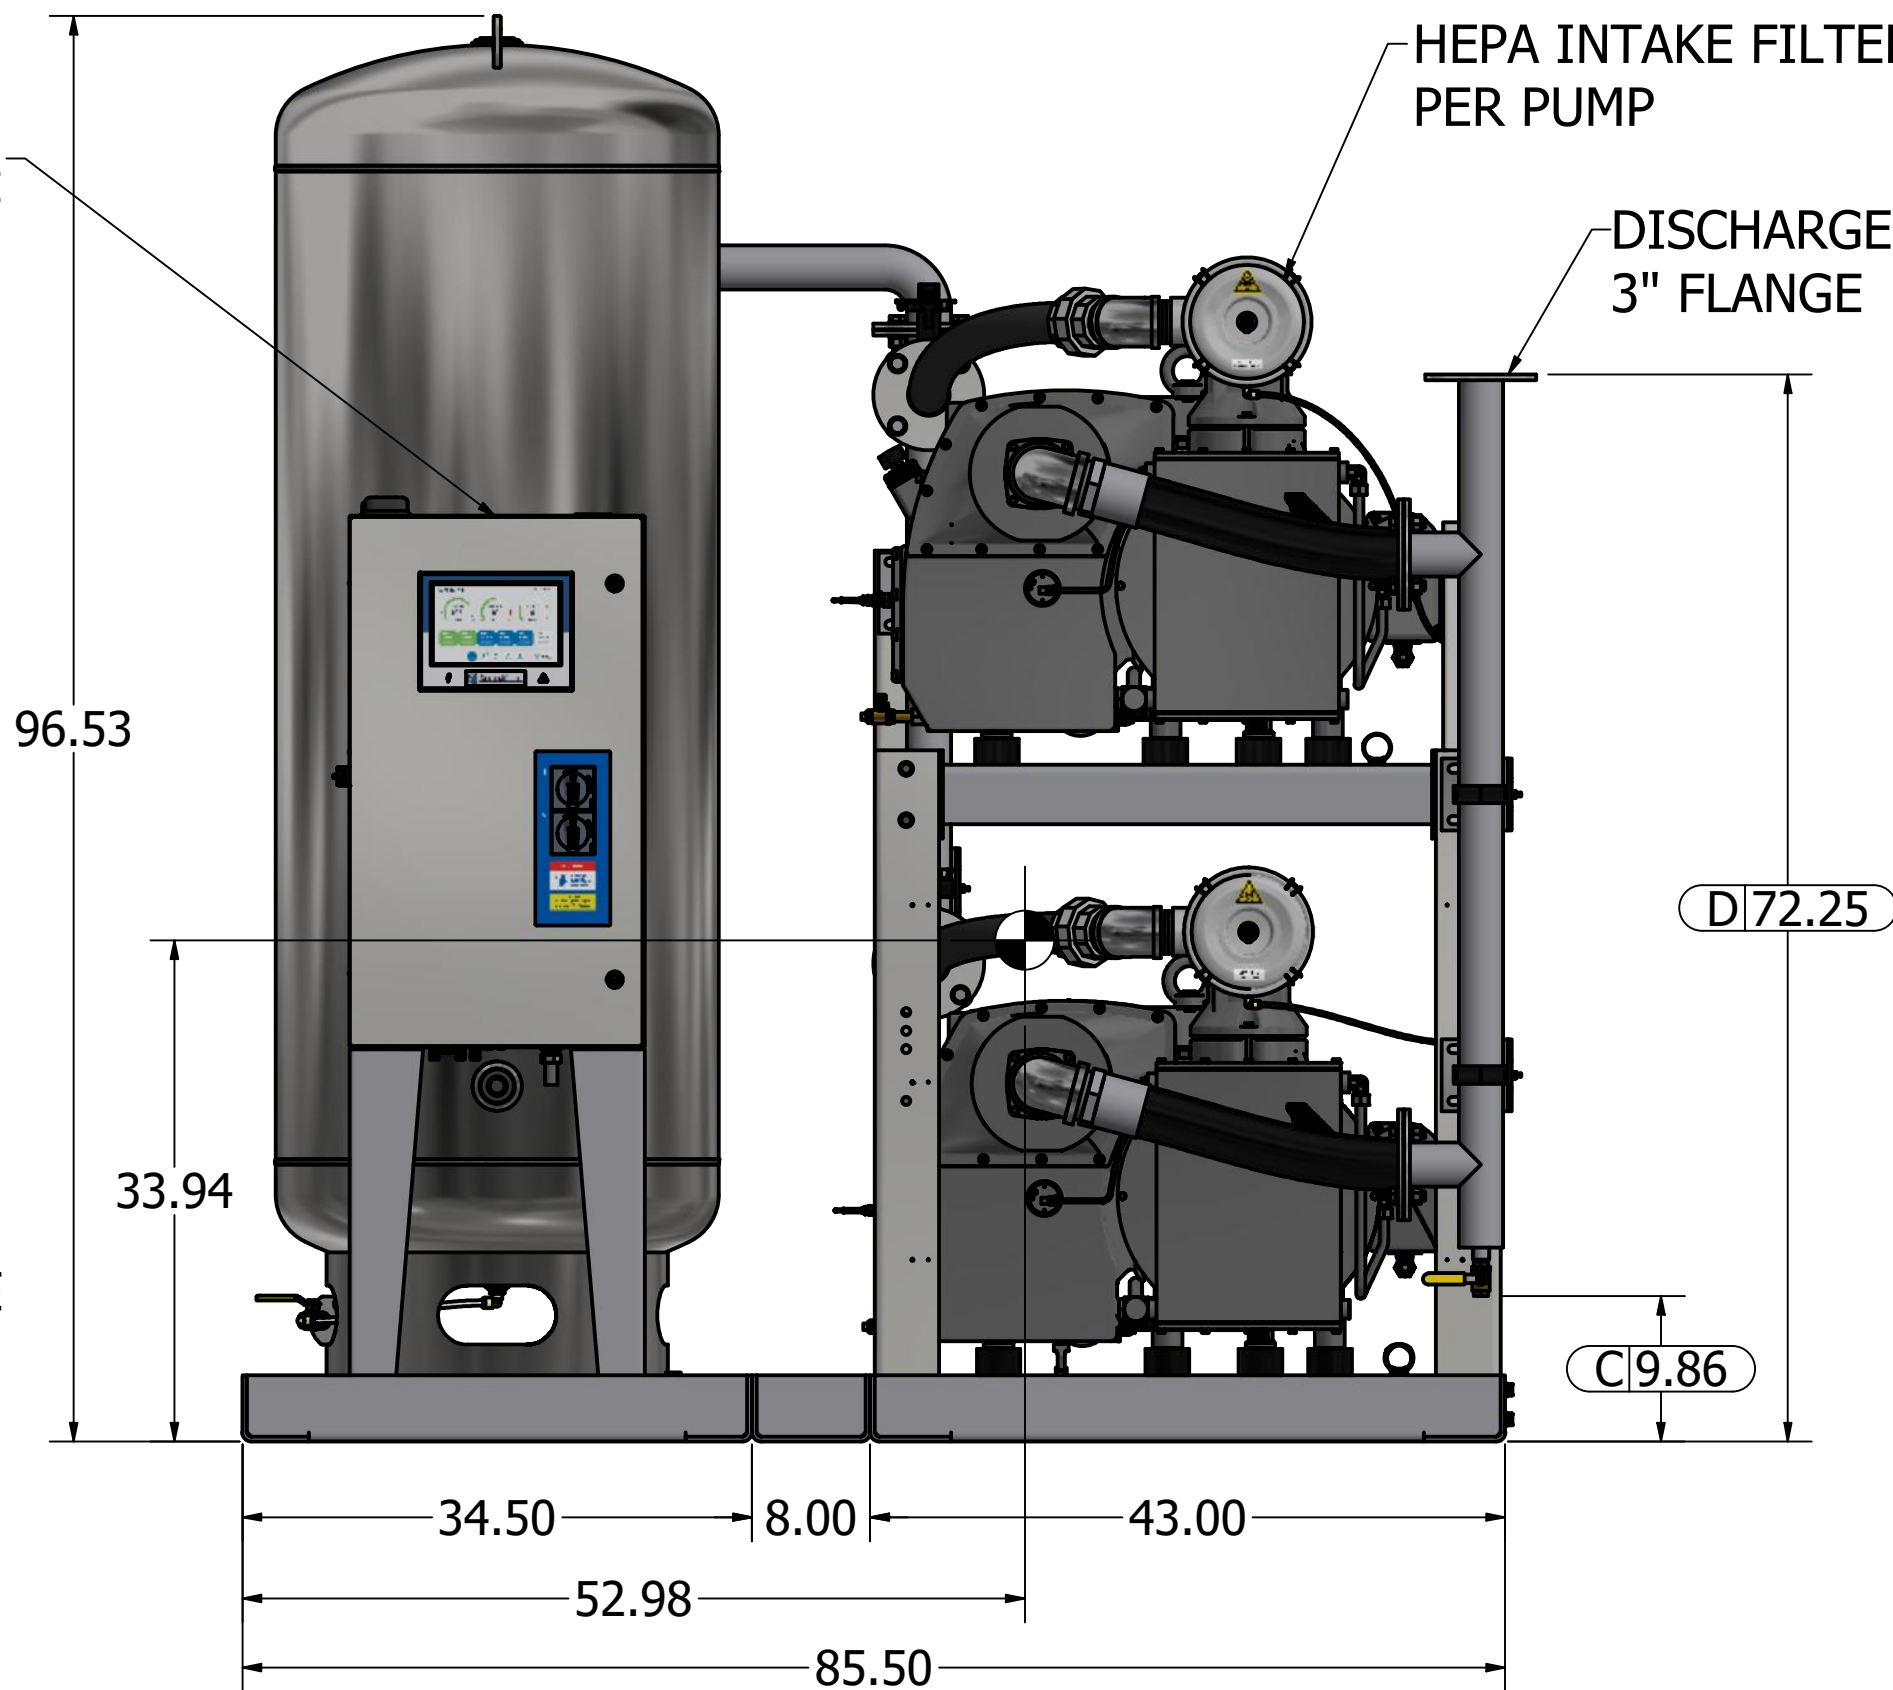

Revised: APS	Date: 3/27/2023	Drawn: MDB	Date: 9/10/2010
		This drawing and the information contained therein remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering.	
Description: GENERAL ASSEMBLY 20HP DX LUBE VAC SPC 240G RECEIVER		Part Number: 4107 8522 39	
DN: HOP230842		Rev: 03	
Sheet 1 of 1		DO NOT SCALE THIS DOCUMENT	