



Notes:


1. SYSTEM WEIGHT: 5,563 LBS.
2.  INDICATES LIFTING POINT.
3.  DENOTES CENTER OF GRAVITY.

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCAITON
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN LOCATION

MINIMUM CLEARANCE FOR
MAINTENANCE & VENTILATION



Ø0.75 BOLTDOWNS
(8 PLACES)

ELECTRICAL
CONNECTION

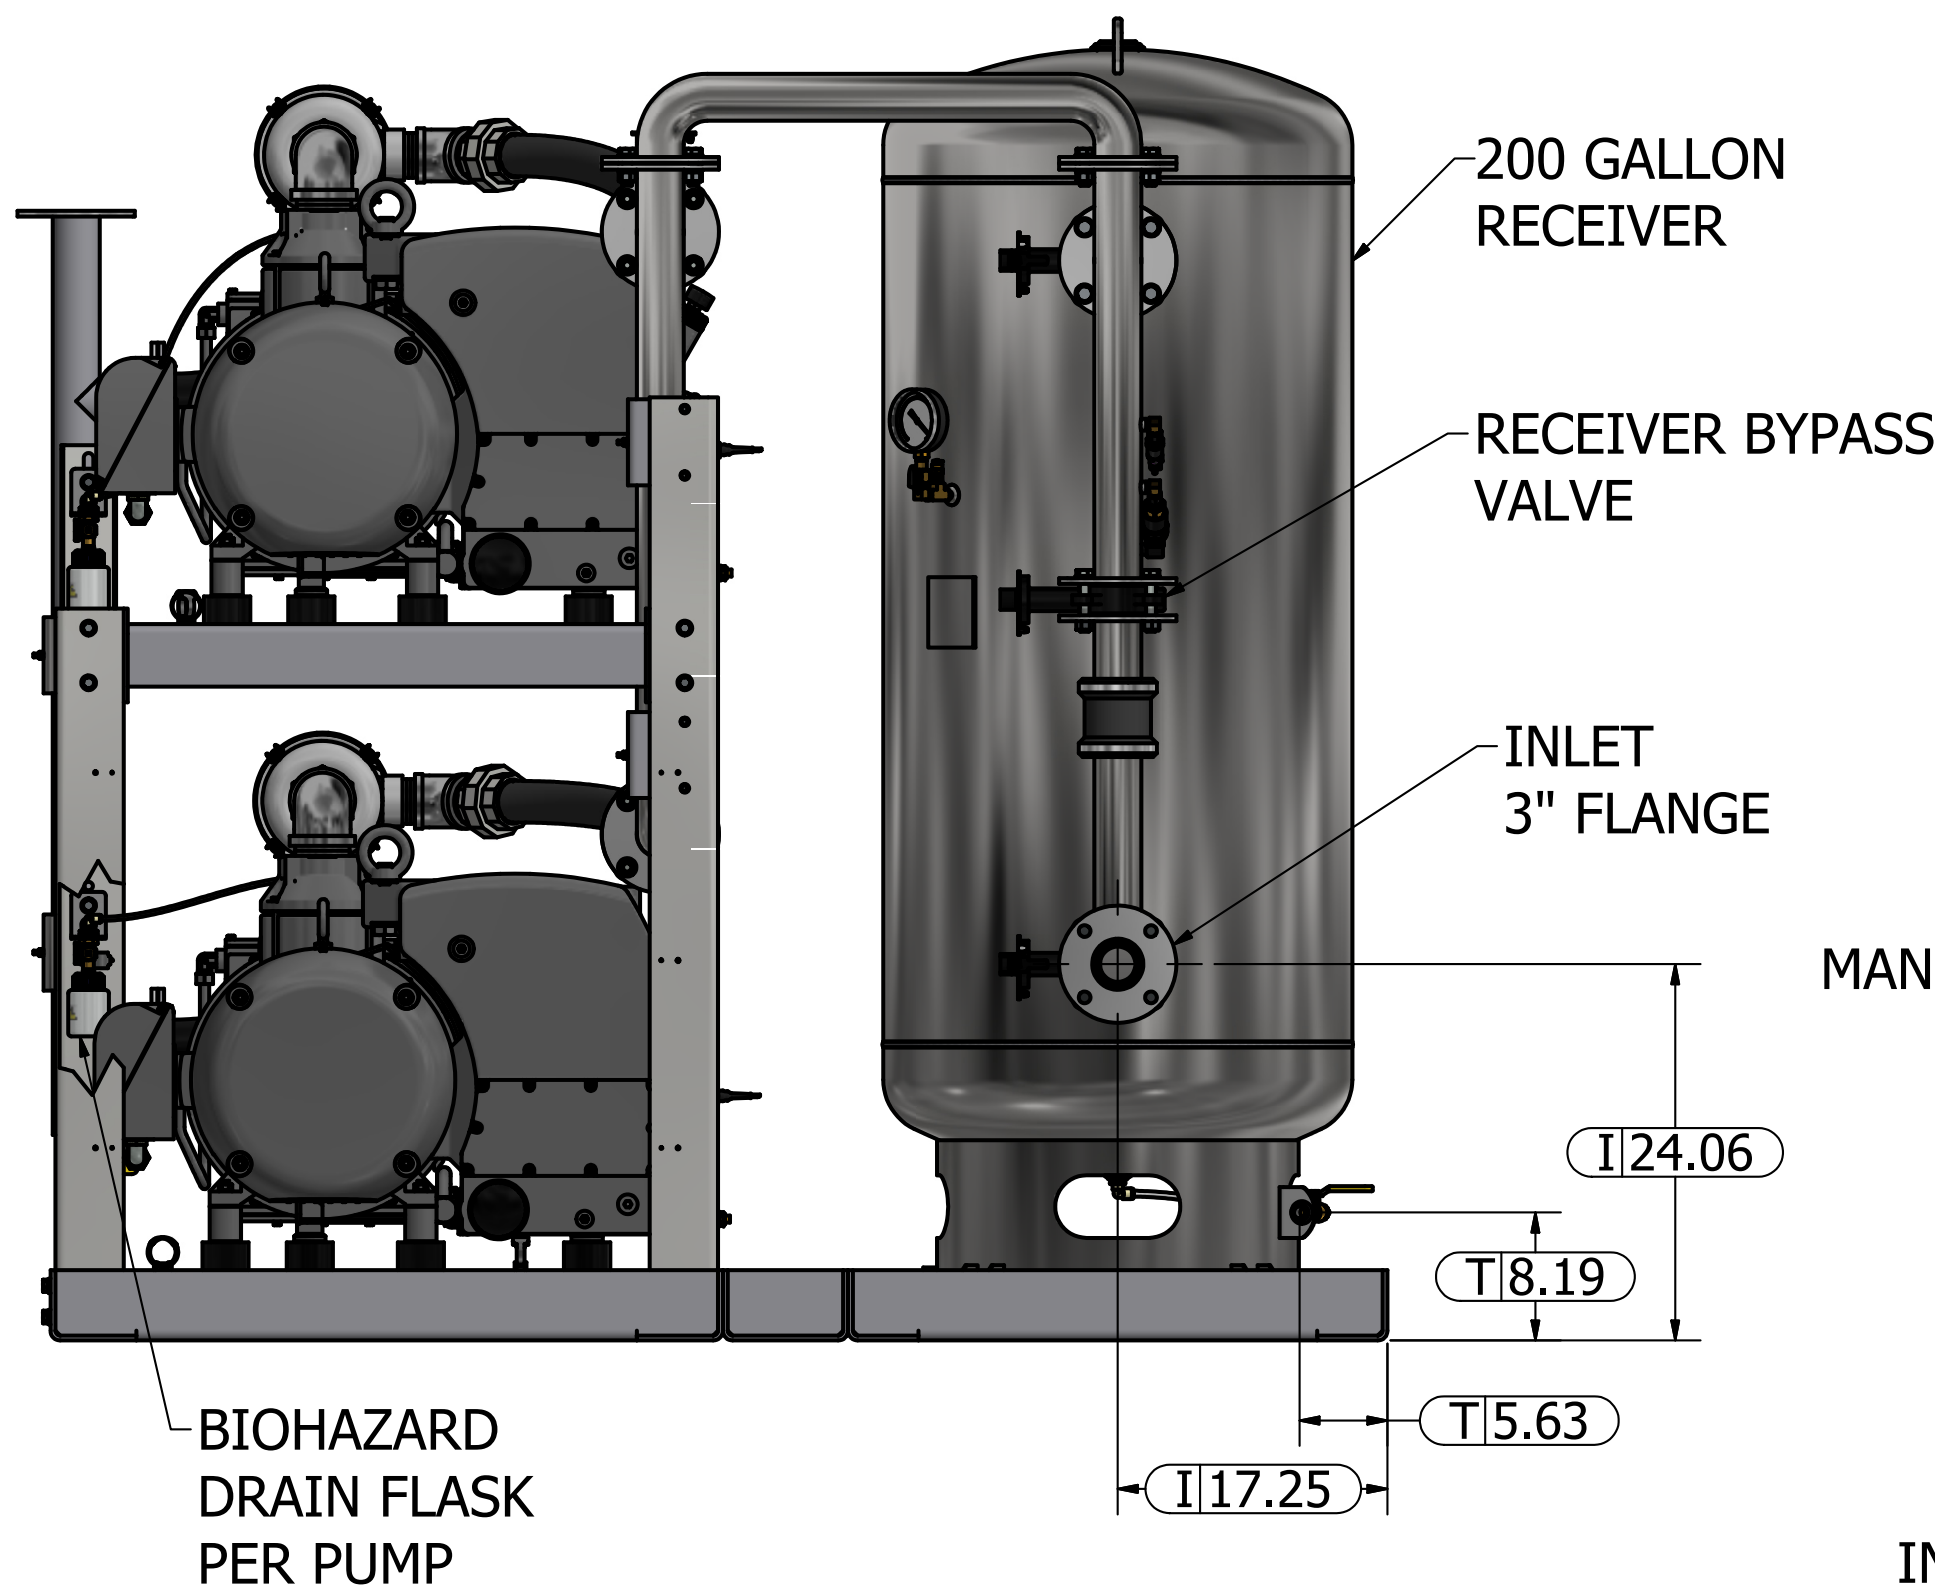


MANUAL DRAIN
1/2" NPT

INTEGRATED
LIFTING EYES

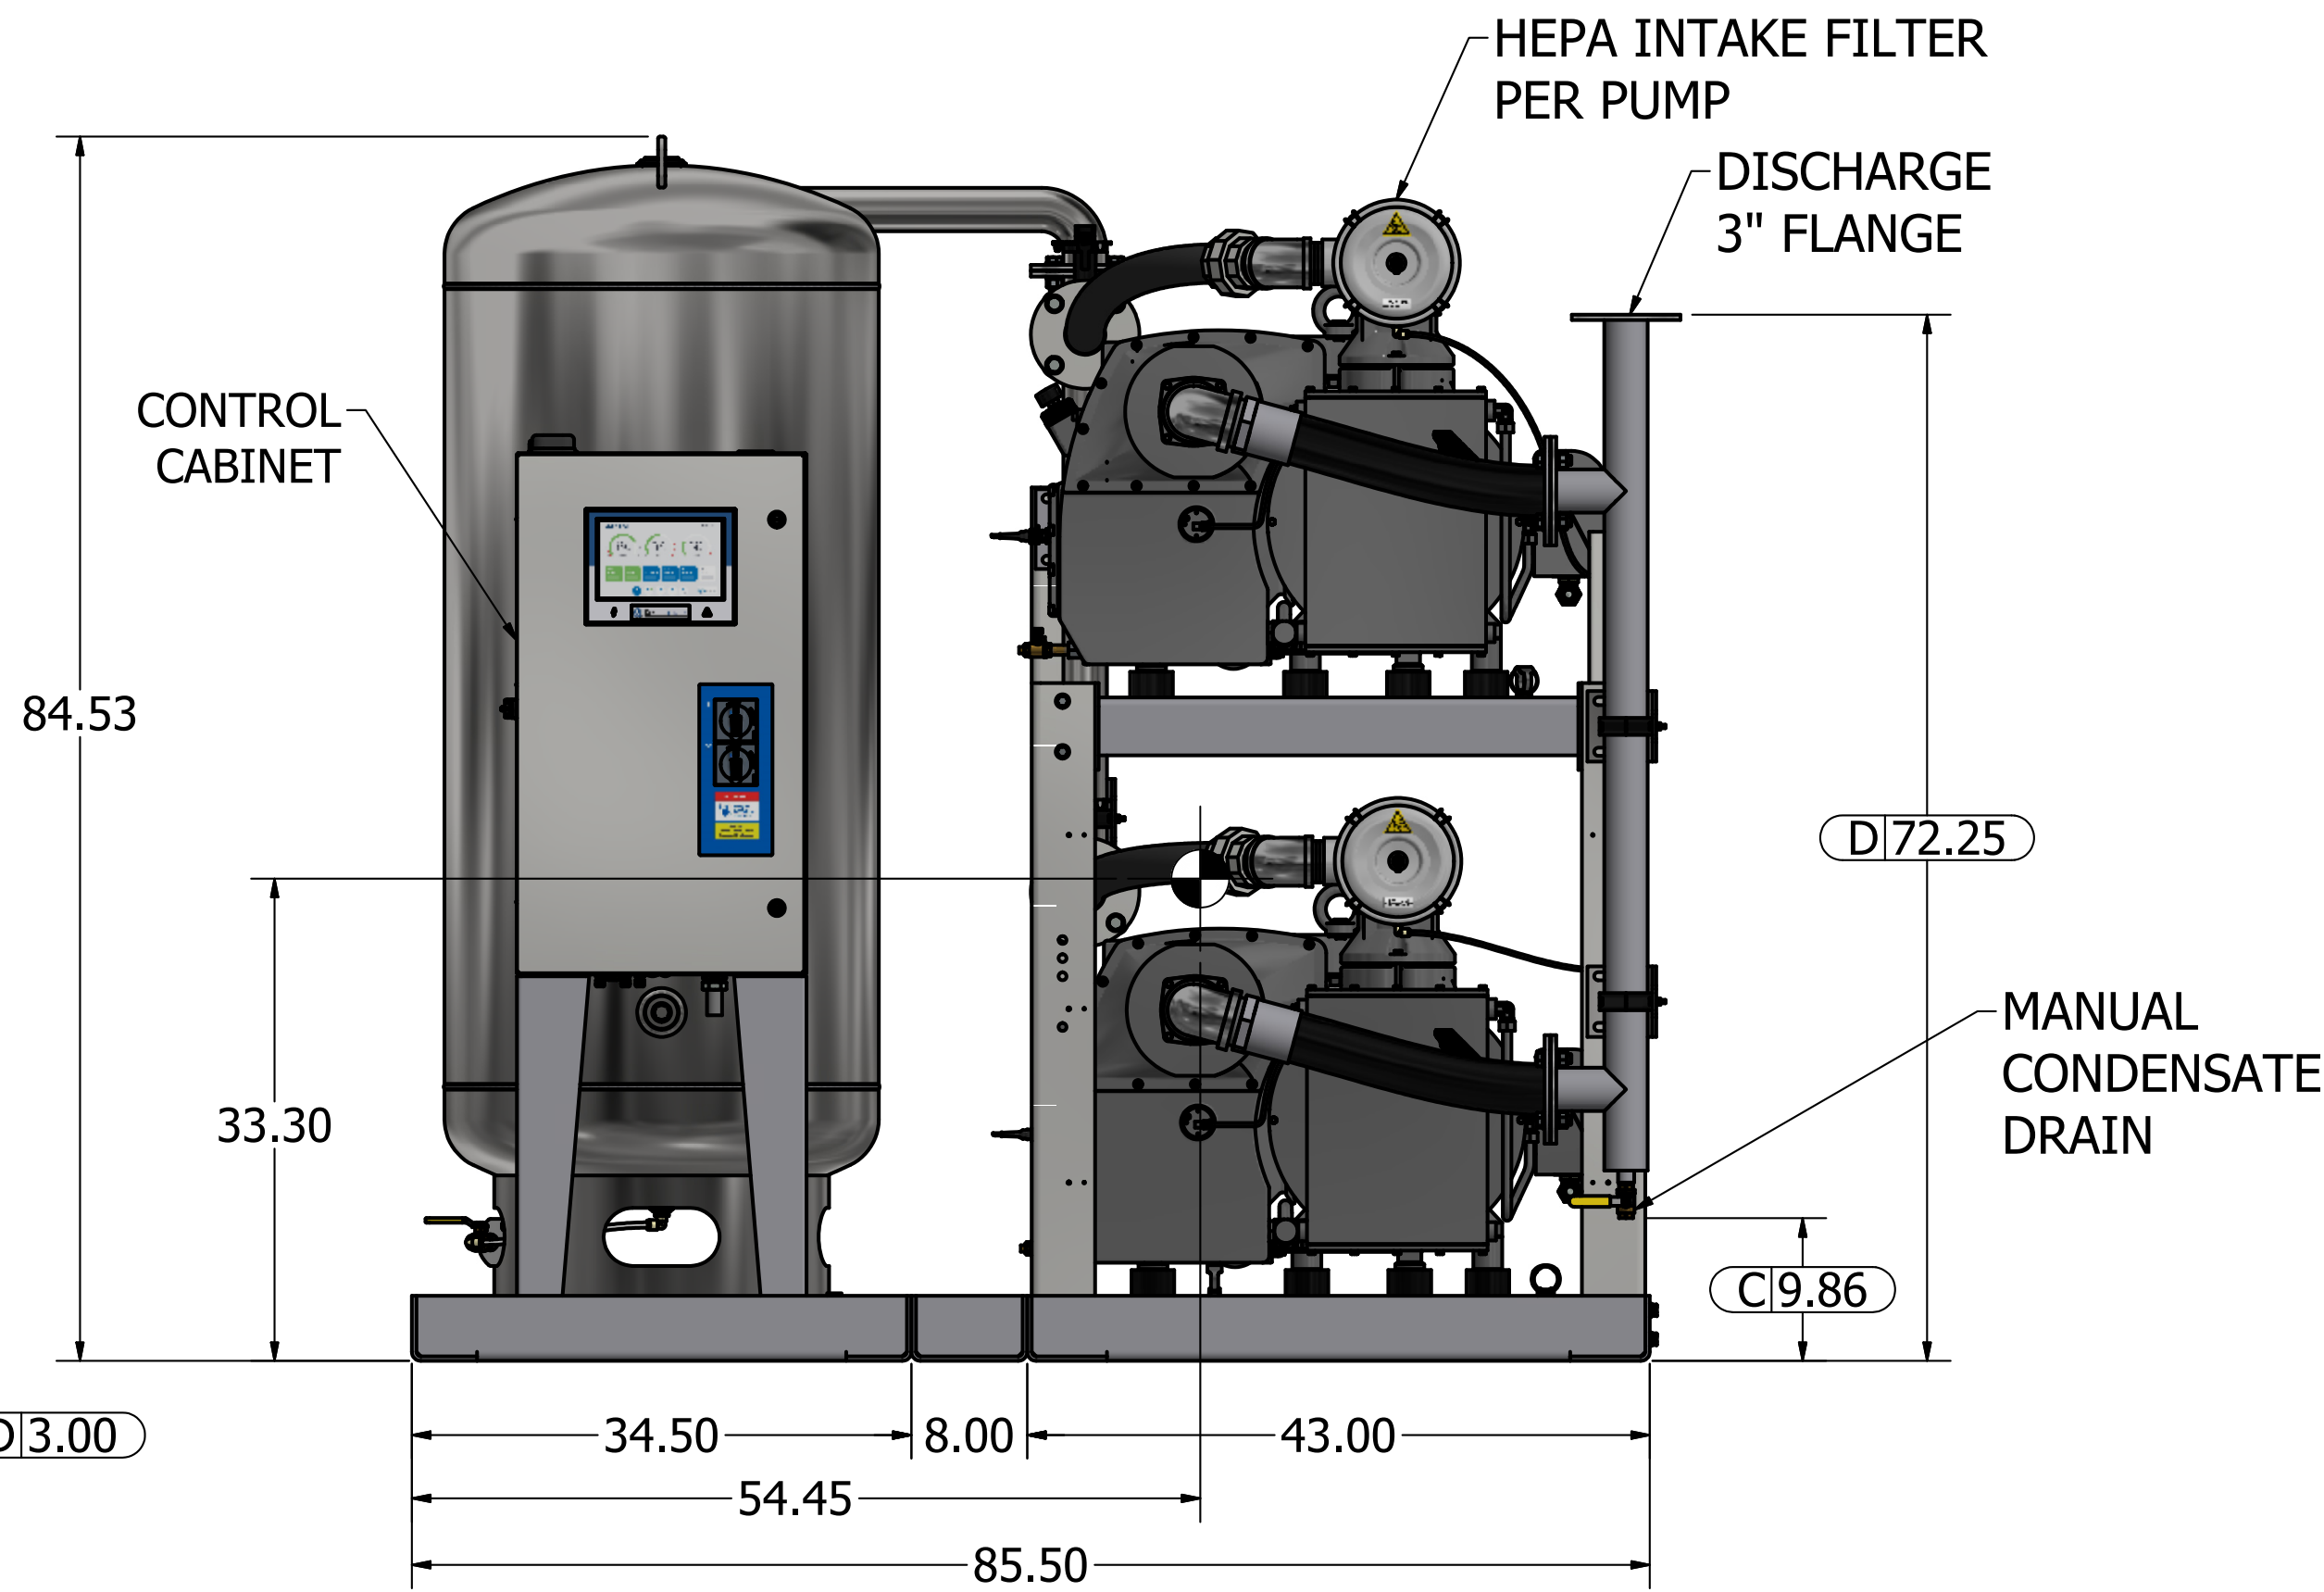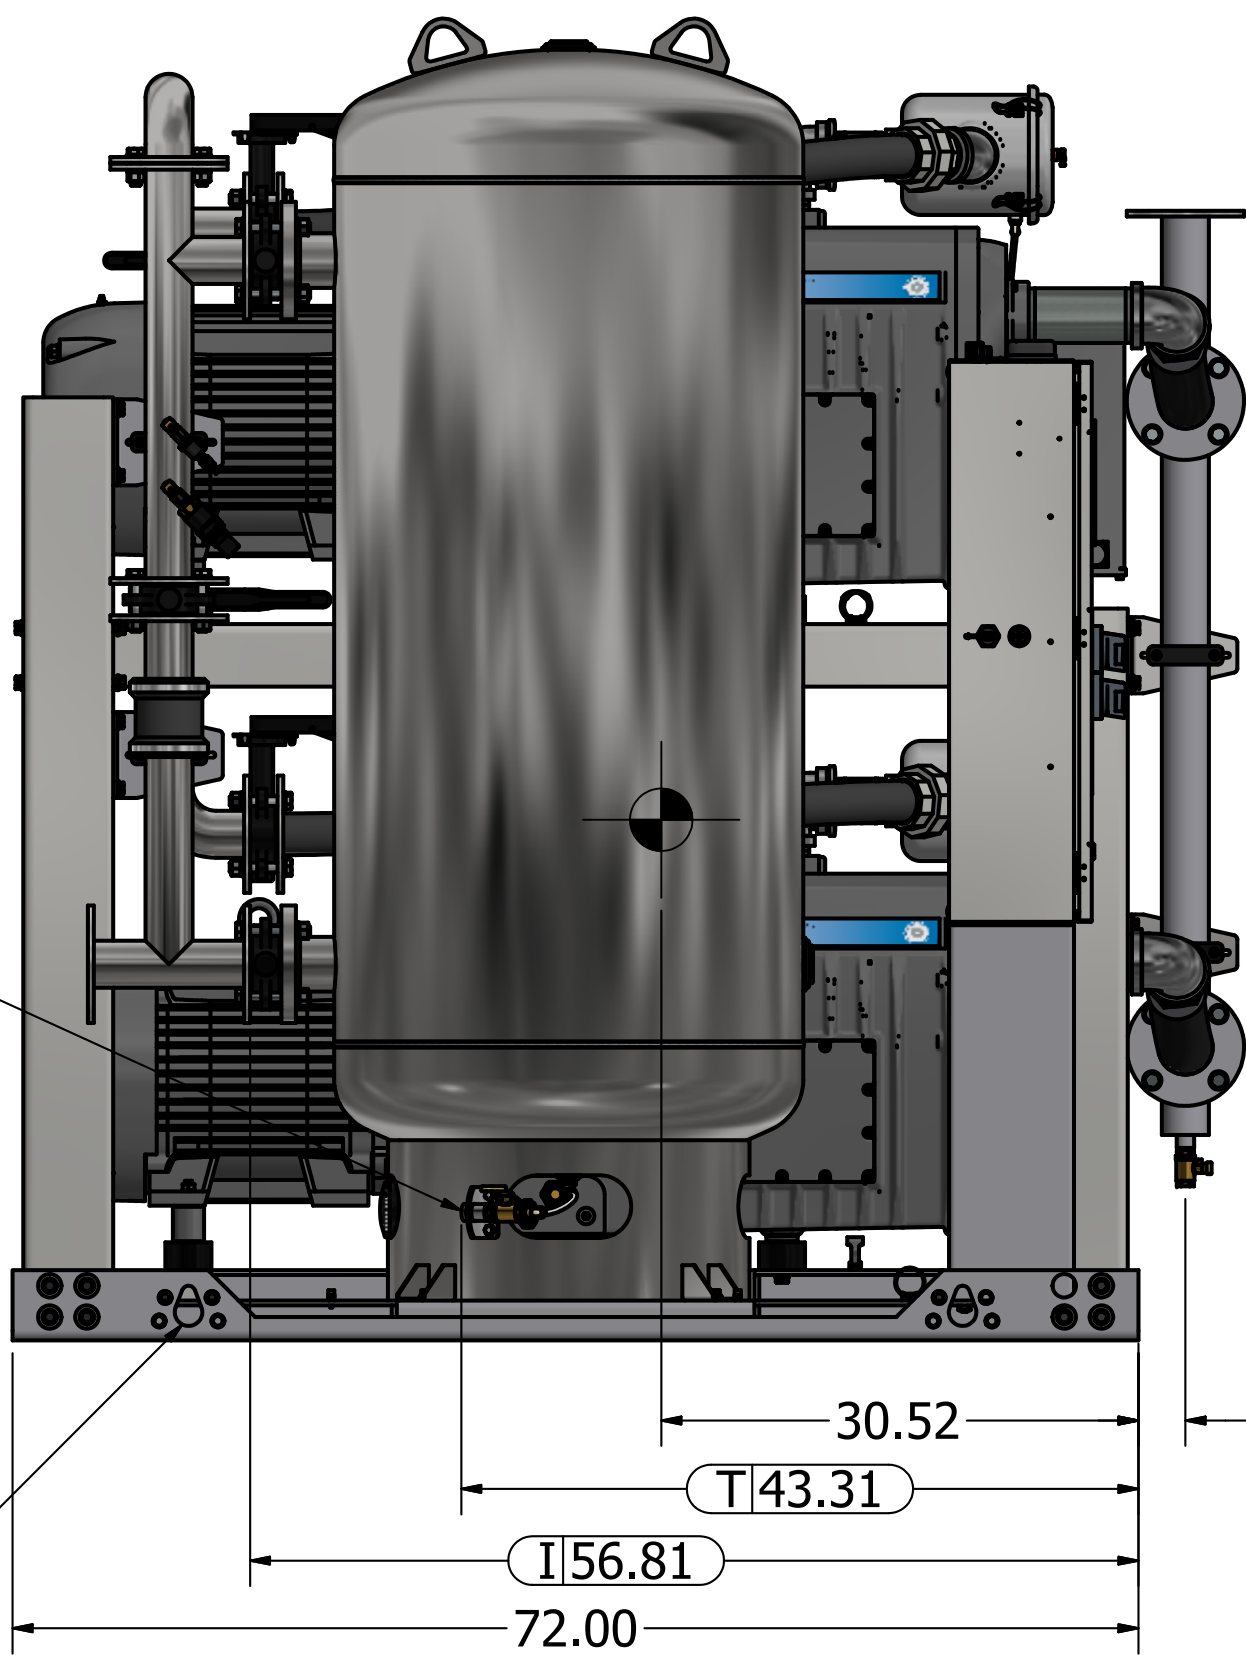

460V PANEL SHOWN

Revised: APS	Date: 3/27/2023	Drawn: MDB	Date: 9/10/2010
	This drawing and the information contained thereon remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering.		Scale: D
Description: GENERAL ASSEMBLY 25HP DX LUBE VAC SPC 200G RECEIVER		Part Number: 4107 8522 40	
DN: HOP230842		Rev: 03	DO NOT SCALE THIS DOCUMENT
Sheet 1 of 1			