


GENERAL NOTES:

- 1. ALL INTERCONNECTING PIPING, ACCESSORIES, AND PIPE FITTINGS SHALL BE SUPPLIED AND INSTALLED BY THE CONTRACTOR.
- 2. ALL PIPING SHALL BE HARD-DRAWN SEAMLESS TYPE "K" OR "L" COPPER TUBING CONFORMING TO ASTM DESIGNATION B-819.
- 3. ALL PIPING SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 99. PIPING LAYOUT IS DIAGRAMMATIC ONLY. FINAL ARRANGEMENT WILL BE SITE SPECIFIC. CONTRACTOR WILL BE RESPONSIBLE FOR FIELD VERIFICATION AND COORDINATING ACTUAL LOCATIONS WITH ALL OTHER TRADES.
- 4. CONTRACTOR SHALL VERIFY MOTOR VOLTAGE, PHASE AND AMP RATINGS BEFORE STARTING ELECTRICAL INSTALLATION AND MAKE CERTAIN THE VOLTAGE SUPPLIED BY THE HOSPITAL IS THE SAME.
- 5. THE ROOM REQUIRES DEDICATED MECHANICAL VENTILATION WITH AN ALLOWABLE TEMPERATURE VARIANCE OF 40° TO 105°F. (FOR HIGHER AMBIENTS, CONSULT FACTORY).
- 6. ELECTRICAL POWER SHOULD BE SUPPLIED FROM THE EQUIPMENT SYSTEM BRANCH OF THE ESSENTIAL ELECTRICAL SYSTEM (EMERGENCY POWER).
- 7. EQUIPMENT, INSTALLATION, AND TESTING OF THE MEDICAL AIR SYSTEM SHALL COMPLY WITH NFPA 99, AND ALL STATE AND LOCAL CODES OR ORDINANCES.
- 8. WHEN DETERMINING THE TOTAL PIPE LENGTH, ADD ALL THE STRAIGHT LENGTHS OF PIPE TOGETHER IN ADDITION TO THE NUMBER OF ELBOWS TIMES THE EFFECTIVE PIPE LENGTH FOR THAT PIPE SIZE. (SEE EQUIVALENT PIPE LENGTH TABLE & EXAMPLE CALCULATION IN O & M MANUAL)
- 9. ALLOW 36 INCHES IN FRONT OF CONTROL PANEL FOR MAINTENANCE AND VENTILATION, ALL OTHER SIDES REQUIRE 24 INCHES OF CLEARNACE.

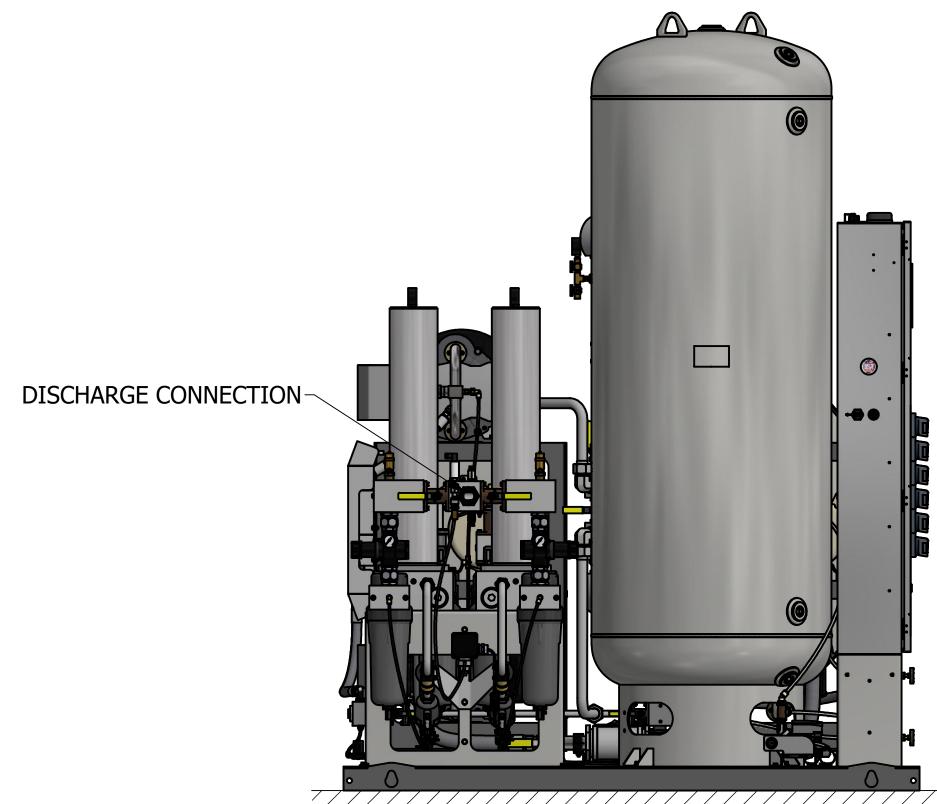

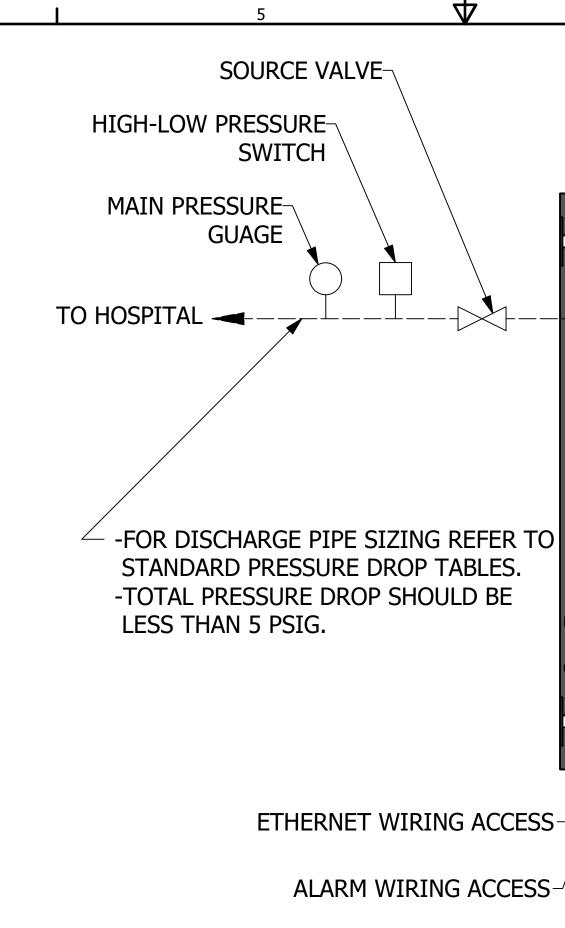

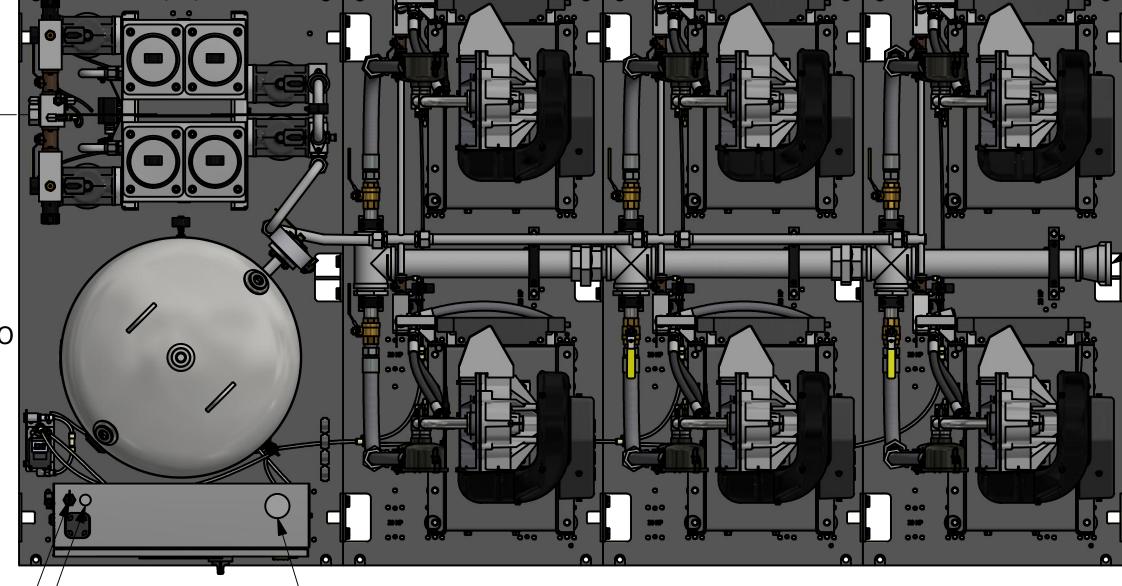

SINGLE POINT POWER

WIRING ACCESS

PIPE INTAKE TO OUTSIDE,-TURN DOWN AND SCREEN PER NFPA 99. (REF. TO TABLE FOR CORRECT PIPE SIZING)

SINGLE POINT DRAIN-CONNECTION, CONTRACTOR SHALL PIPE TO FLOOR DRAIN

NO VIBRATION PADS ARE ~ **NECESSARY AT THIS LOCATION**

-HEAVY-DUTY 4-POINT ISOLATION (SEISMIC OPTIONAL)

-INLET CONNECTION

INTAKE PIPE SIZE TABLE (SEE NOTE 8) PIPE LENGTH UNIT SIZE 301'-700' 0-100' 101'-300' 4.0" NPT HPX 15 5.0" NPT 6.0" NPT

| EFFECTIVE PIPE LENGTH FOR ELBOWS | | | |
|----------------------------------|-----------|-----------|-----------|
| PIPE SIZE (IN) | 4.00" NPT | 5.00" NPT | 6.00" NPT |
| EFF. PIPE LENGTH (FT) | 10 | 11.9 | 13.2 |

NOTE: ALL ACCESSORIES, PIPE, AND FITTINGS BEYOND INLET AND DISCHARGE PORTS ARE SUPPLIED AND INSTALLED BY OTHERS.

NO FOUNDATION OR INERTIA PAD IS REQUIRED (HOUSEKEEPING PAD IS OPTIONAL)

(15HP WITH 240 GALLON RECEIVER SHOWN

This drawing and the information contained thereon remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering. 4107 8511 93 INSTALLATION DIAGRAM 15HP HX HOP230837 SCROLL SPC Sheet 1 of 1 DO NOT SCALE T DOCUMENT

Form F-007 Rev. 01 8