## GENERAL

D

1. EQUIPMENT, INSTALLATION, AND TESTING OF THE INSTRUMENT AIR SYSTEM SHALL COMPLY WITH NFPA 99, 2018 EDITION AND ALL STATE AND LOCAL CODES OR ORDINANCES.

2. EQUIPMENT, ELECTRICAL AND PIPING LAYOUT IS DIAGRAMMATIC ONLY: FINAL ARRANGEMENT WILL BE SITE SPECIFIC. CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD VERIFICATION AND COORDINATING ACTUAL LOCATION WITH OTHER TRADES.

3. THE ROOM REQUIRES DEDICATED MECHANICAL VENTILATION WITH AN ALLOWABLE TEMPERATURE RANGE OF 40°F - 105°F [4°C - 41°C] (FOR HIGHER AMBIENTS, CONSULT FACTORY).

4. REFERENCE OPERATION AND MAINTENANCE MANUAL FOR PROPER LOCATION OF MODULES TO ENSURE ADEQUATE AIR FLOW ACROSS THE UNITS.

5. VENTILATION: THE INLET GRID(S) AND VENTILATION FAN SHOULD BE INSTALLED IN SUCH A WAY THAT ANY RECIRCULATION OF COOLING AIR TO THE COMPRESSOR IS AVOIDED. THE AIR VELOCITY TO THE GRID(S) HAS TO BE LIMITED TO 16FT/S [5M/S].

6. SERVICE AND MAINTENANCE: RECOMMENDED MINIMUM CLEARANCE IN FRONT OF DRYER MODULE CONTROL PANEL AND COMPRESOR MODULE CONTROL PANEL IS 36" [914MM]. RECOMMENDED MIMIMUM CLEARANCE ELSEWHERE IS 24" [610MM].

7. ALL EQUIPMENT SHOULD BE INSTALLED ON A LEVEL FLOOR CAPABLE OF TAKING THE WEIGHT OF THE EQUIPMENT.

<u>PIPING</u>

8. ALL PIPING SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 99, 2018 EDITION.

9. ALL INTERCONNECTING PIPING AND FITTINGS SHALL BE SUPPLIED AND INSTALLED BY OTHERS.

10. FOR DISCHARGE PIPE SIZING REFER TO STANDARD PRESSURE DROP TABLES (TOTAL PRESSURE DROP SHOULD BE LESS THAN 2PSIG [0.1BARG]).

11. ALL INTERCONNECTING PIPING SHALL BE SUPPLIED AND INSTALLED BY OTHERS. PIPING SHALL BE HARD-DRAWN SEAMLESS TYPE "K" OR "L" COPPER TUBING CONFORMING TO ASTM DESIGNATION B-819 AND INSTALLED IN ACCORDANCE WITH NFPA 99, 2018 EDITION.

12. THE RECEIVER DRAIN VALVE IS SUPPLIED WITH A 3/8" HOSE BARB. EACH COMPRESSOR MODULE IS SUPPLIED WITH (2) 5/16" BRASS COMPRESSION FITTING DRAIN CONNECTIONS. ALL DRAIN LINES SHALL BE SUPPLIED AND INSTALLED BY OTHERS AND RUN TO AN OIL WATER SEPARATOR, THEN TO AN APPROPRIATE WASTE DRAIN.

ELECTRICAL

 $\rightarrow$ 

13. ELECTRICAL POWER SHALL BE SUPPLIED FROM THE EQUIPMENT SYSTEM BRANCH OF THE ESSENTIAL ELECTRICAL DISTRIBUTION (EMERGENCY POWER). POWER NEEDED AT EACH MODULE.


14. INTERCONNECTING COMMUNICATION "CAN" CABLES ARE SUPPLIED BY BEACONMEDAES. COMPRESSORS ARE CONNECTED TO THE MAIN CONTROL PANEL IN SERIES USING THESE CABLES. THE STANDARD CABLE LENGTH IS [10M] (FOR LONGER CABLE LENGTHS, CONSULT FACTORY).


15. ALL CONDUIT, FITTINGS AND CONDUCTORS SHALL BE SUPPLIED BY OTHERS.

16. REFER TO LIFELINE WIRING DIAGRAM SHIPPED WITH CONTROL MODULE UNIT FOR CONNECTIONS IN THE PANEL.

17. POWER CORD FOR THE AUTOMATIC DRAIN WILL BE SUPPLIED BY BEACONMEDAES. STANDARD CABLE LENGTH IS 33FT [10M] (FOR LONGER CABLE LENGTHS, CONSULT FACTORY).


18. NO FOUNDATION OR INERTIA PAD IS REQUIRED. NO VIBRATION PADS ARE REQUIRED. HOUSEKEEPING PAD IS OPTIONAL.

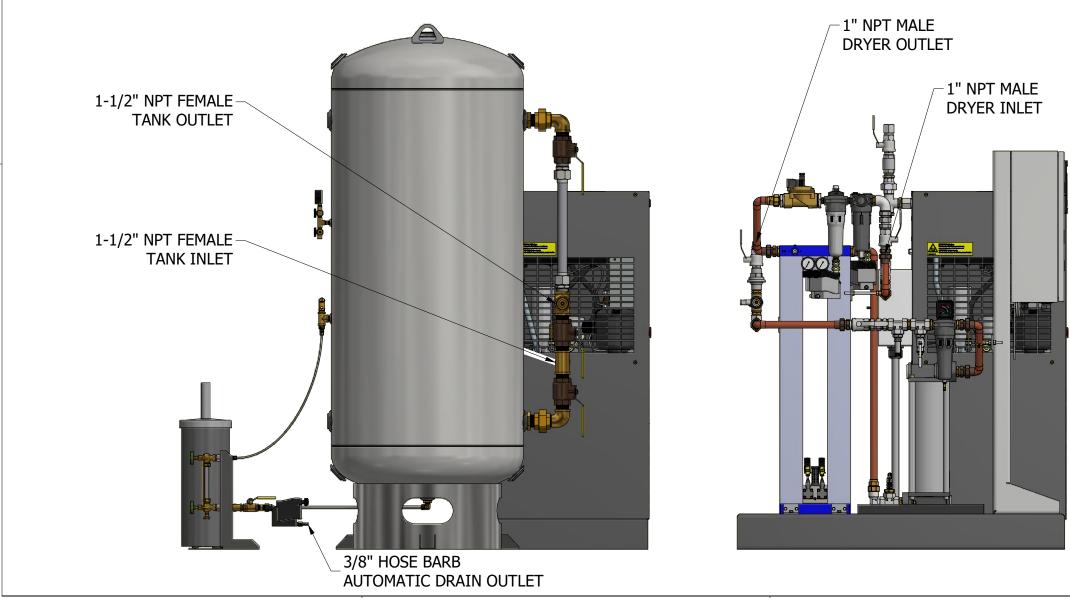


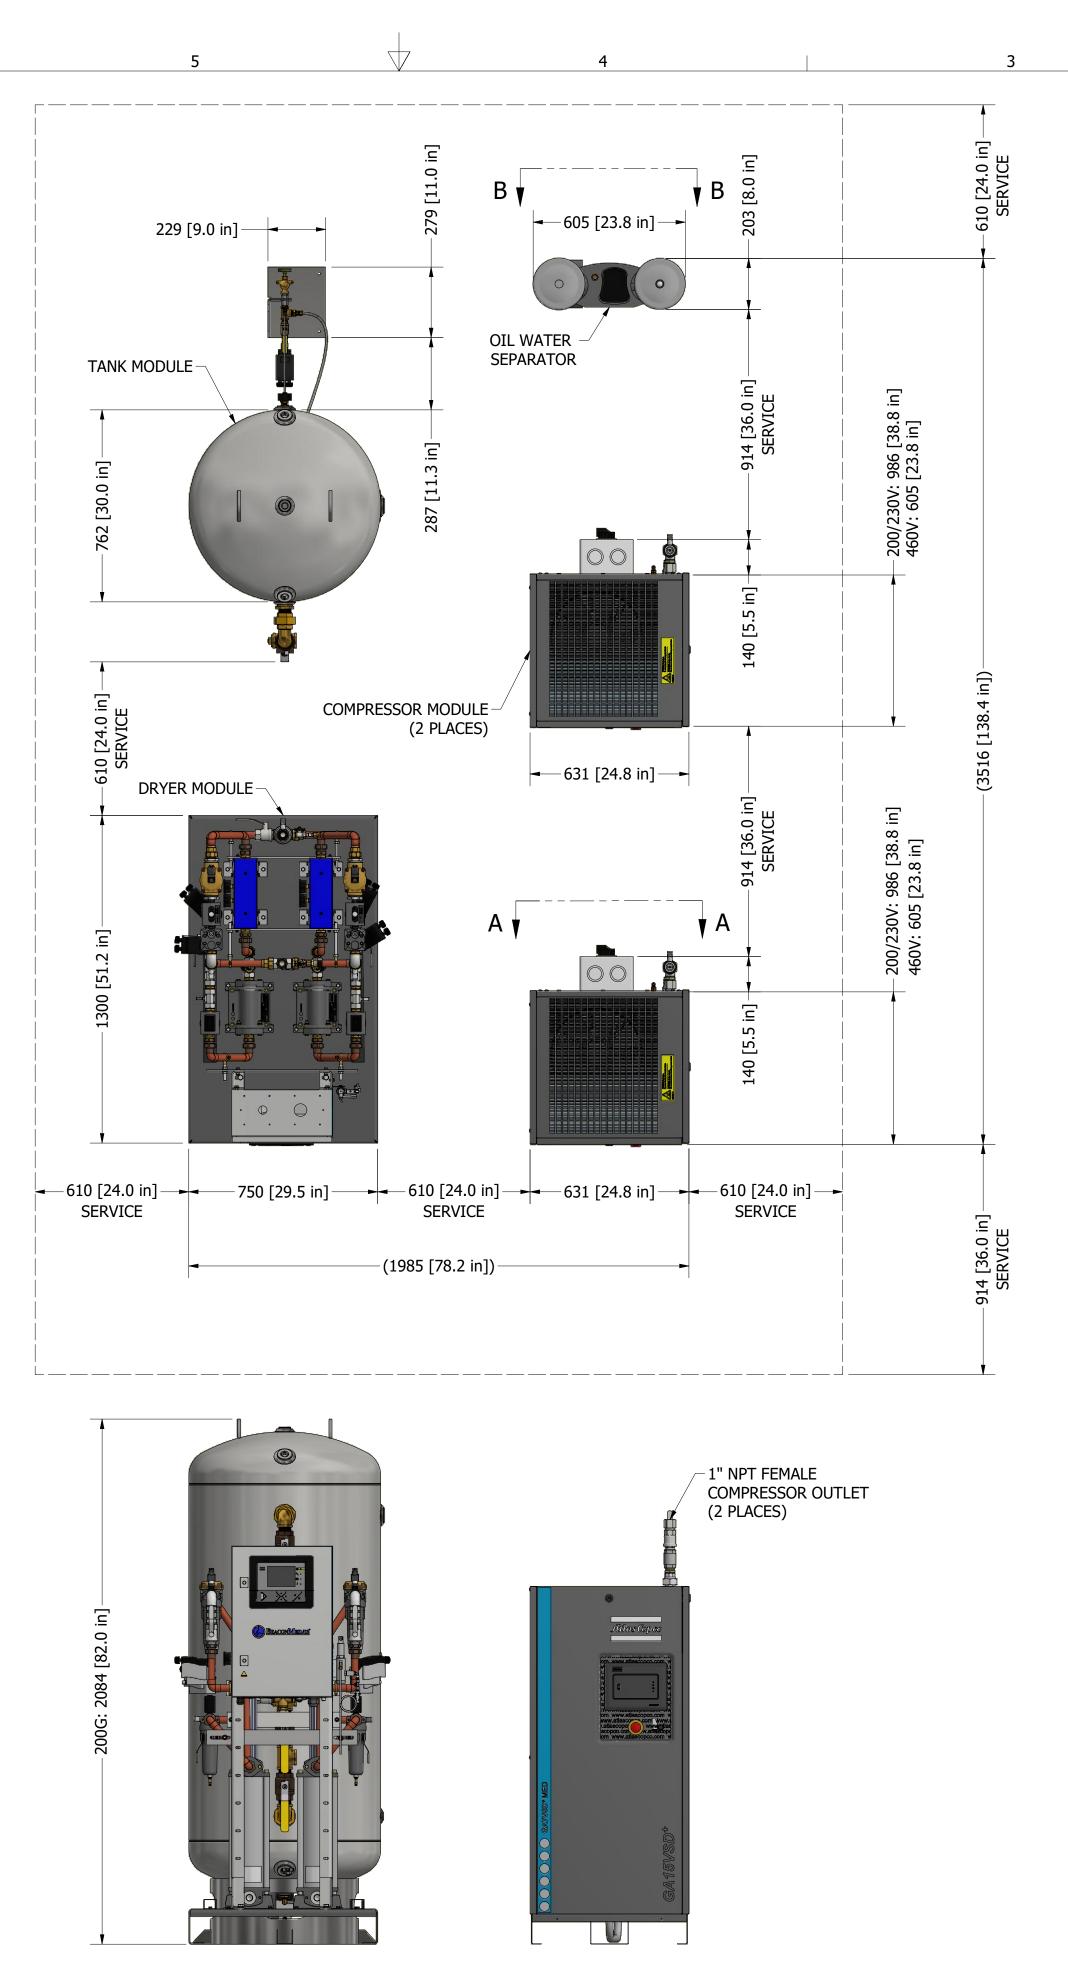


4

3

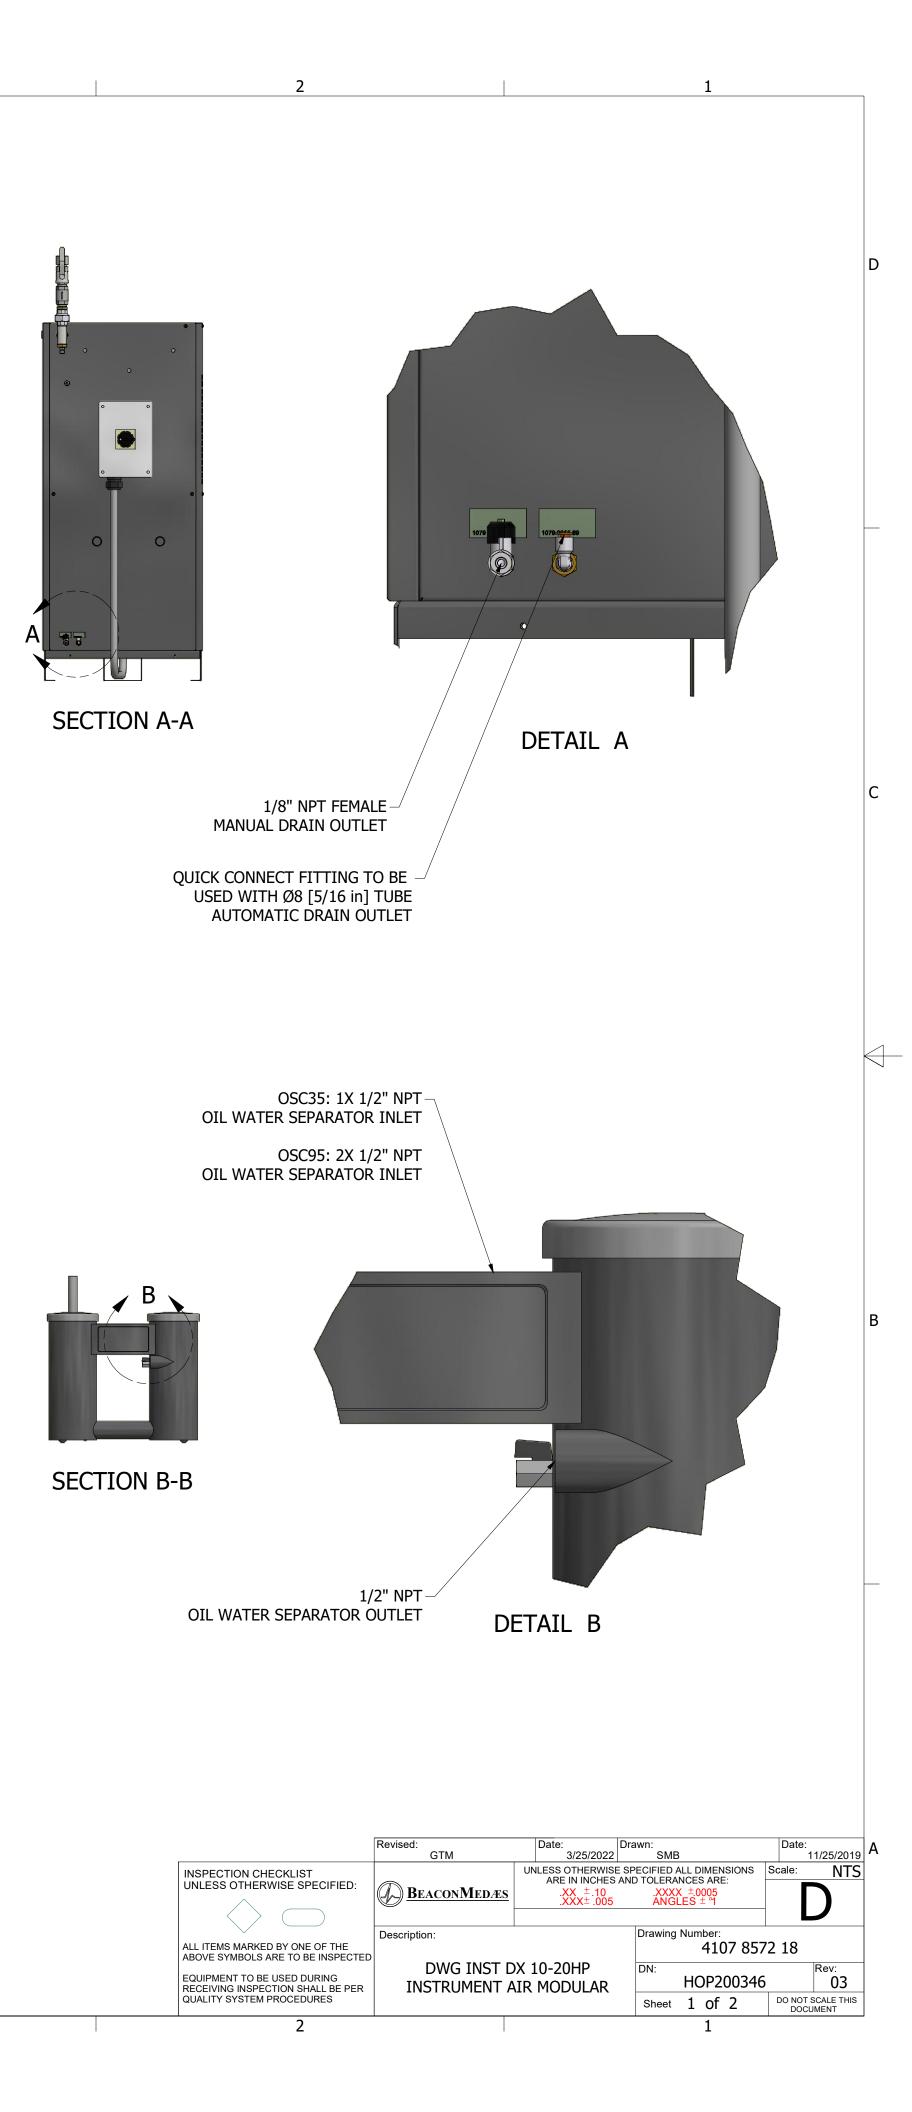

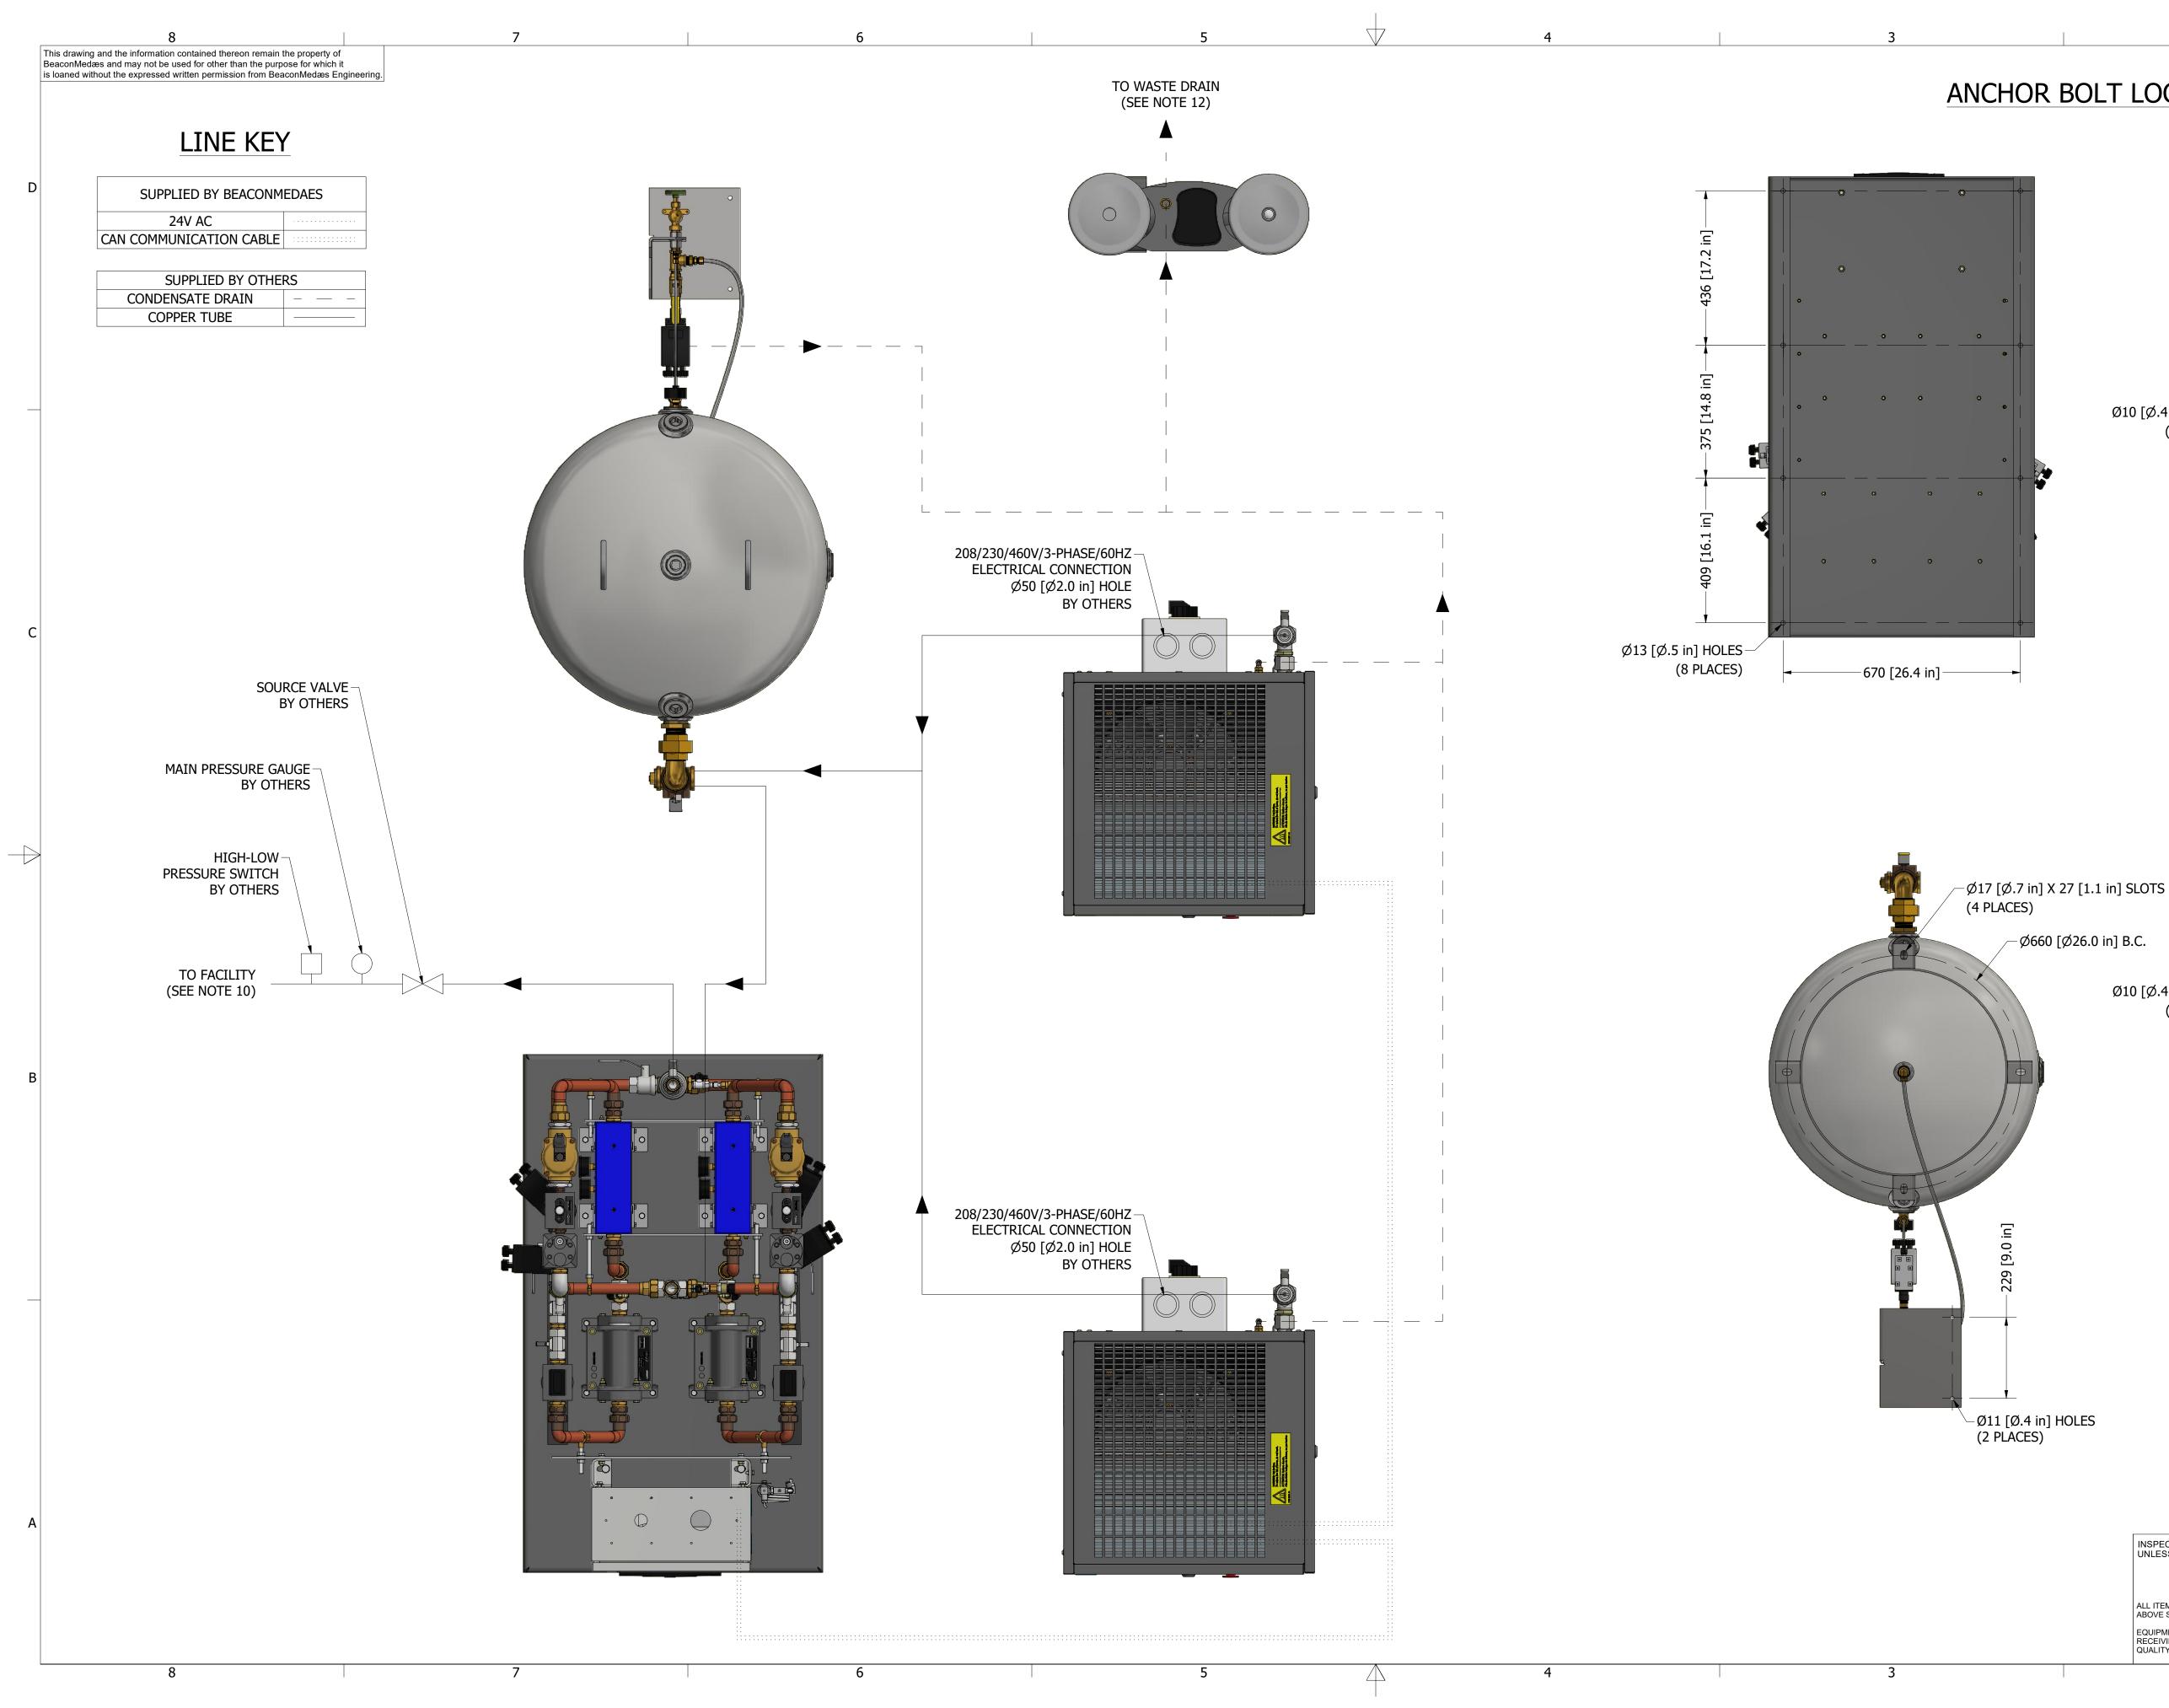

Ø660 [Ø26.0 ii	n] B.C.					В
[UI 0.6] 60.6 [Ø.4 in] HOLES LACES)		DOES TO TH	NOT BOLT IE FLOOR			
		Revised: GTM	3/25/2022	awn: SMB	Date: 11/25/201	
	INSPECTION CHECKLIST UNLESS OTHERWISE SPECIFIED:	<b>BEACONMEDÆS</b>	UNLESS OTHERWISE S ARE IN INCHES AN XX ±.10 XXX±.005	PECIFIED ALL DIMENSIONS D TOLERANCES ARE: .XXXX ±0005 ANGLES ± M	Scale: NT	<u>S</u>
	ALL ITEMS MARKED BY ONE OF THE	Description:		Drawing Number: 4107 8572 18		
	ABOVE SYMBOLS ARE TO BE INSPECTED	DWG INST D	X 10-20HP	DN:	Rev:	_
	EQUIPMENT TO BE USED DURING RECEIVING INSPECTION SHALL BE PER QUALITY SYSTEM PROCEDURES	INSTRUMENT A	AIR MODULAR	HOP200346 Sheet 2 of 2	DO NOT SCALE THI DOCUMENT	s
	2			1	DOCUMENT	
	-			-		

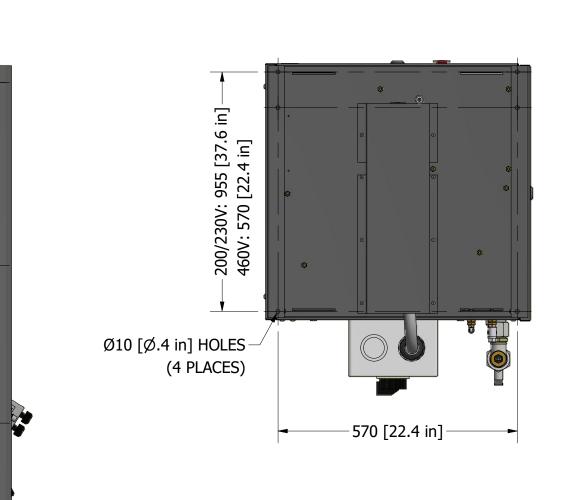

CAN CONNECTION

Ē

955 [37.6 [22.4 in]

200/230V: 460V: 570 |

0

 $\left| \right|$ 

## ANCHOR BOLT LOCATIONS