




Notes:

- 1. DISCHARGE MUFFLER WILL BE SHIPPED LOOSE.
- 2. DX MODULE WEIGHT: 1,385 LBS
240G TANK WEIGHT: 693 LBS
- 3.  INDICATES LIFTING POINT.
- 4.  DENOTES CENTER OF GRAVITY.

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN

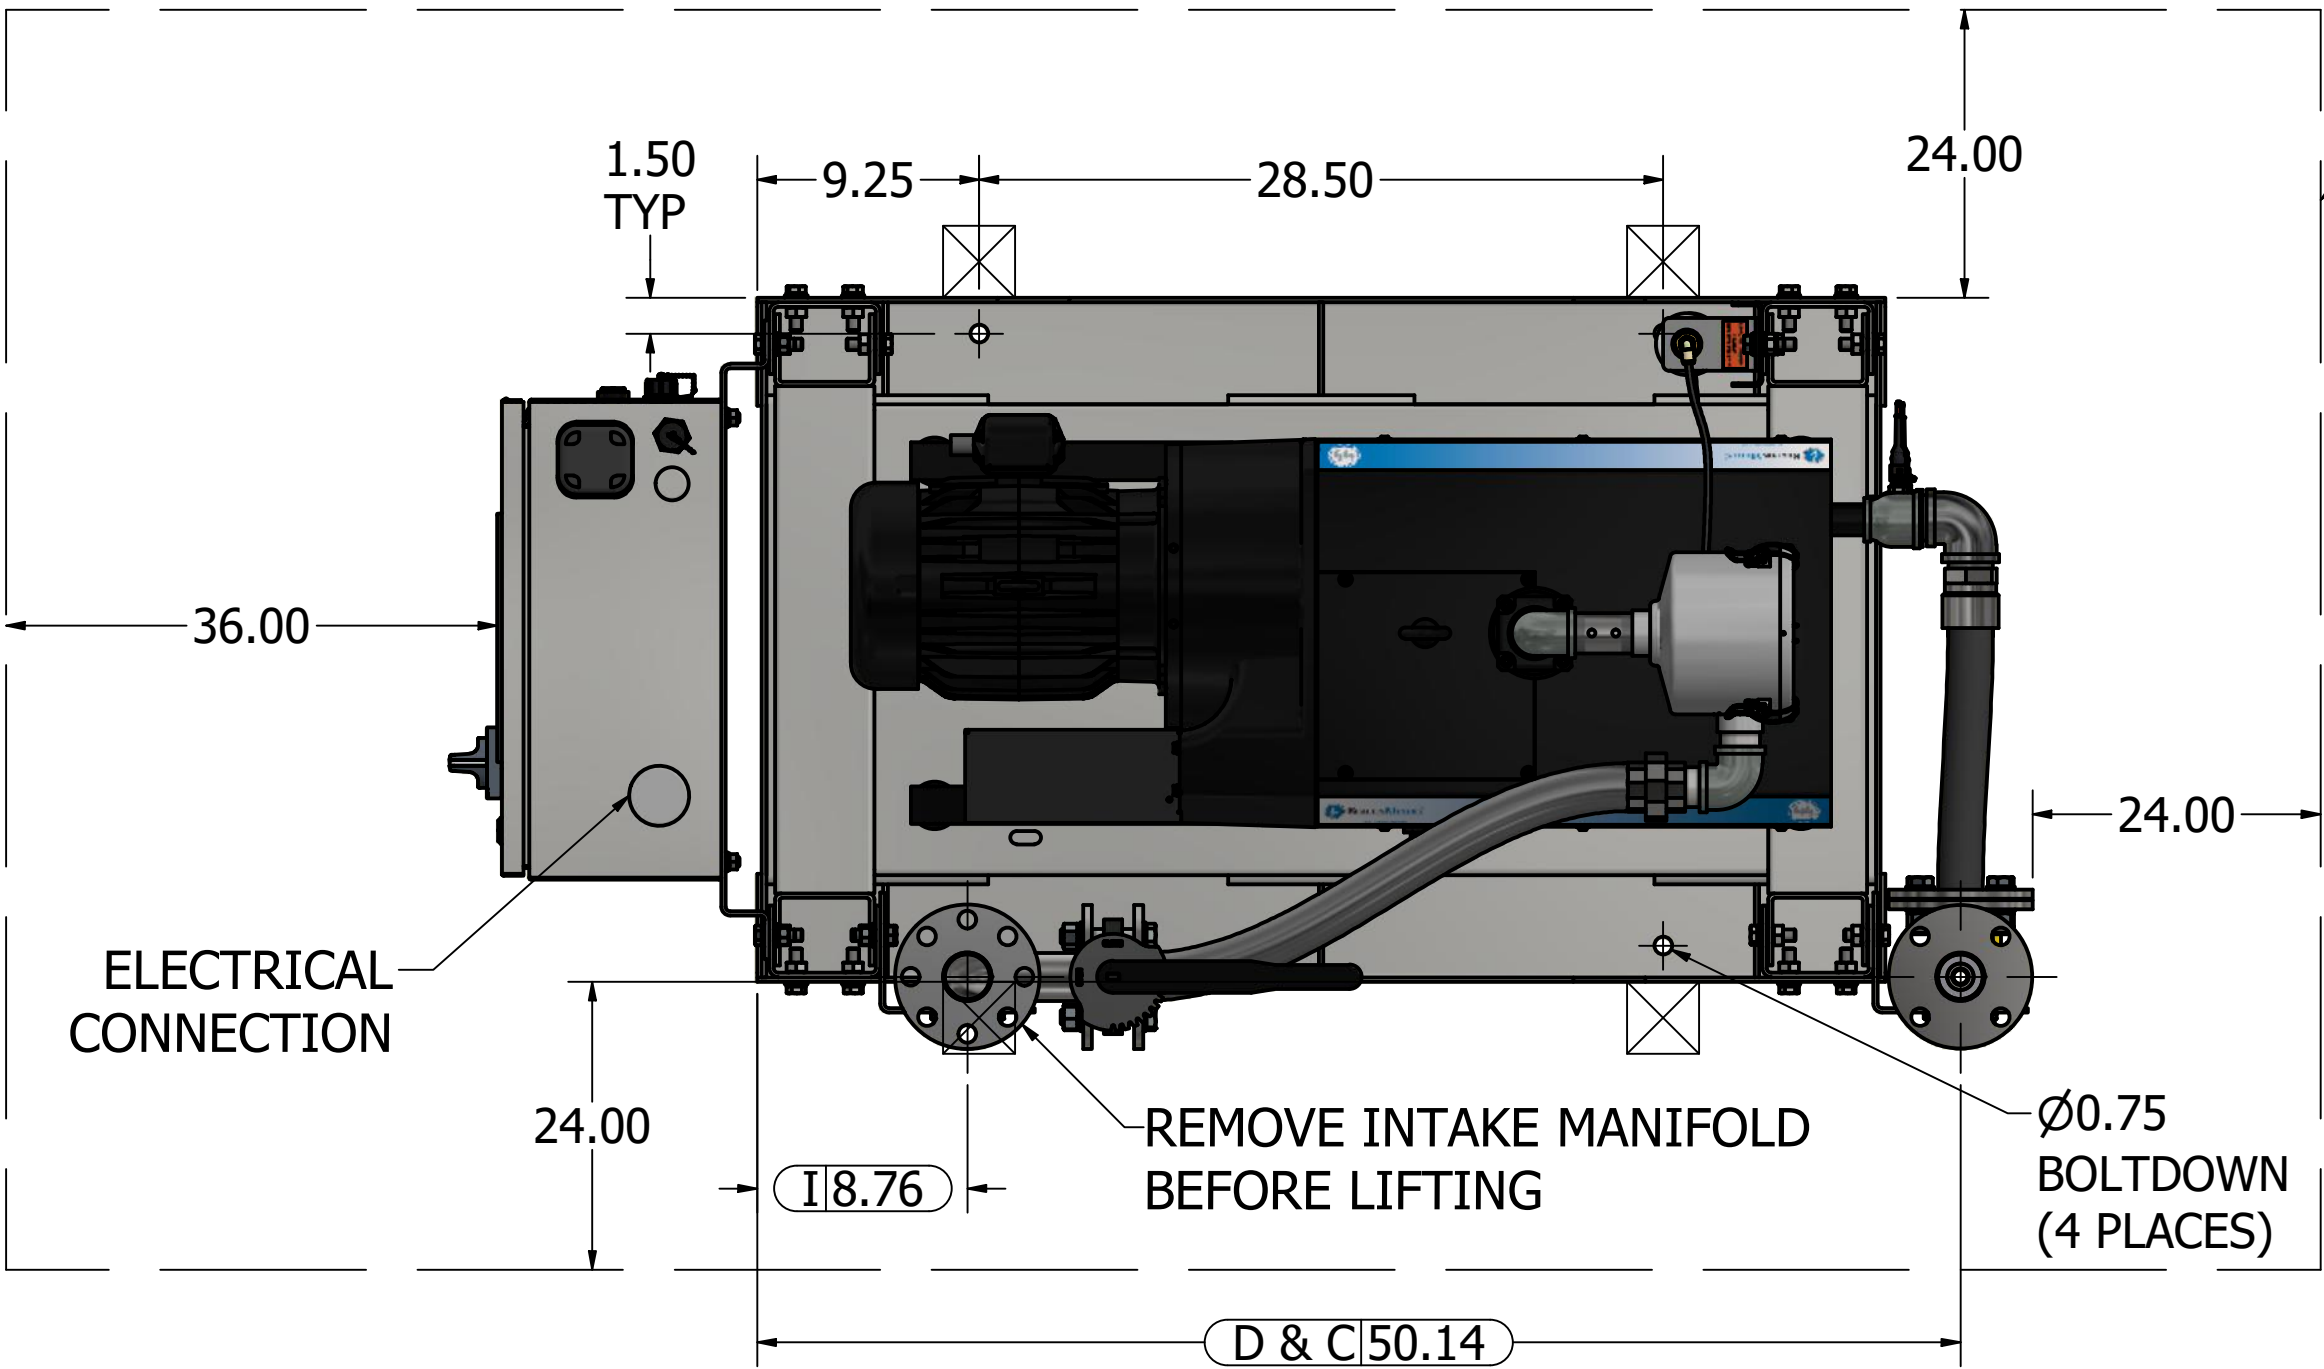

MINIMUM CLEARANCE FOR
MAINTENANCE & VENTILATION

OUTLET
2" FLANGE

RECEIVER BYPASS
VALVE

HOSPITAL CONN
2" FLANGE

MANUAL DRAIN CONN
1/2" NPT (FEMALE)

0.69 X 1.06 SLOT
Ø20.00 B.C.
EQUALLY SPACED
(4 PLACES)

240 GAL VACUUM RECEIVER
2" FLANGED CONNECTIONS
(SCALE 1:10)

CONTROL PANEL

INLET
2" FLANGE


HEPA INTAKE FILTER
PER PUMP

DISCHARGE
2" FLANGE

INTEGRATED
LIFTING EYES

BIOHAZARD DRAIN
FLASK PER PUMP

MANUAL
CONDENSATE
DRAIN

Revised: a00545201	Date: 3/15/2023	Drawn: JDY	Date: 1/11/2010
		This drawing and the information contained therein remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering.	
Description: GENERAL ASSEMBLY 5.4HP DX CLAW VAC MOD 240G RECEIVER STANDARD AND O2 ASSURED		Part Number: 4107 8513 06	
DN: HOP230841		Rev: 03	
Sheet 1 of 1		DO NOT SCALE THIS DOCUMENT	