

- NOTES:
- 1. DISCHARGE MUFFLERS WILL BE SHIPPED LOOSE.
  - 2. DX MODULE WEIGHT: 2,301 LBS.  
SX MODULE WEIGHT: 1,222 LBS  
240G TANK WEIGHT: 733 LBS  
CONTROL PANEL WEIGHT: 257 LBS.
  - 3. ☒ INDICATES LIFTING POINT.
  - 4. ● DENOTES CENTER OF GRAVITY.

MINIMUM CLEARANCE FOR  
MAINTENANCE & VENTILATION

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN LOCATION


REMOVE INTAKE MANIFOLD  
BEFORE LIFTING  
(3 PLACES)

REMOVE JUNCTION BOX  
BEFORE LIFTING  
(3 PLACES)


DISCHARGE  
3" FLANGE  
(3 PLACES)

D & C 63.87


Ø0.75  
BOLTDOWN  
(12 PLACES)

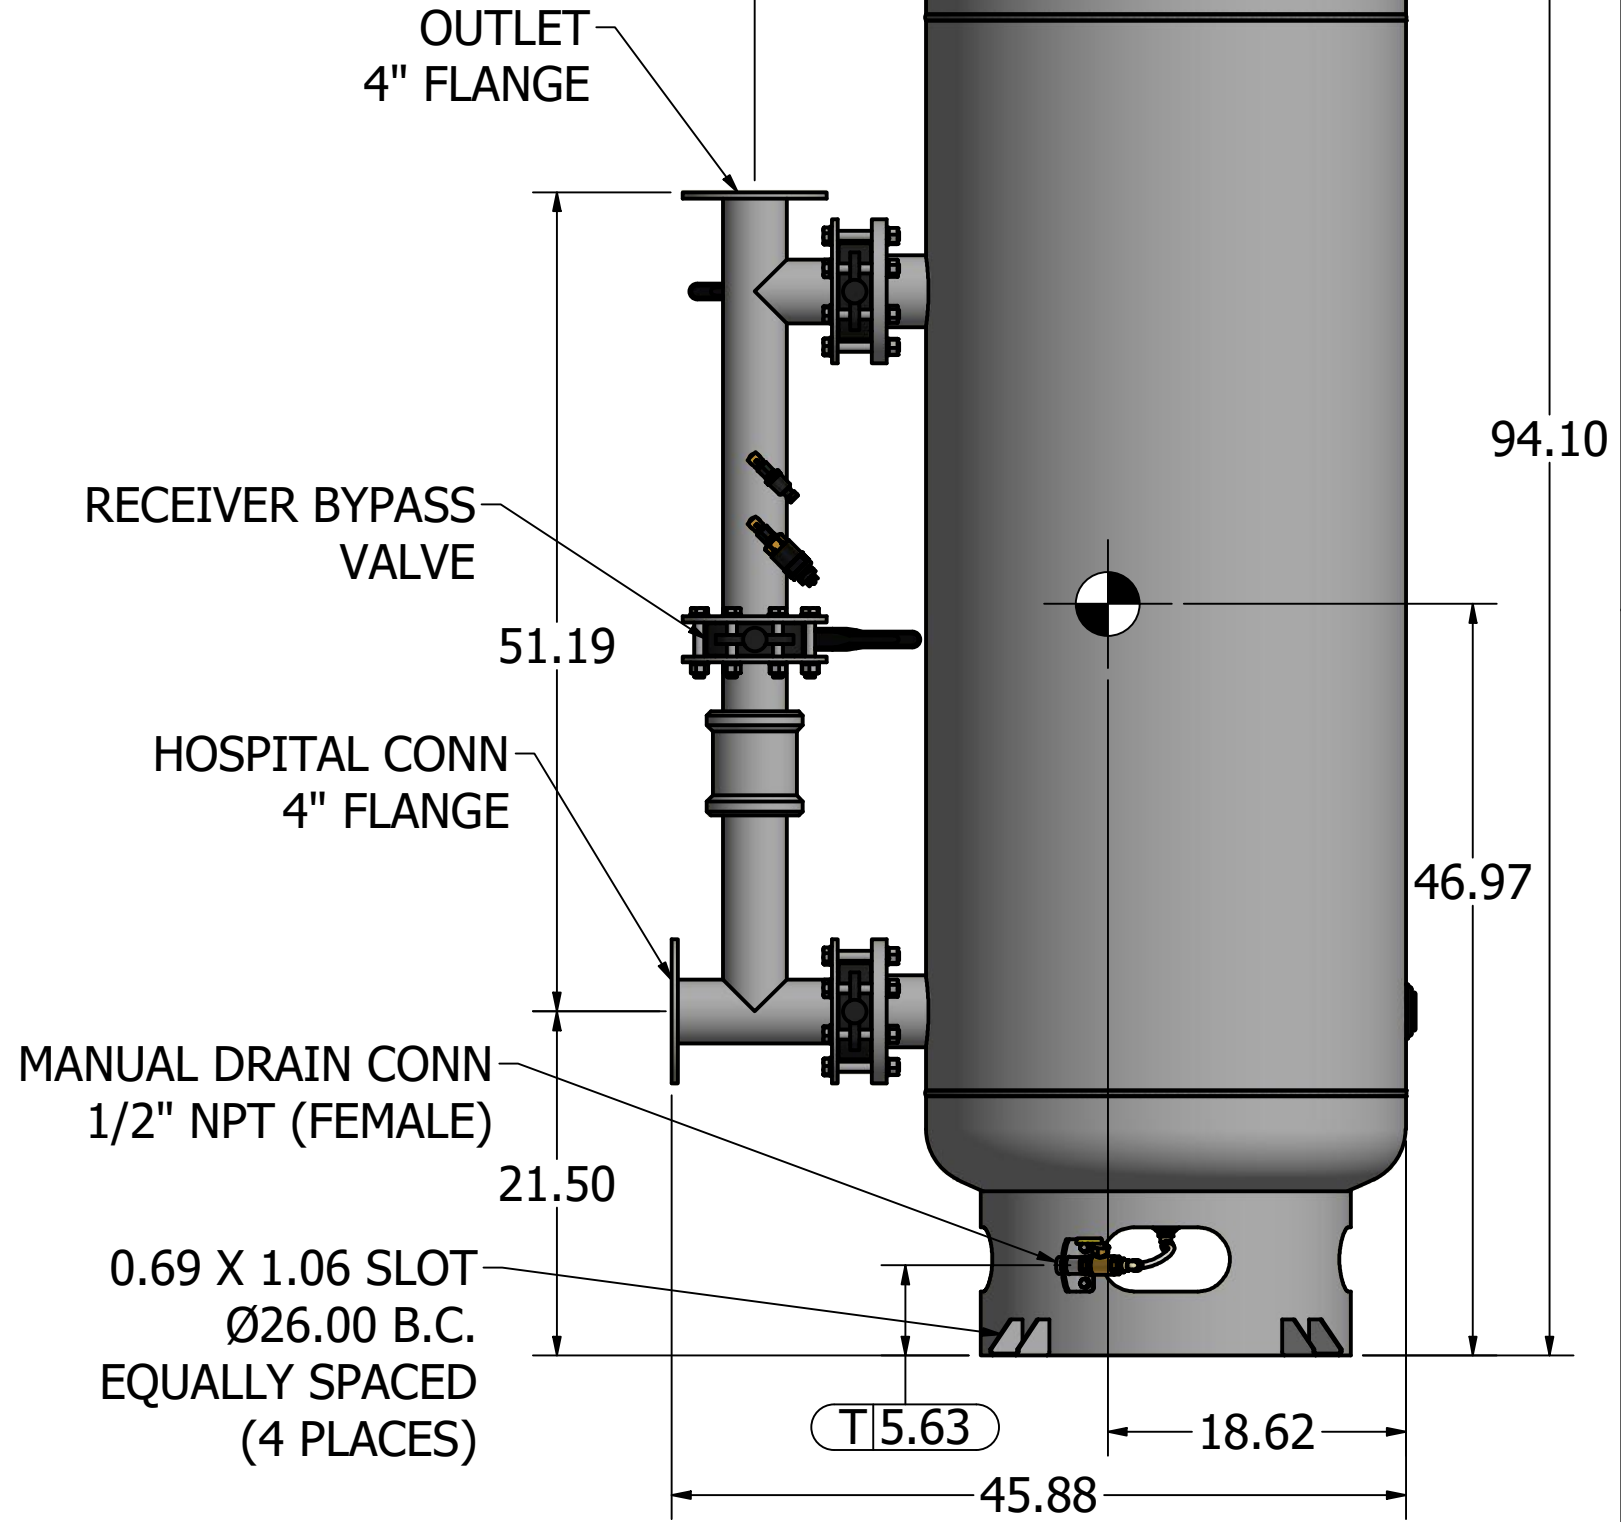


240 GAL VACUUM RECEIVER  
4" FLANGED CONNECTIONS  
(SCALE 1:12)

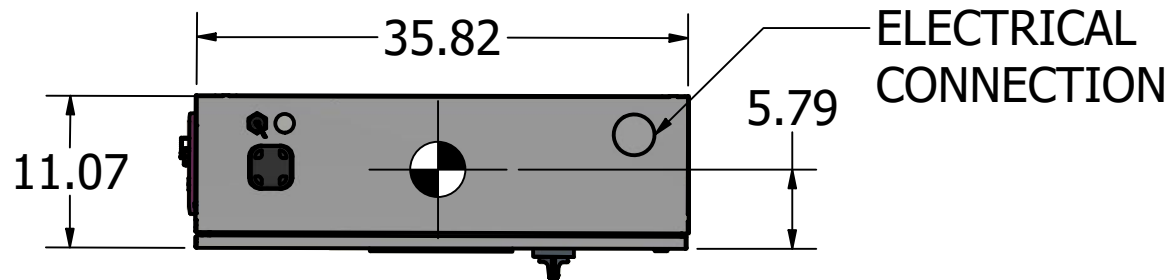

ALLOW 36" IN FRONT  
OF CONTROL CABINET  
FOR MAINTENANCE

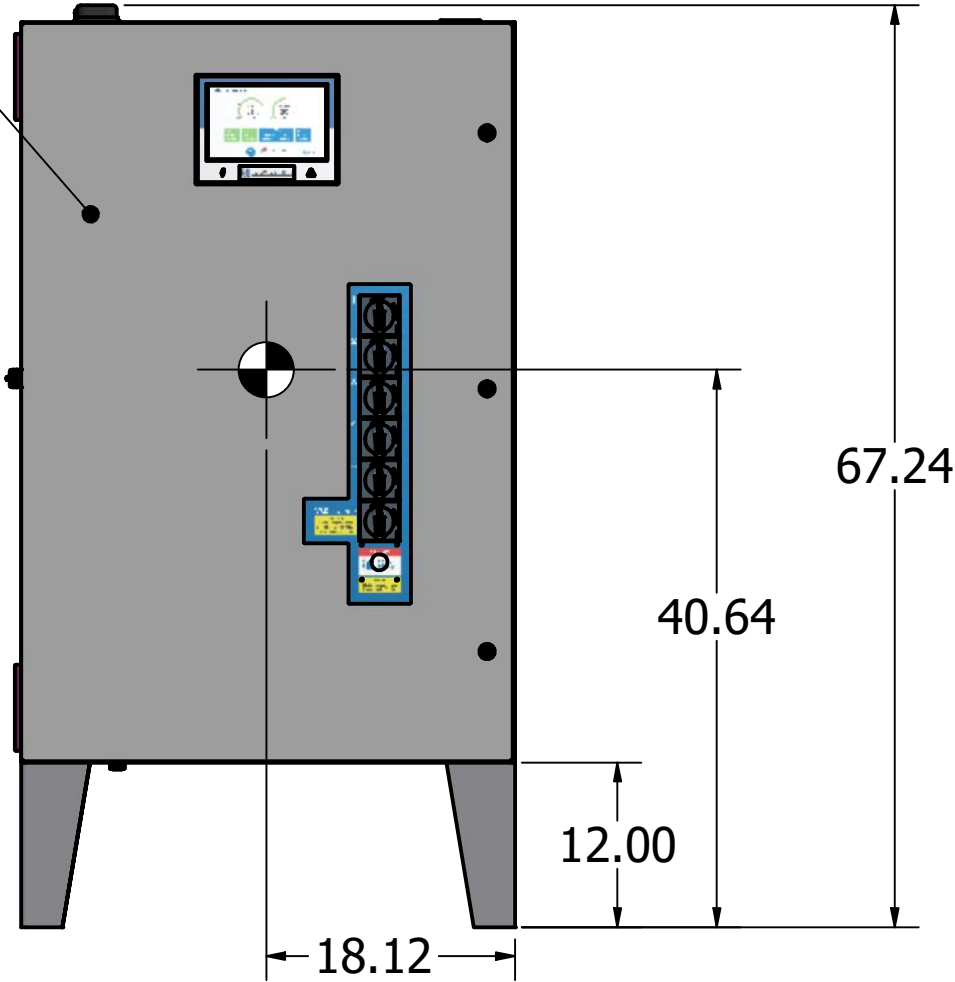

CONTROL CABINET

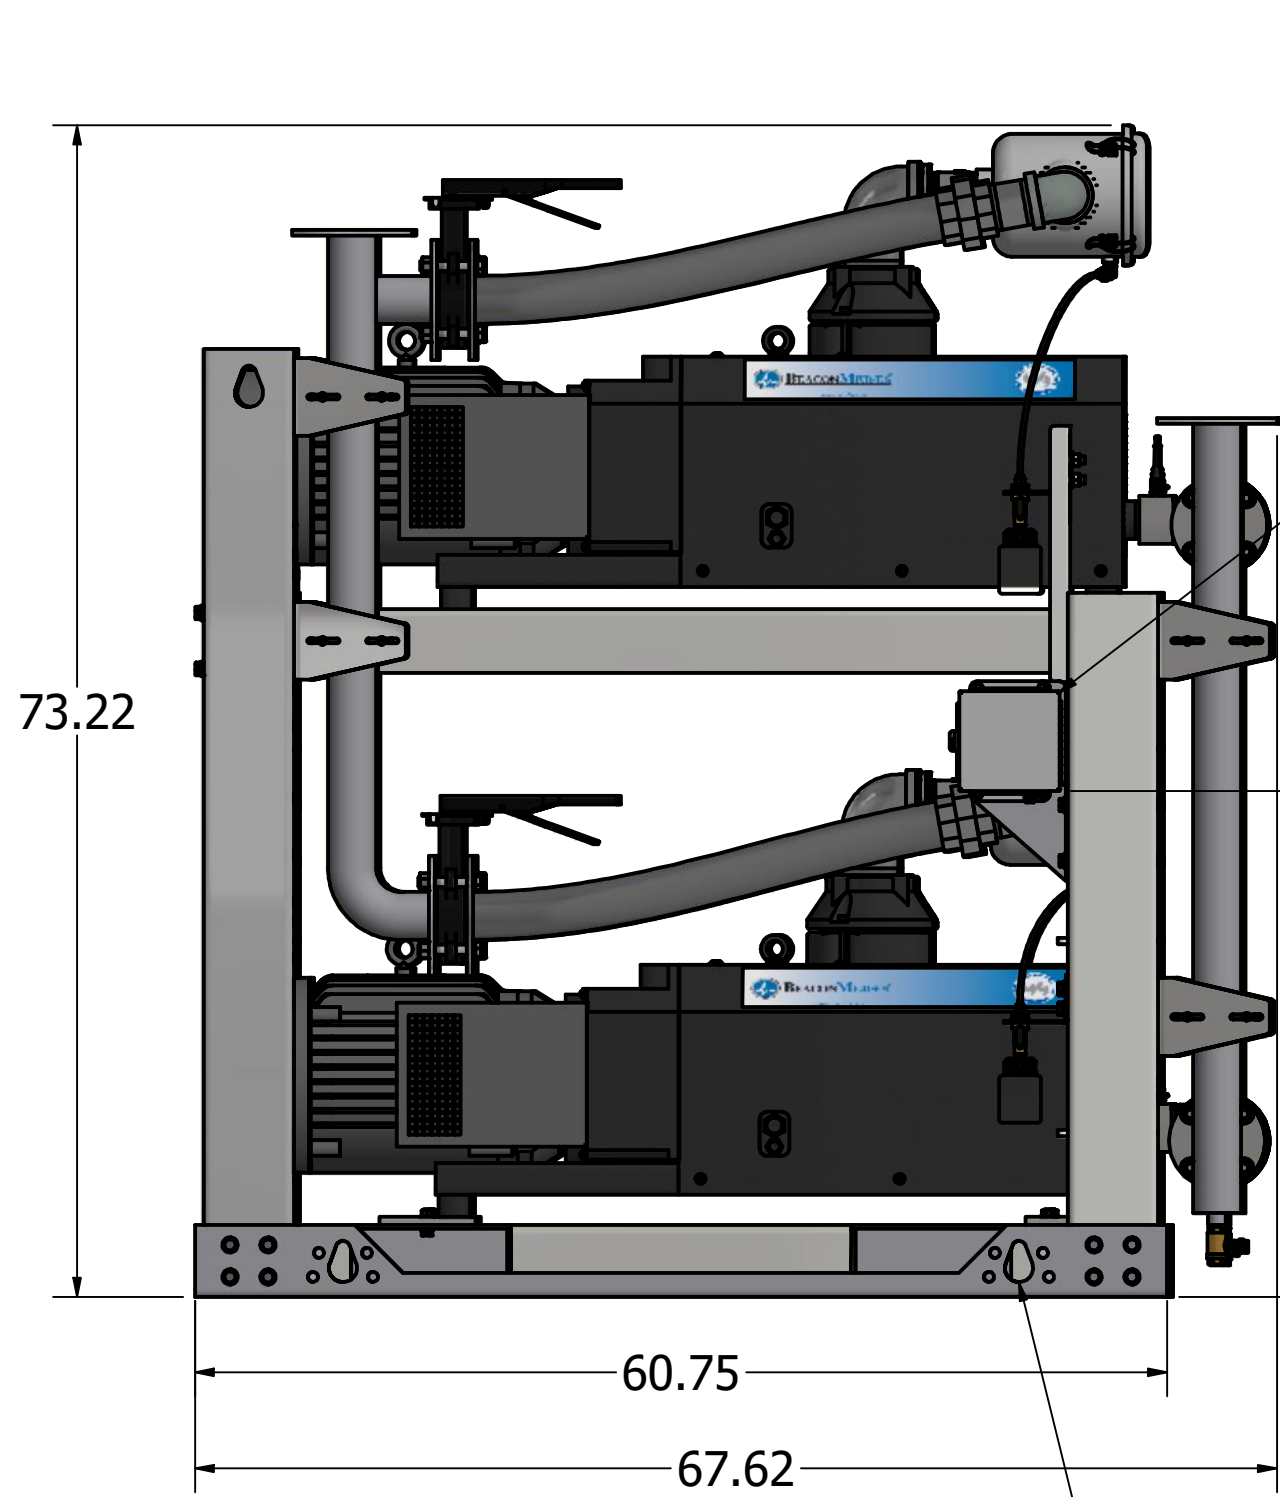

JUNCTION BOX  
FOR CONTROL  
WIRING

BIOHAZARD DRAIN  
FLASK PER PUMP

INTEGRATED  
LIFTING EYES

MANUAL  
CONDENSATE  
DRAIN, TYP

INLET  
3" FLANGE  
(3 PLACES)

I 66.69

D 54.94

C 1.97

C, D & I 1.20

148.50 REF