

NOTES:
1. DISCHARGE MUFFLERS WILL BE SHIPPED LOOSE.

2. DX MODULE WEIGHT: 2,301 LBS.
SX MODULE WEIGHT: 1,222 LBS.
(FUTURE EXPANSION MODULE)

240G TANK WEIGHT: 733 LBS

CONTROL CABINET WEIGHT: 215 LBS.

3.  INDICATES LIFTING POINT.

4.  DENOTES CENTER OF GRAVITY.

MINIMUM CLEARANCE FOR
MAINTENANCE & VENTILATION

REMOVE INTAKE MANIFOLD
BEFORE LIFTING
(3 PLACES)

REMOVE JUNCTION BOX
BEFORE LIFTING
(3 PLACES)

DISCHARGE
3" FLANGE
(3 PLACES)

Ø0.75
BOLTDOWN
(12 PLACES)

OUTLET
4" FLANGE

RECIEVER BYPASS
VALVE

HOSPITAL CONN
4" FLANGE

MANUAL DRAIN CONN
1/2" NPT (FEMALE)

0.69 X 1.09 SLOT
Ø26.00 B.C.
EQUALLY SPACED
(4 PLACES)

240 GAL VACUUM RECEIVER
4" FLANGED CONNECTIONS
(SCALE 1:12)






ELECTRICAL
CONNECTION

ALLOW 36" IN FRONT
OF CONTROL CABINET
FOR MAINTENANCE

MANUAL
CONDENSATE
DRAIN,TYP

CONTROL CABINET

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN LOCATION

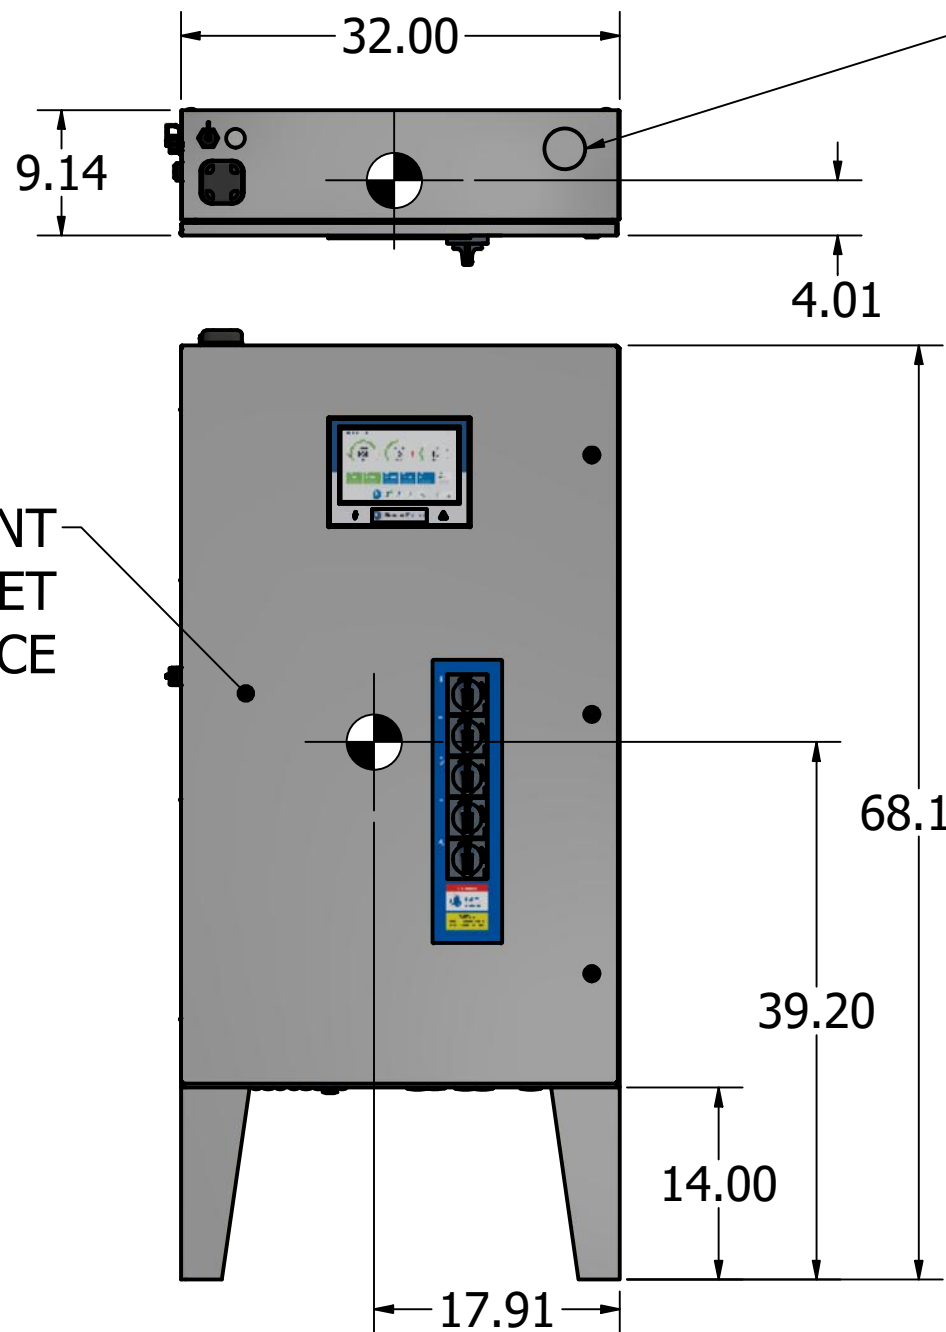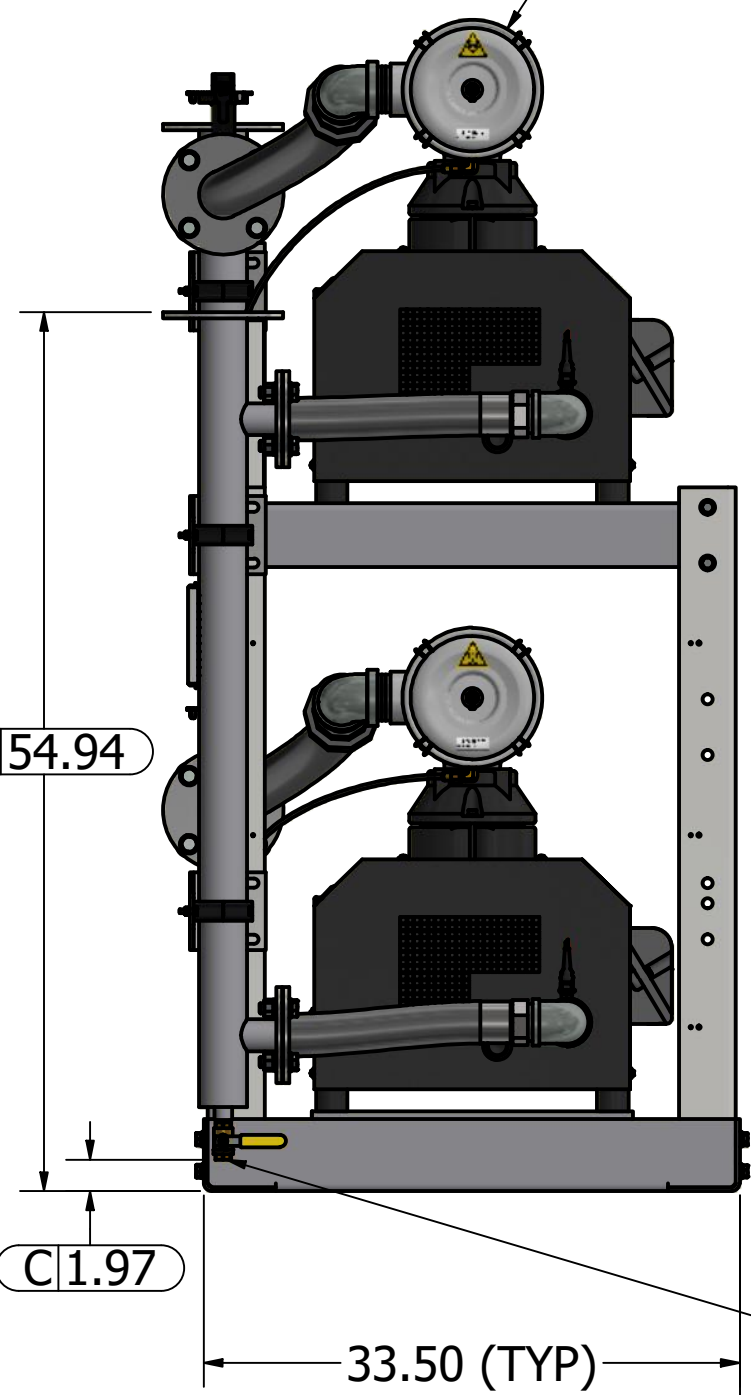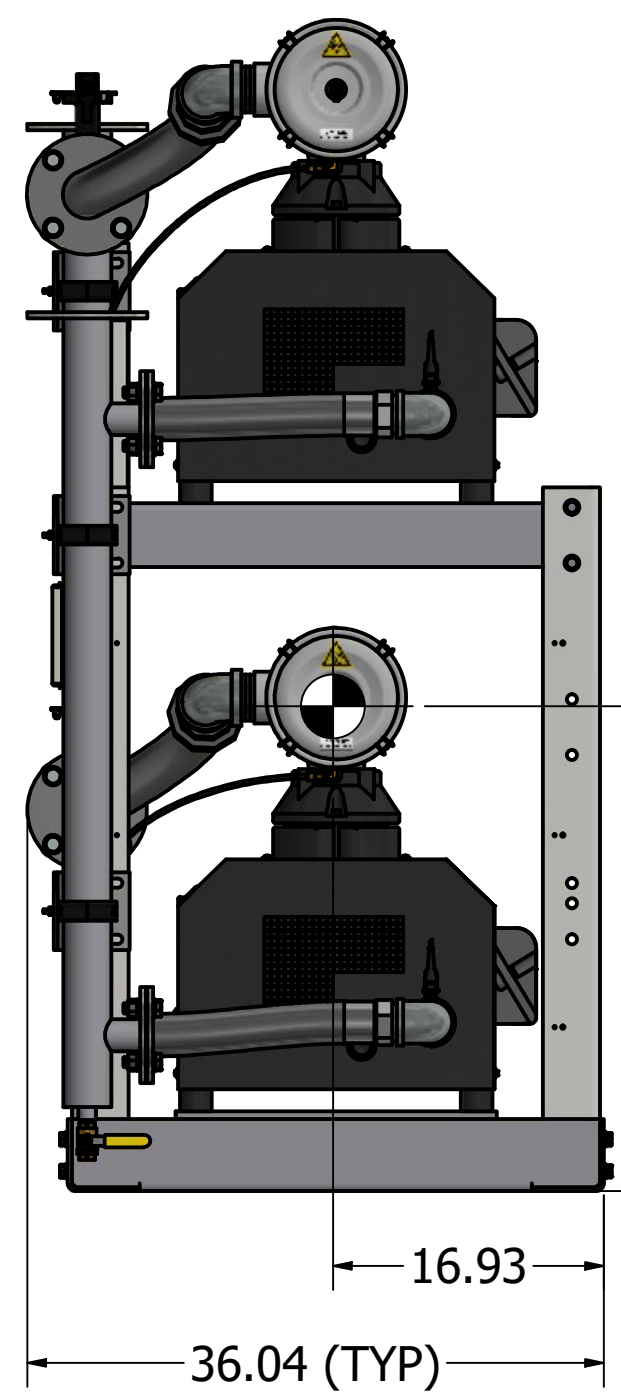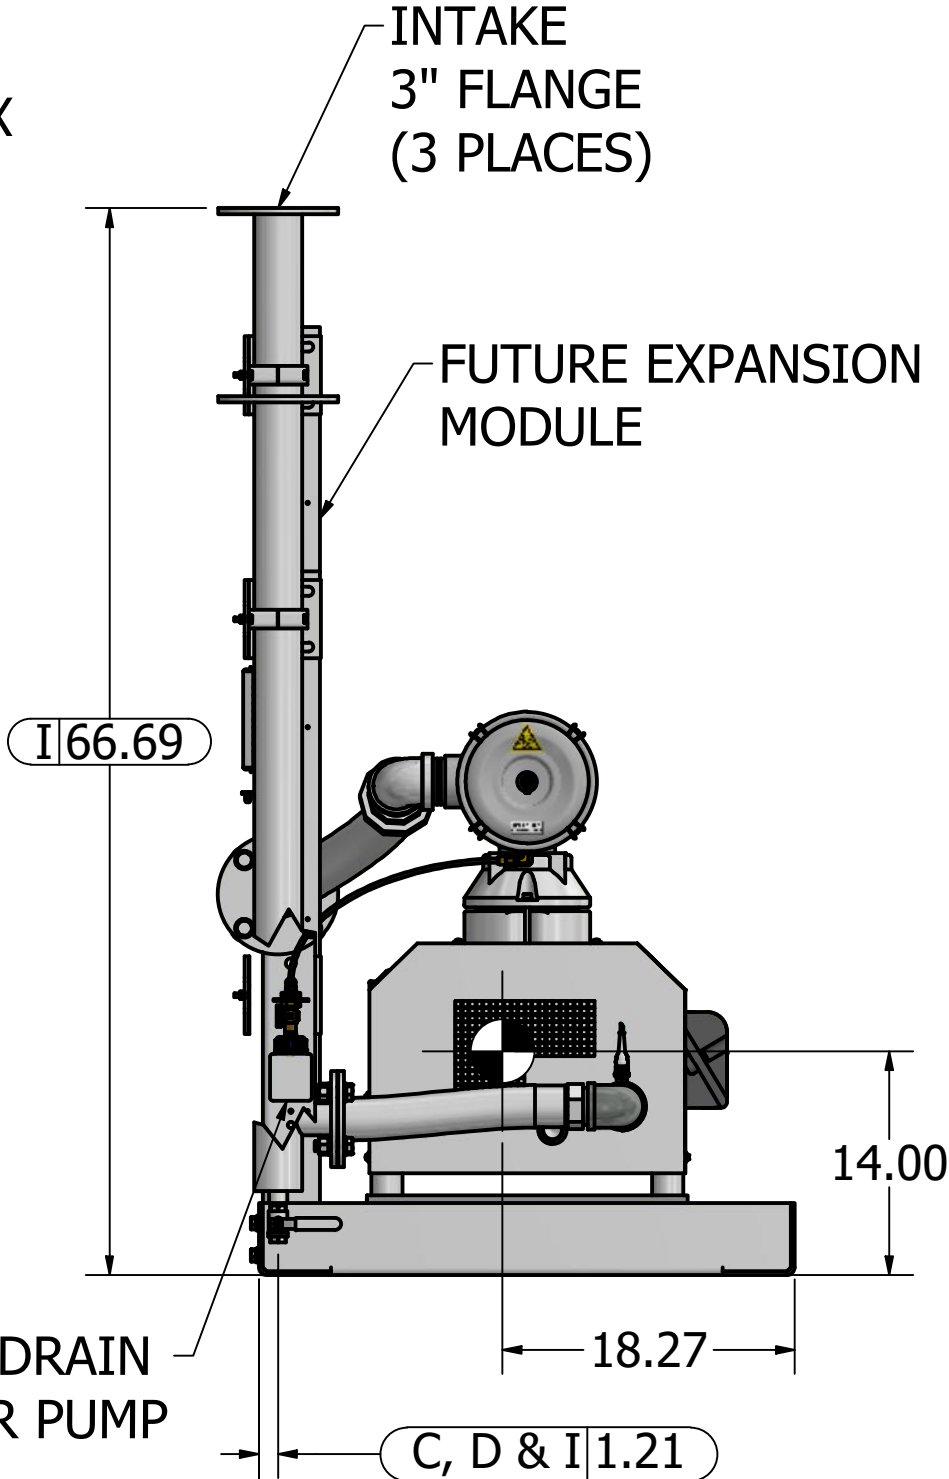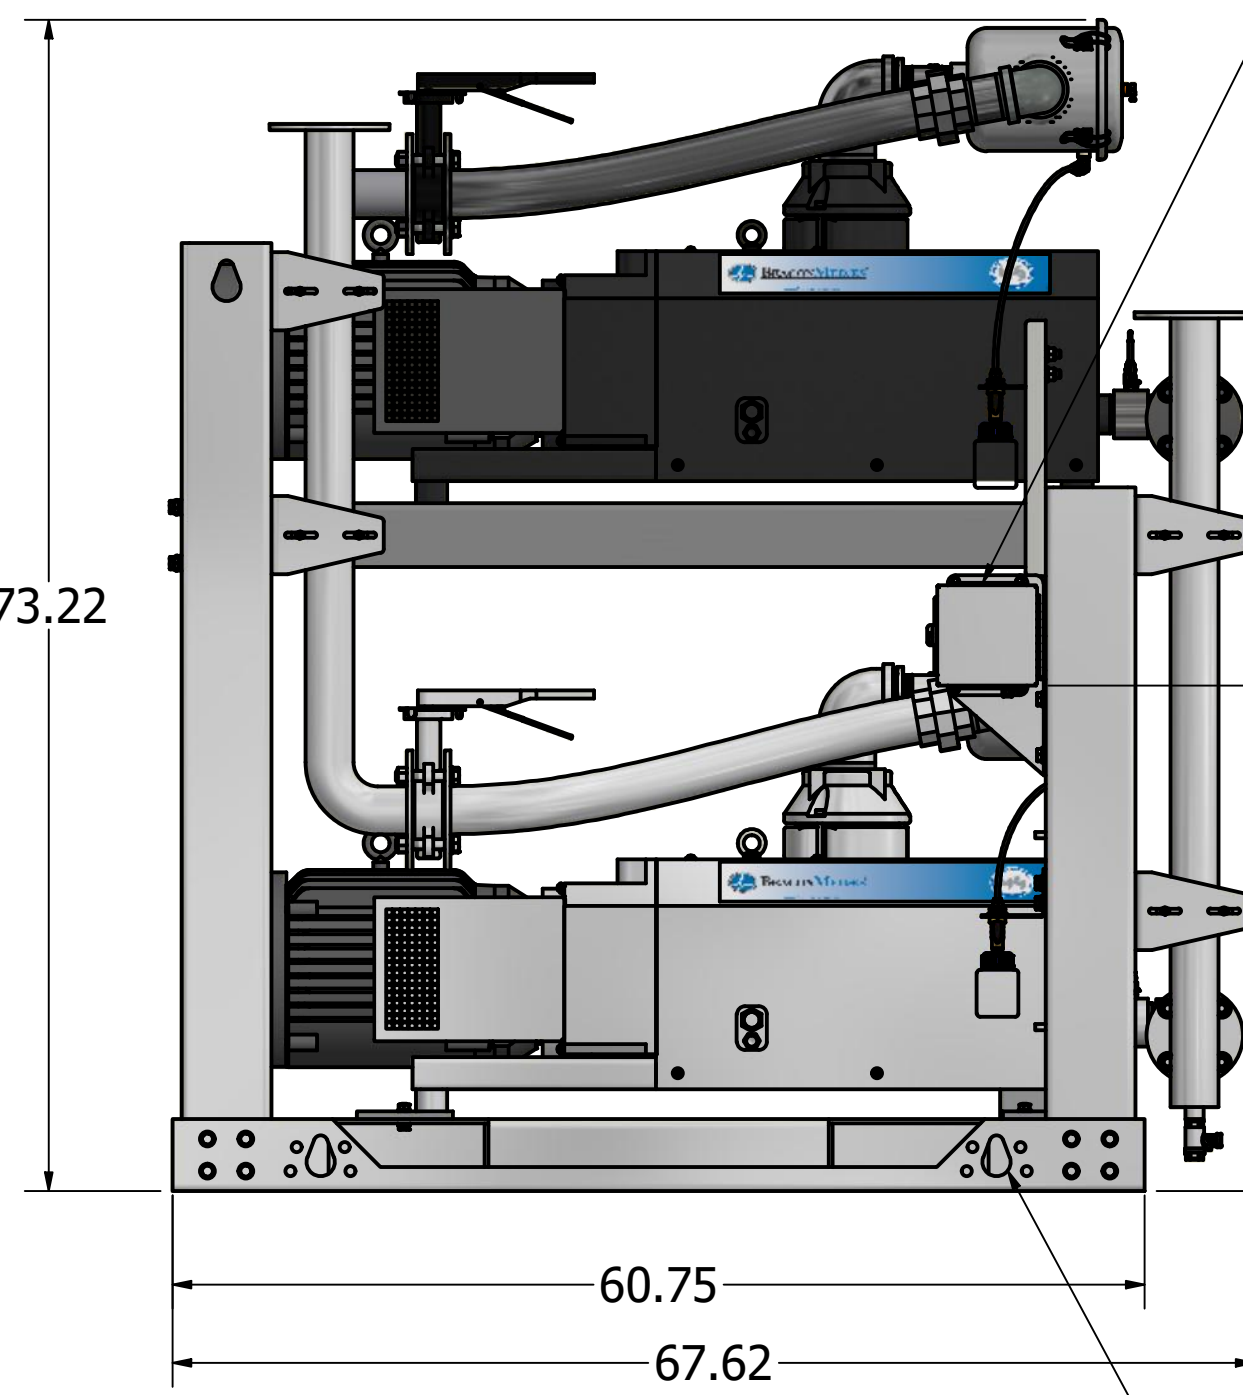

Revised: a00551998	Date: 3/30/2023	Drawn: JWO	Date: 1/22/2014
This drawing and the information contained therein remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering.		Scale: D	
Description: GENERAL ASSEMBLY 15HP QX-EXP-PX CLAW VAC MOD 240G RECEIVER STANDARD		Part Number: 4107 8549 47	
DN: HOP230841		Rev: 03	
Sheet 1 of 1		DO NOT SCALE THIS DOCUMENT	