


Notes:

1. DX MODULE W/ PANEL WEIGHT: 1,145 LBS  
DX MODULE WEIGHT: 933 LBS  
240G TANK WEIGHT: 713 LBS

2.  INDICATES LIFTING POINT.

3.  DENOTES CENTER OF GRAVITY.

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN

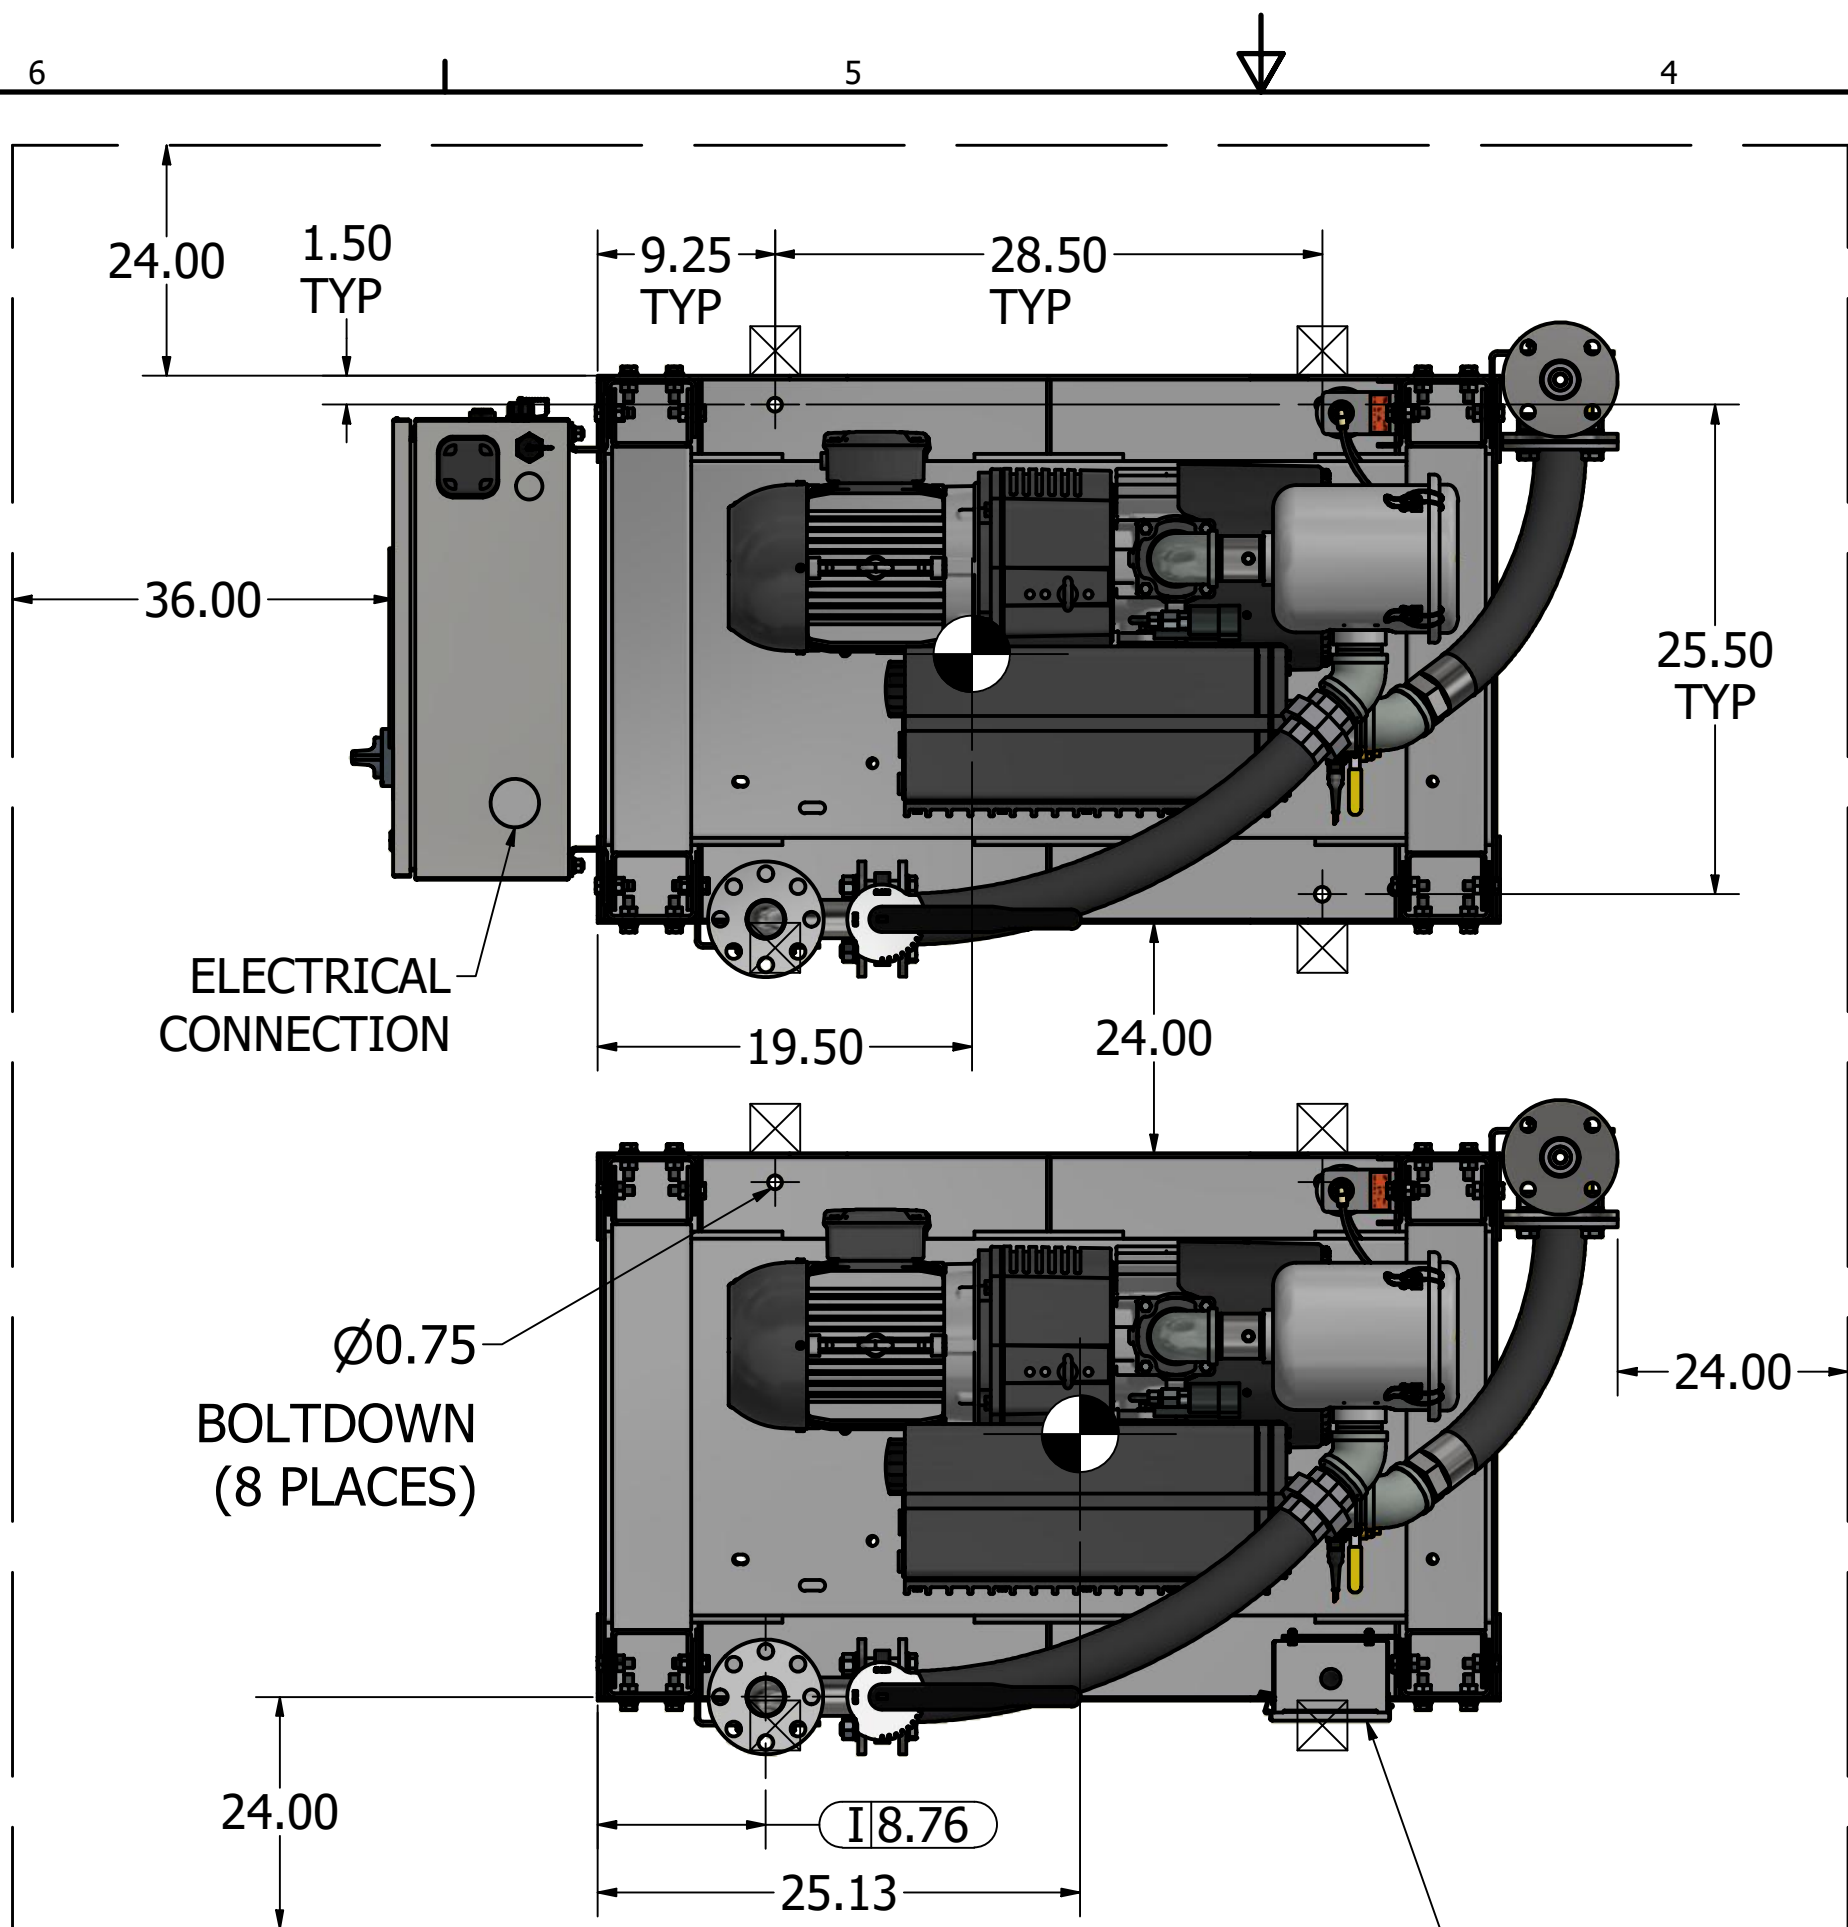

MINIMUM CLEARANCE FOR  
MAINTENANCE & VENTILATION

OUTLET  
3" FLANGE

RECEIVER BYPASS  
VALVE

HOSPITAL CONN  
3" FLANGE

MANUAL DRAIN CONN  
1/2" NPT (FEMALE)

0.56 X 0.88 SLOT  
Ø26.00 B.C.  
EQUALLY SPACED  
(4 PLACES)

240 GAL VACUUM RECEIVER  
3" FLANGED CONNECTIONS  
(SCALE 1:11)

HEPA INTAKE FILTER  
PER PUMP

MANUAL  
CONDENSATE  
DRAIN, TYP

CONTROL CABINET

BIOHAZARD DRAIN  
FLASK PER PUMP

26.32

14.48

28.50

14.61

34.09

23.11

INLET  
2" FLANGE  
(2 PLACES)

DISCHARGE  
2" FLANGE  
(2 PLACES)

D46.88

C4.01

C&D3.14

INTEGRATED  
LIFTING EYES


47.00

63.78

REMOVE INTAKE  
MANIFOLDS  
BEFORE LIFTING

I61.19

66.50

Revised: APS	Date: 3/24/2023	Drawn: USNKG	Date: 10/26/2010
		This drawing and the information contained therein remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering.	
Description: GENERAL ASSEMBLY 5HP QX LUBE VAC MOD 240G RECEIVER		Part Number: 4107 8522 22	
Sheet 1 of 1		Rev: 04	