NOTES:


₽

- 1. ALL INTERCONNECTING PIPE AND FITTINGS SHALL BE INSTALLED BY THE CONTRACTOR.
- 2. PIPING LAYOUT IS DIAGRAMMATIC ONLY. FINAL ARRANGEMENT WILL BE SITE SPECIFIC. CONTRACTOR WILL BE RESPONSIBLE FOR FIELD VERIFICATION AND COORDINATING ACTUAL LOCATION WITH ALL OTHER TRADES.
- 3. CONTRACTOR SHALL VERIFY MOTOR VOLTAGE, PHASE AND AMP RATINGS BEFORE STARTING ELECTRICAL INSTALLATION; AND MAKE CERTAIN THE VOLTAGE SUPPLIED BY THE FACILITY IS THE SAME.
- 4. THE ROOM REQUIRES DEDICATED MECHANICAL VENTILATION WITH AN ALLOWABLE TEMPERATURE VARIANCE OF 40° TO 105°F. (FOR HIGHER AMBIENTS, CONSULT FACTORY)
- 5. ALL ACCESSORIES, PIPE AND FITTINGS, EXCEPT DISCHARGE SILENCERS, BEYOND INLET AND DISCHARGE PORTS ARE SUPPLIED AND INSTALLED BY OTHERS.
- 6. ALLOW 36 INCHES IN FRONT OF CONTROL PANEL FOR MAINTENANCE AND VENTILATION, ALL OTHER SIDES REQUIRE 24 INCHES OF CLEARANCE.
- 7. WHEN DETERMINING THE TOTAL PIPE LENGTH, AND ALL THE STRAIGHT LENGTHS OF PIPE TOGETHER IN ADDITION TO THE NUMBER OF ELBOWS TIMES THE EFFECTIVE PIPE LENGTH FOR THAT PIPE SIZE. (SEE EQUIVALENT PIPE LENGTH TABLE & EXAMPLE CALCULATION IN THE O&M MANUAL)

FOR INTAKE PIPE SIZING REFER TO STANDARD PRESSURE DROP TABLES. TOTAL PRESSURE DROP SHOULD BE LESS THAN 2" Hg AT A SYSTEM VACUUM LEVEL OF 15" Hg.

FROM LABORATORY

DISCHARGE 3" FLANGE (2 PLACES)

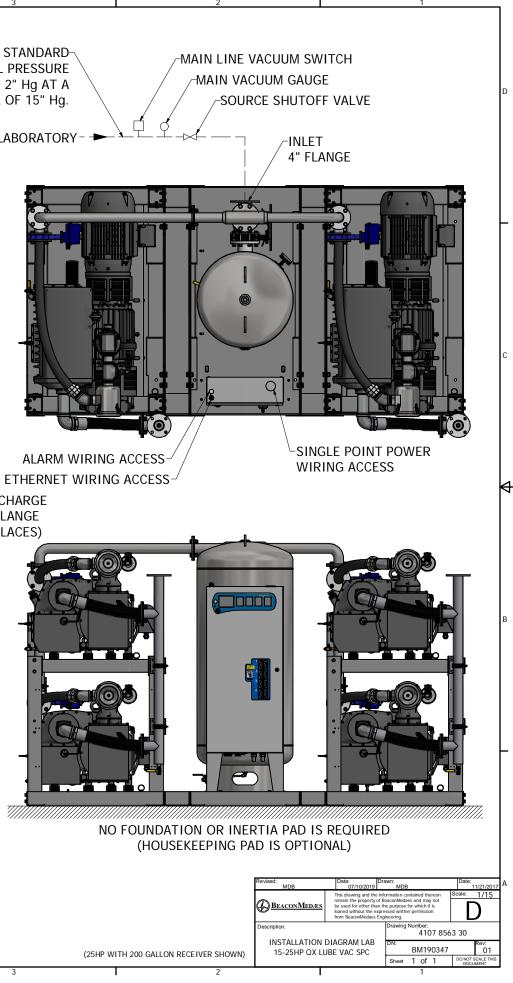

DRIP LEG VALVE-(2 PLACES)

OUTSIDE, TURN DOWN

AND SCREEN PER NFPA 99

INECTION-

NO VIBRATION PADS-ARE NECESSARY AT THIS LOCATION

Ф

		TANK DRAIN CON
IPT	8.00" NPT	

EFFECTIVE PIPE LENGTH						
PIPE SIZE (IN)	4.00" NPT	5.00" NPT	6.00" NPT	8.00" NPT		
EFF. PIPE LENGTH (FT)	10	11.9	13.2	14.5		

— – FIELD PIPING INLET

= == = FIELD PIPING OUTLET

EXHAUST PIPE SIZE TABLE (SEE NOTE 7)

0-300'

5.00" NPT

0-300'

6.00"NPT

PIPE LENGTH

PIPE LENGTH 0-500'

6.00" NPT

PIPE LENGTH

301'-500'

6.00" NPT

301'-500'

8.00" NPT

UNIT SIZE

QX 15

UNIT SIZE

QX 20

UNIT SIZE

QX 25