







- Notes:
1. DX MODULE W/ PANEL WEIGHT: 1,927 LBS
DX MODULE WEIGHT: 1,751 LBS (INCLUDES FUTURE EXPANSION PUMP)
200G TANK WEIGHT: 638 LBS
 2.  INDICATES LIFTING POINT.
 3.  DENOTES CENTER OF GRAVITY (INCLUDES FUTURE EXPANSION PUMP).

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN LOCATION



MINIMUM CLEARANCE FOR MAINTENANCE & VENTILATION

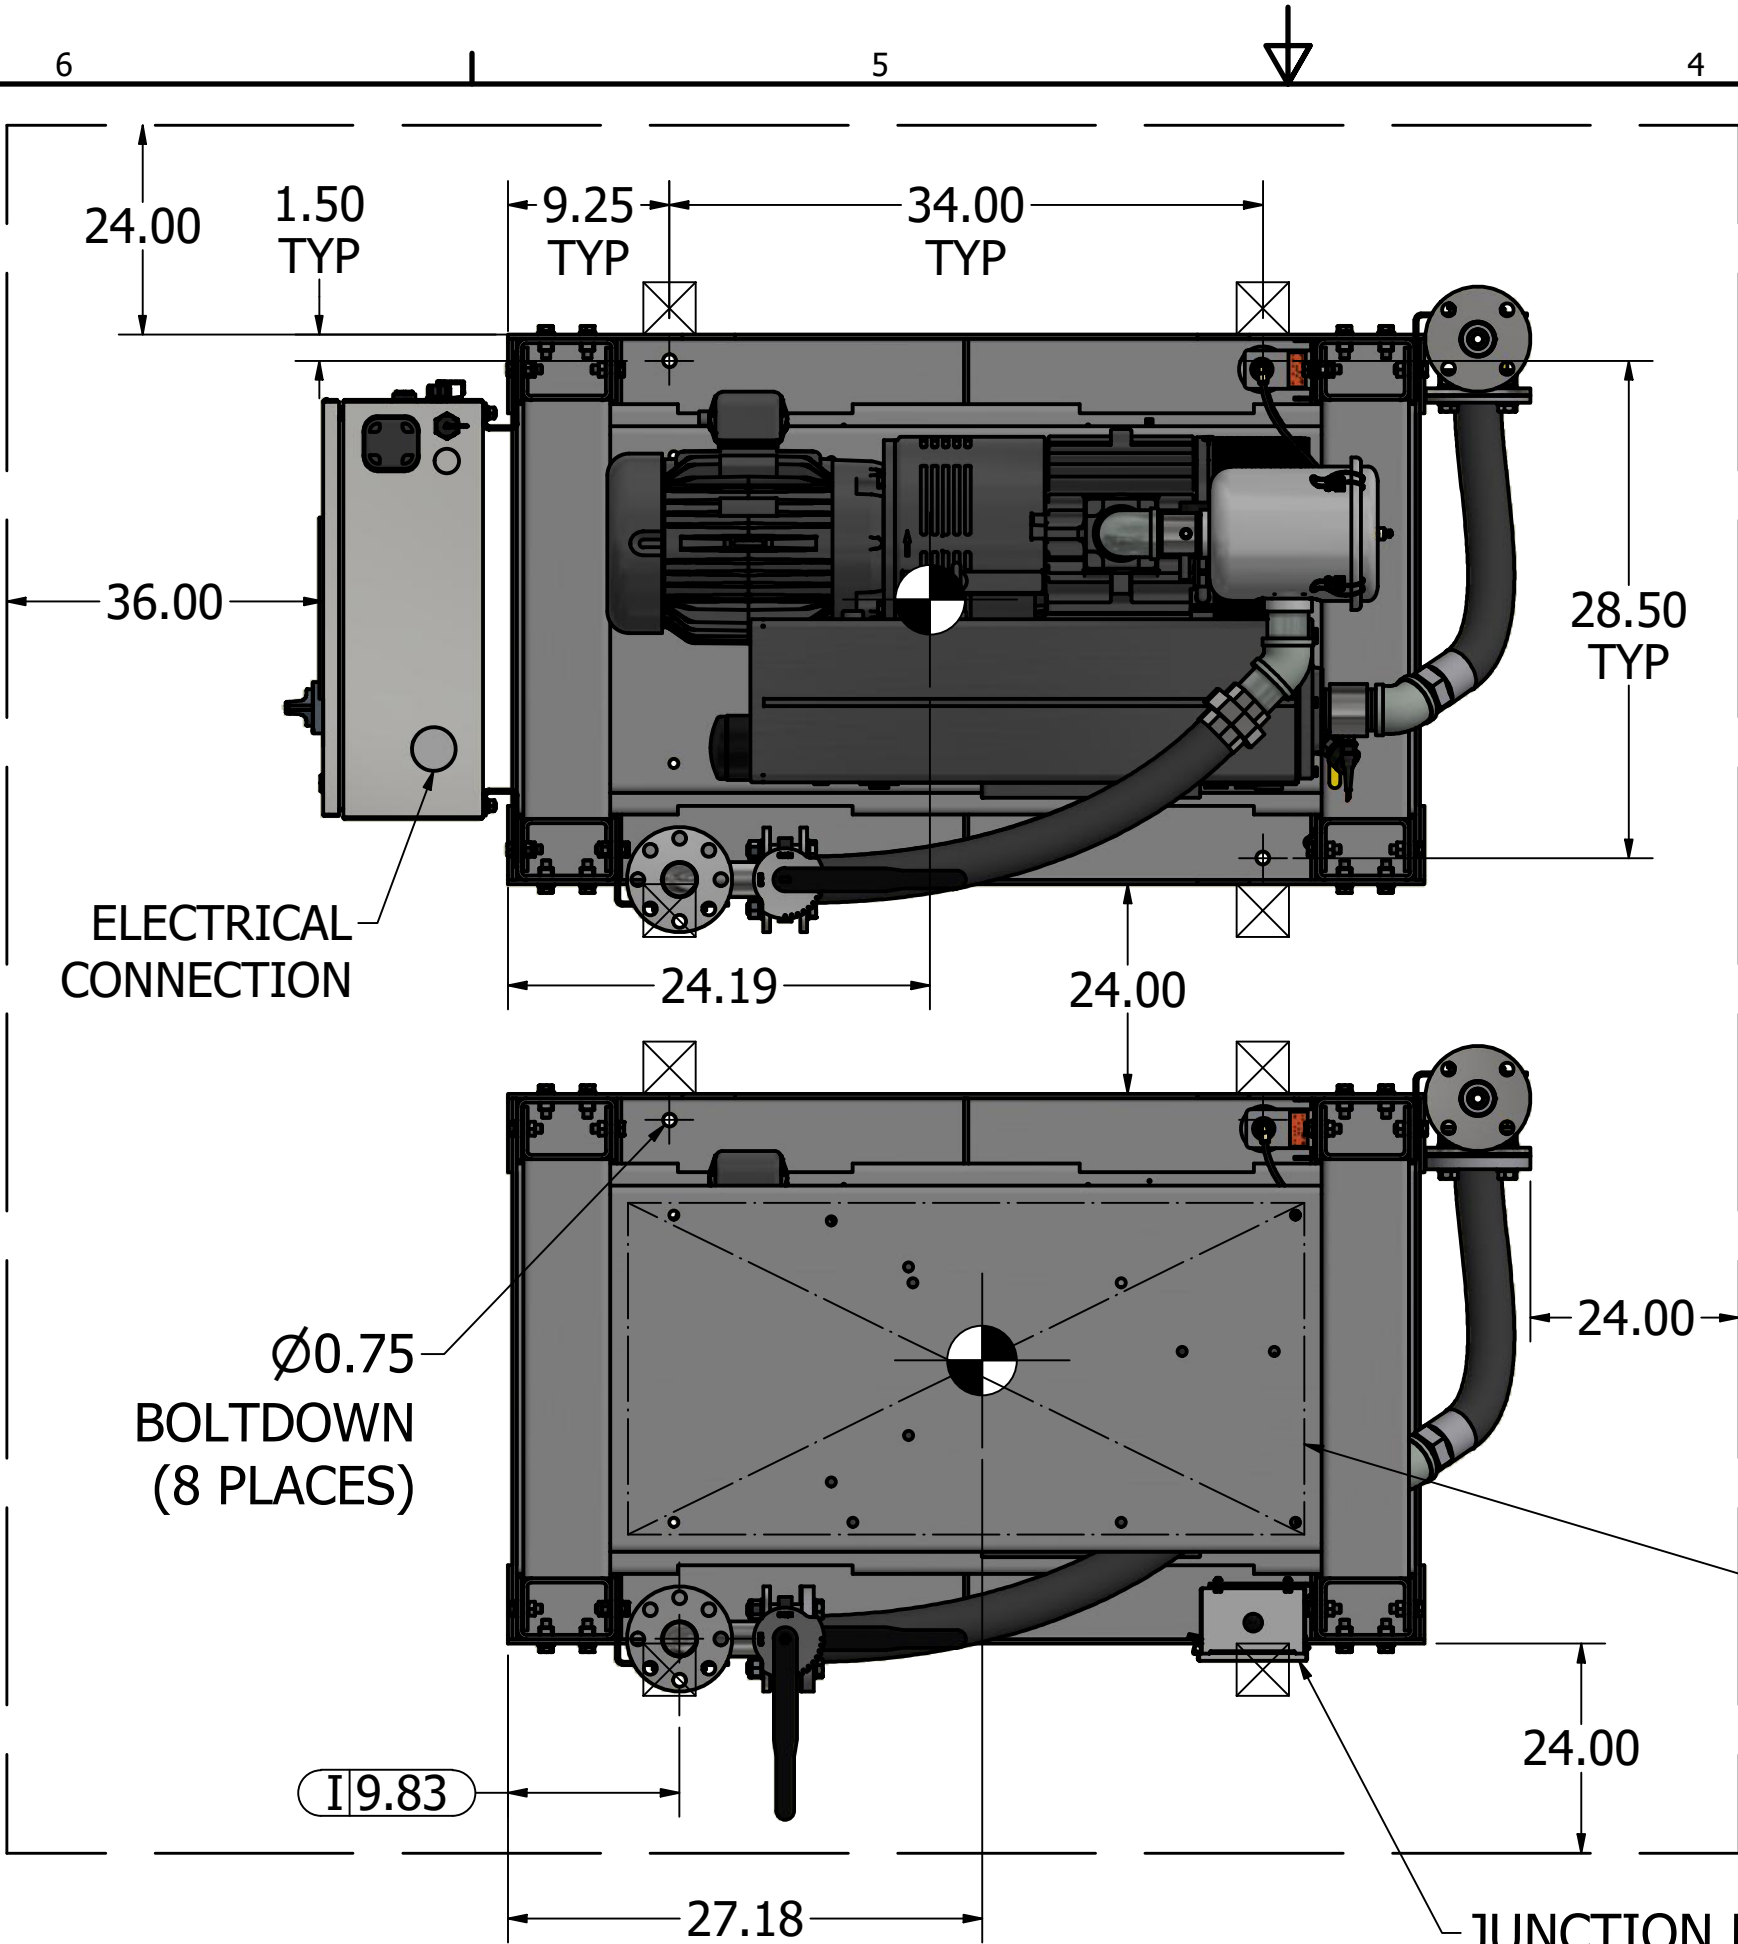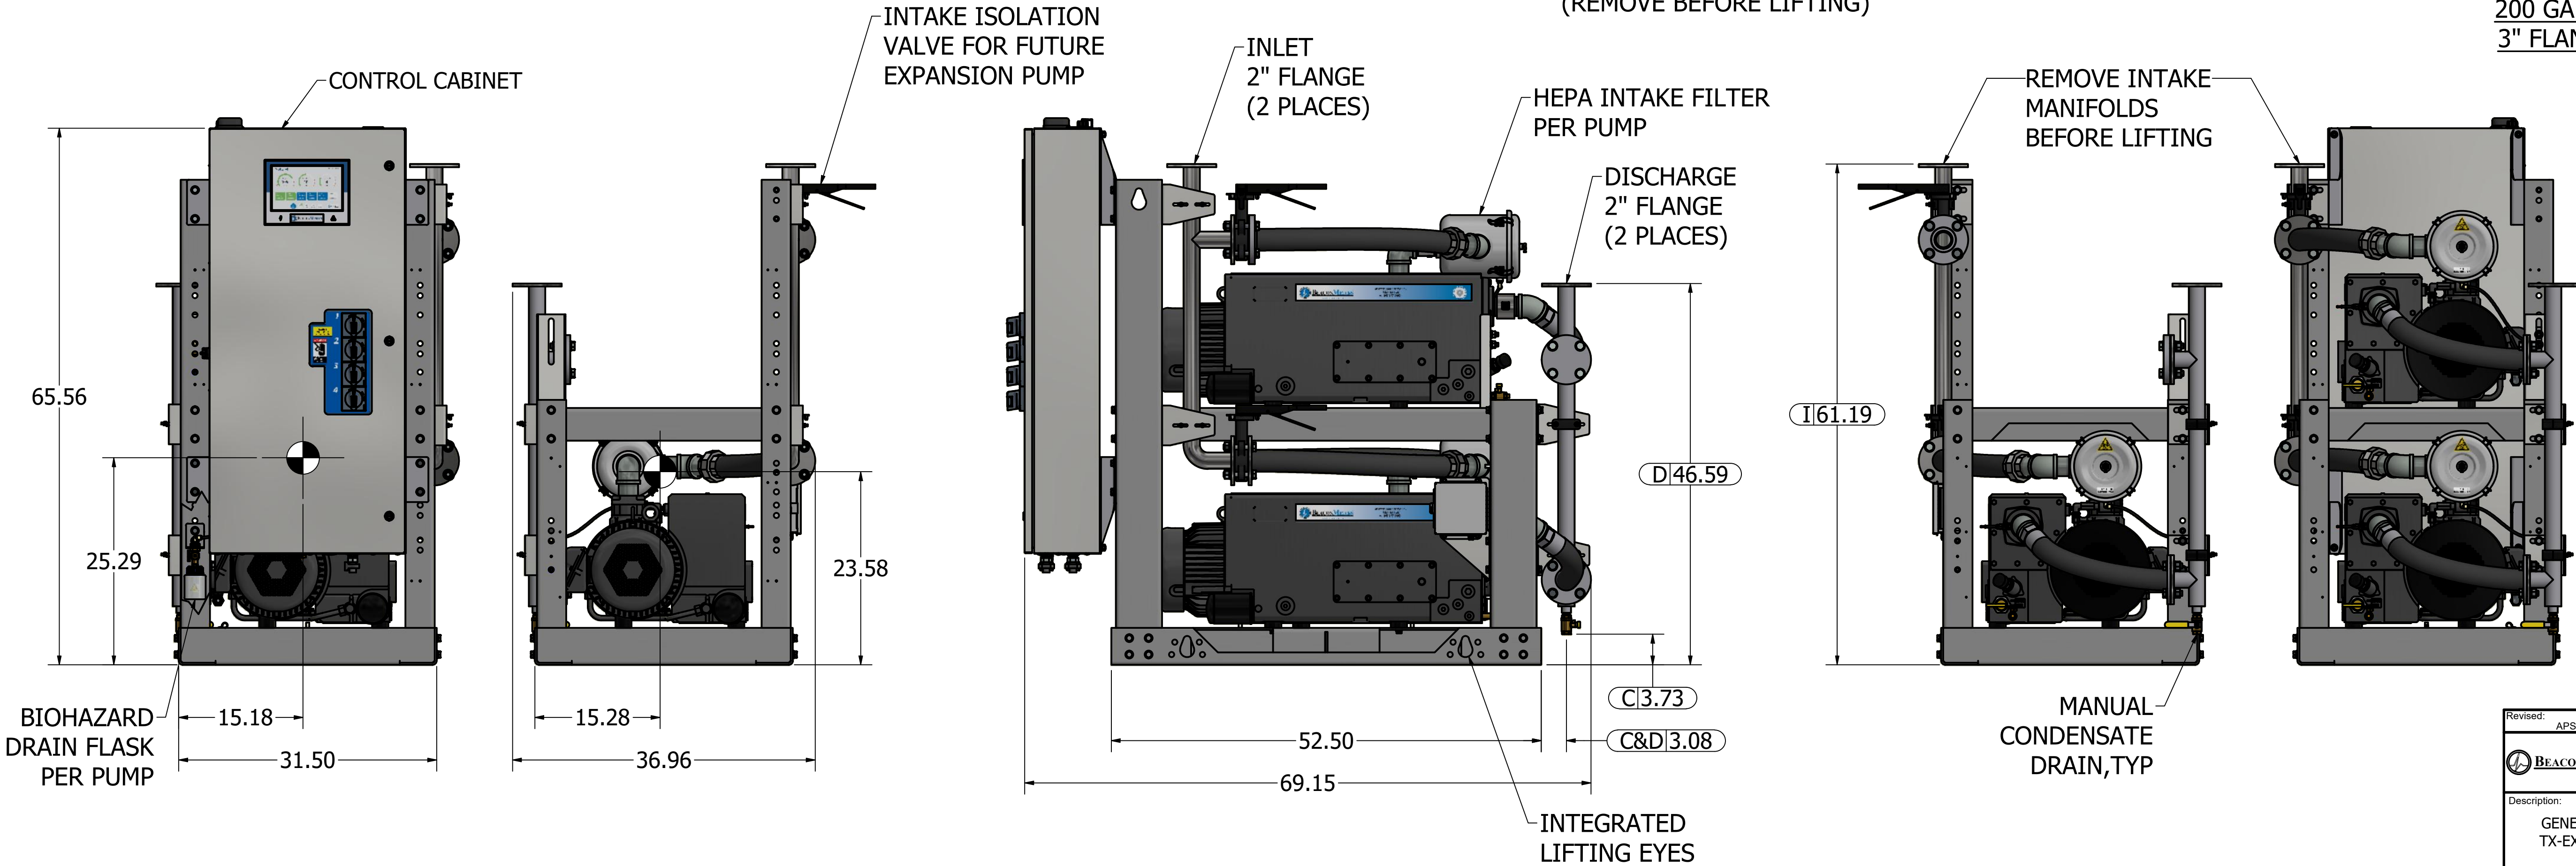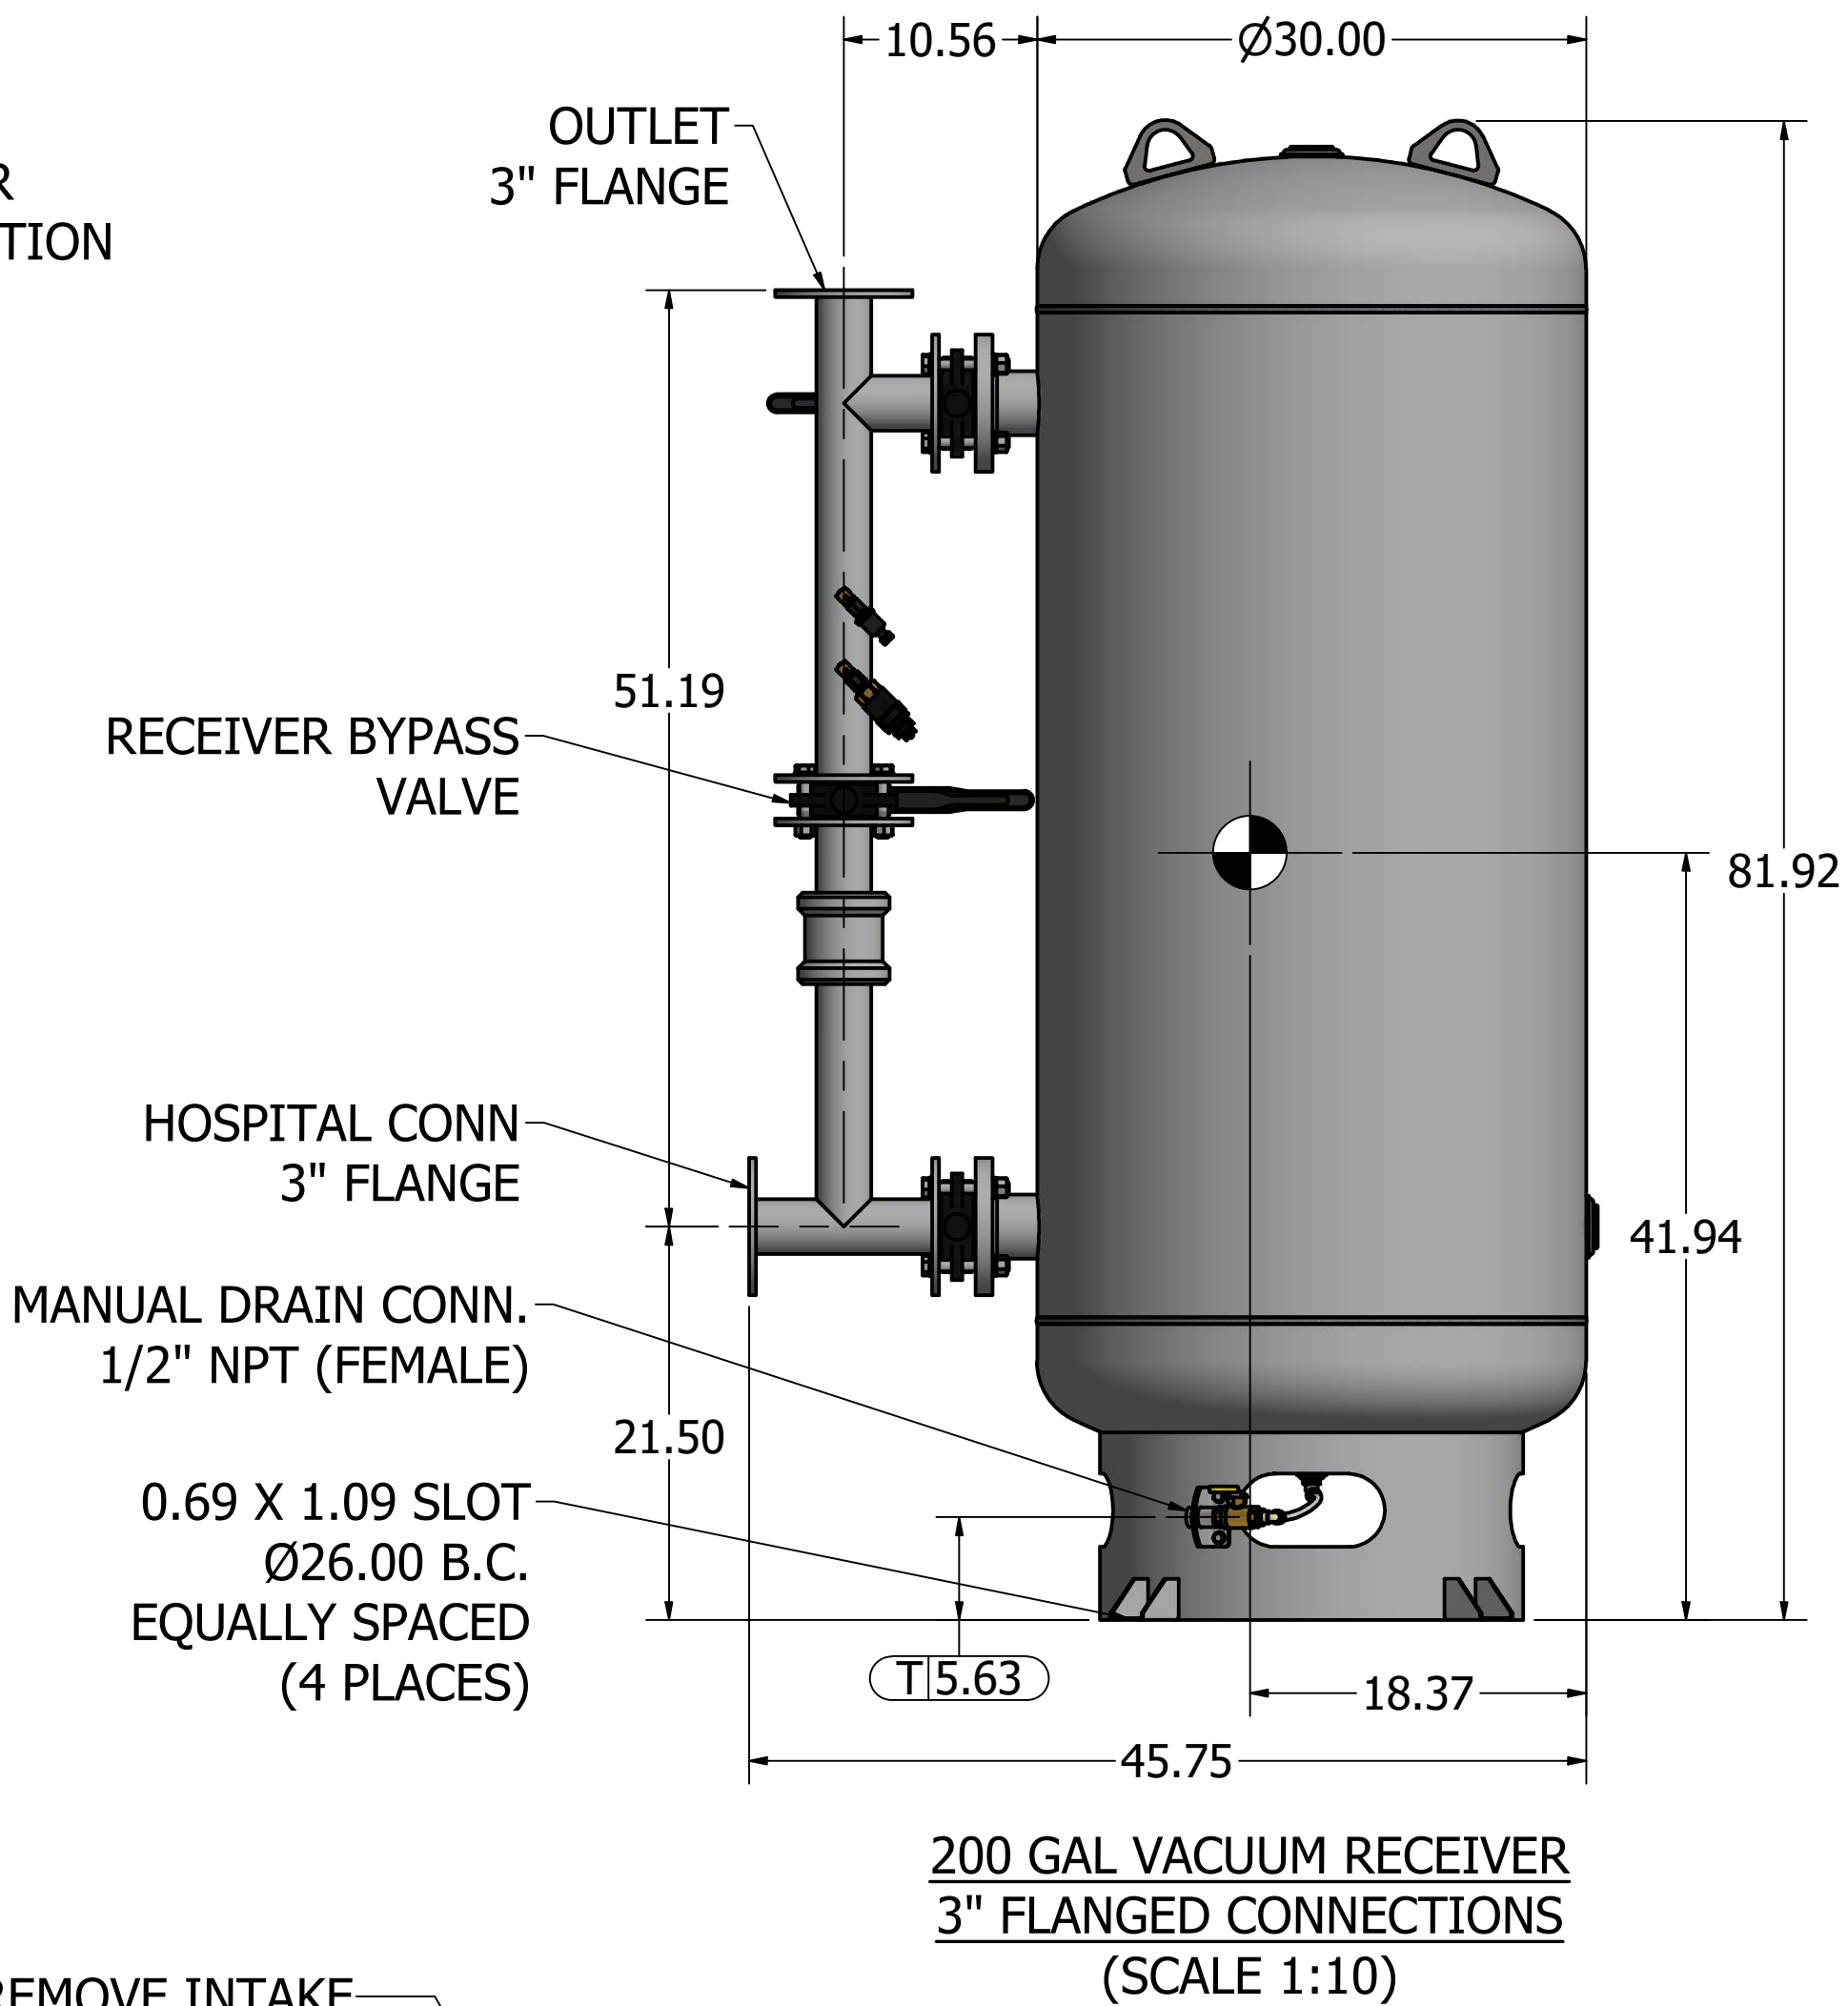

Revised: APS	Date: 3/29/2023	Drawn: USNKG	Date: 11/11/2010
		This drawing and the information contained therein remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering.	
Description: GENERAL ASSEMBLY 10HP TX-EXP-QX LUBE VAC MOD 200G RECEIVER		Part Number: 4107 8522 78	
DN: HOP230842		Rev: 03	
Sheet 1 of 1		DO NOT SCALE THIS DOCUMENT	