
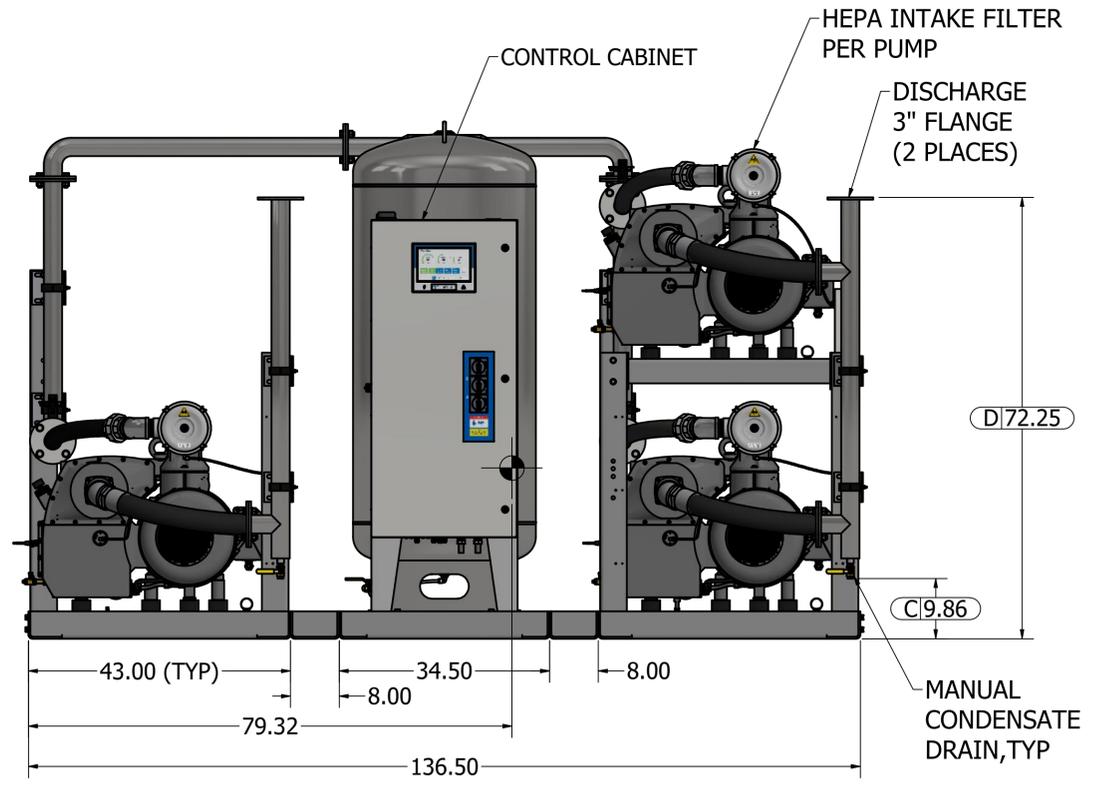
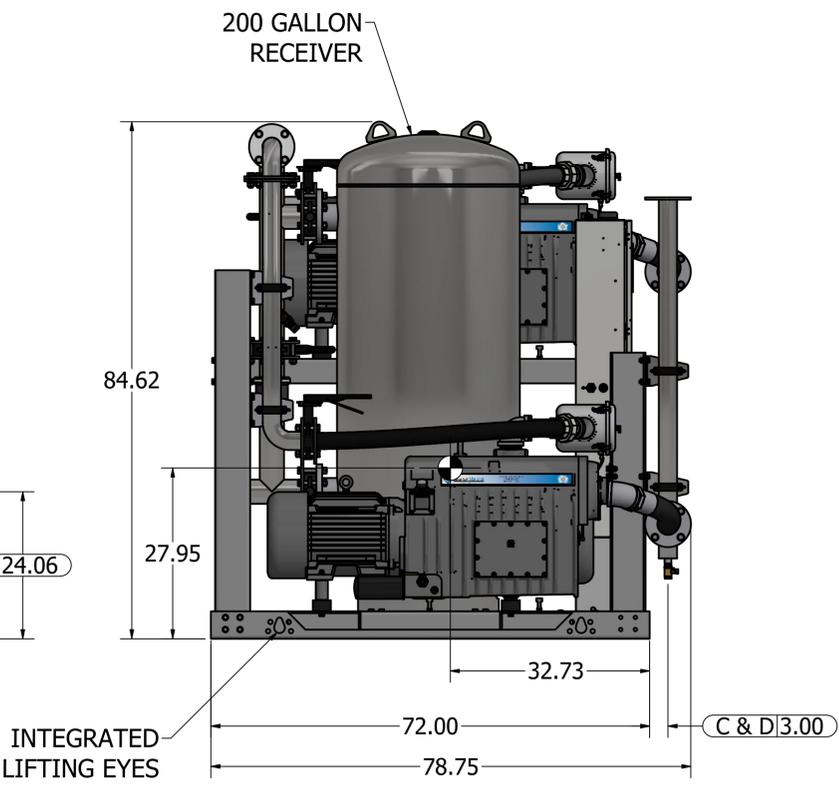
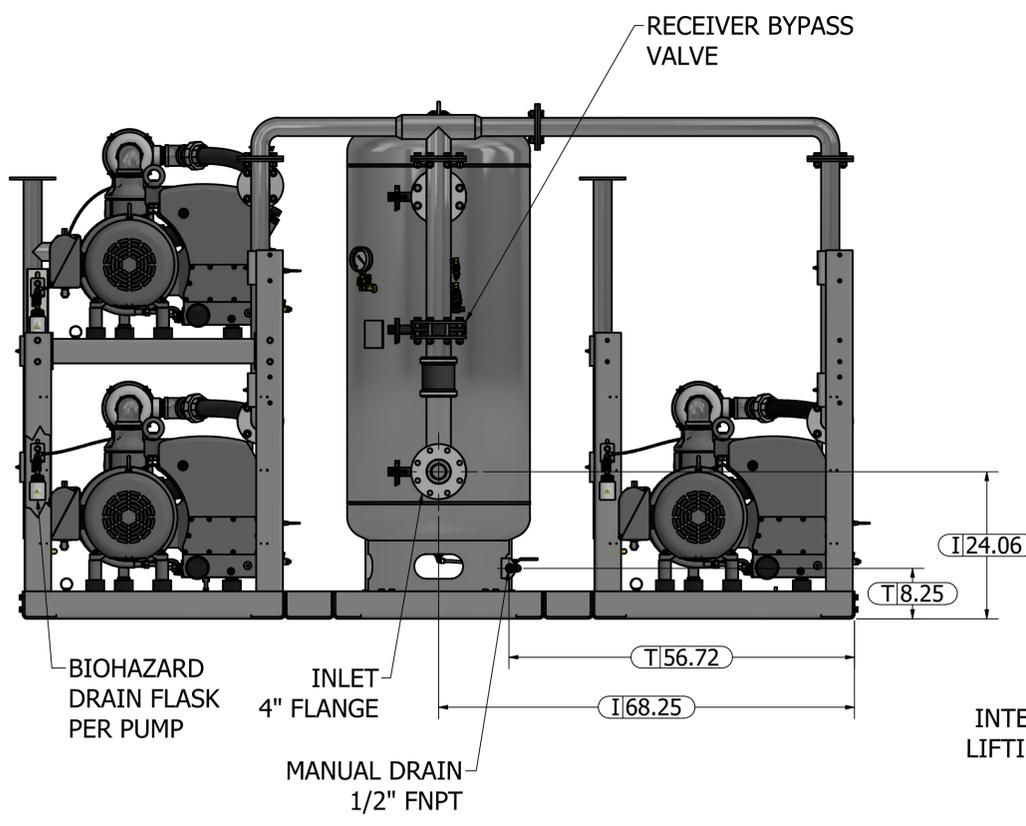


Notes:

1. SYSTEM WEIGHT: 6,855 LBS.
2.  INDICATES LIFTING POINT.
3.  DENOTES CENTER OF GRAVITY.

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
C	CONDENSATE DRAIN LOCATION
T	TANK DRAIN LOCATION

MINIMUM CLEARANCE FOR MAINTENANCE & VENTILATION

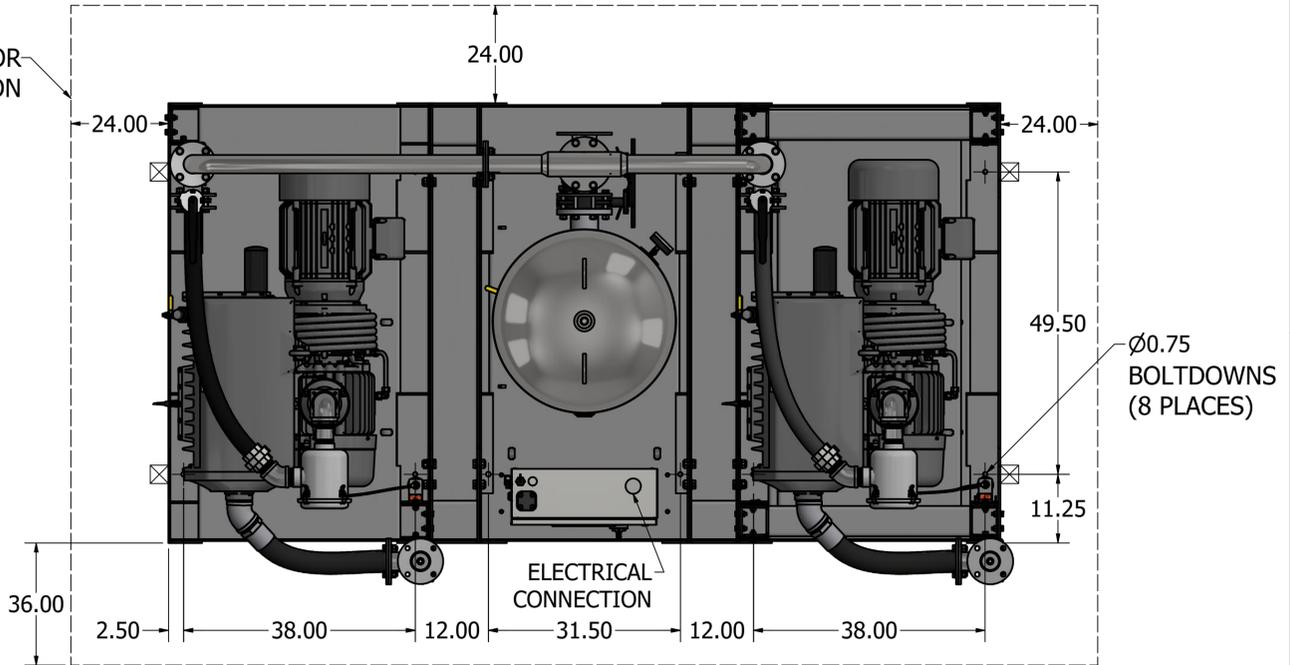

Revised: APS	Date: 3/7/2023	Drawn: MDB	Date: 10/4/2010
		This drawing and the information contained therein remain the property of BeaconMedaes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedaes Engineering.	
Description: GENERAL ASSEMBLY 15HP TX LUBE VAC SPC 200G RECEIVER		Part Number: 4107 8522 49	
DN: HOP230842		Rev: 03	
Sheet 1 of 1		DO NOT SCALE THIS DOCUMENT	