




Notes:

- DISCHARGE MUFFLERS WILL BE SHIPPED LOOSE.
- SYSTEM WEIGHT: 4,598.5 LBS.
- ☒ INDICATES LIFTING POINT.
- DENOTES CENTER OF GRAVITY.

SYSTEM CONNECTIONS	
ID	DESCRIPTION
I	INLET LOCATION
D	DISCHARGE LOCATION
T	TANK DRAIN LOCATION
C	CONDENSATE DRAIN LOCATION

Ø0.75 BOLTDOWNS  
(12 PLACES)


MINIMUM CLEARANCE  
FOR MAINTENANCE & VENTILATION

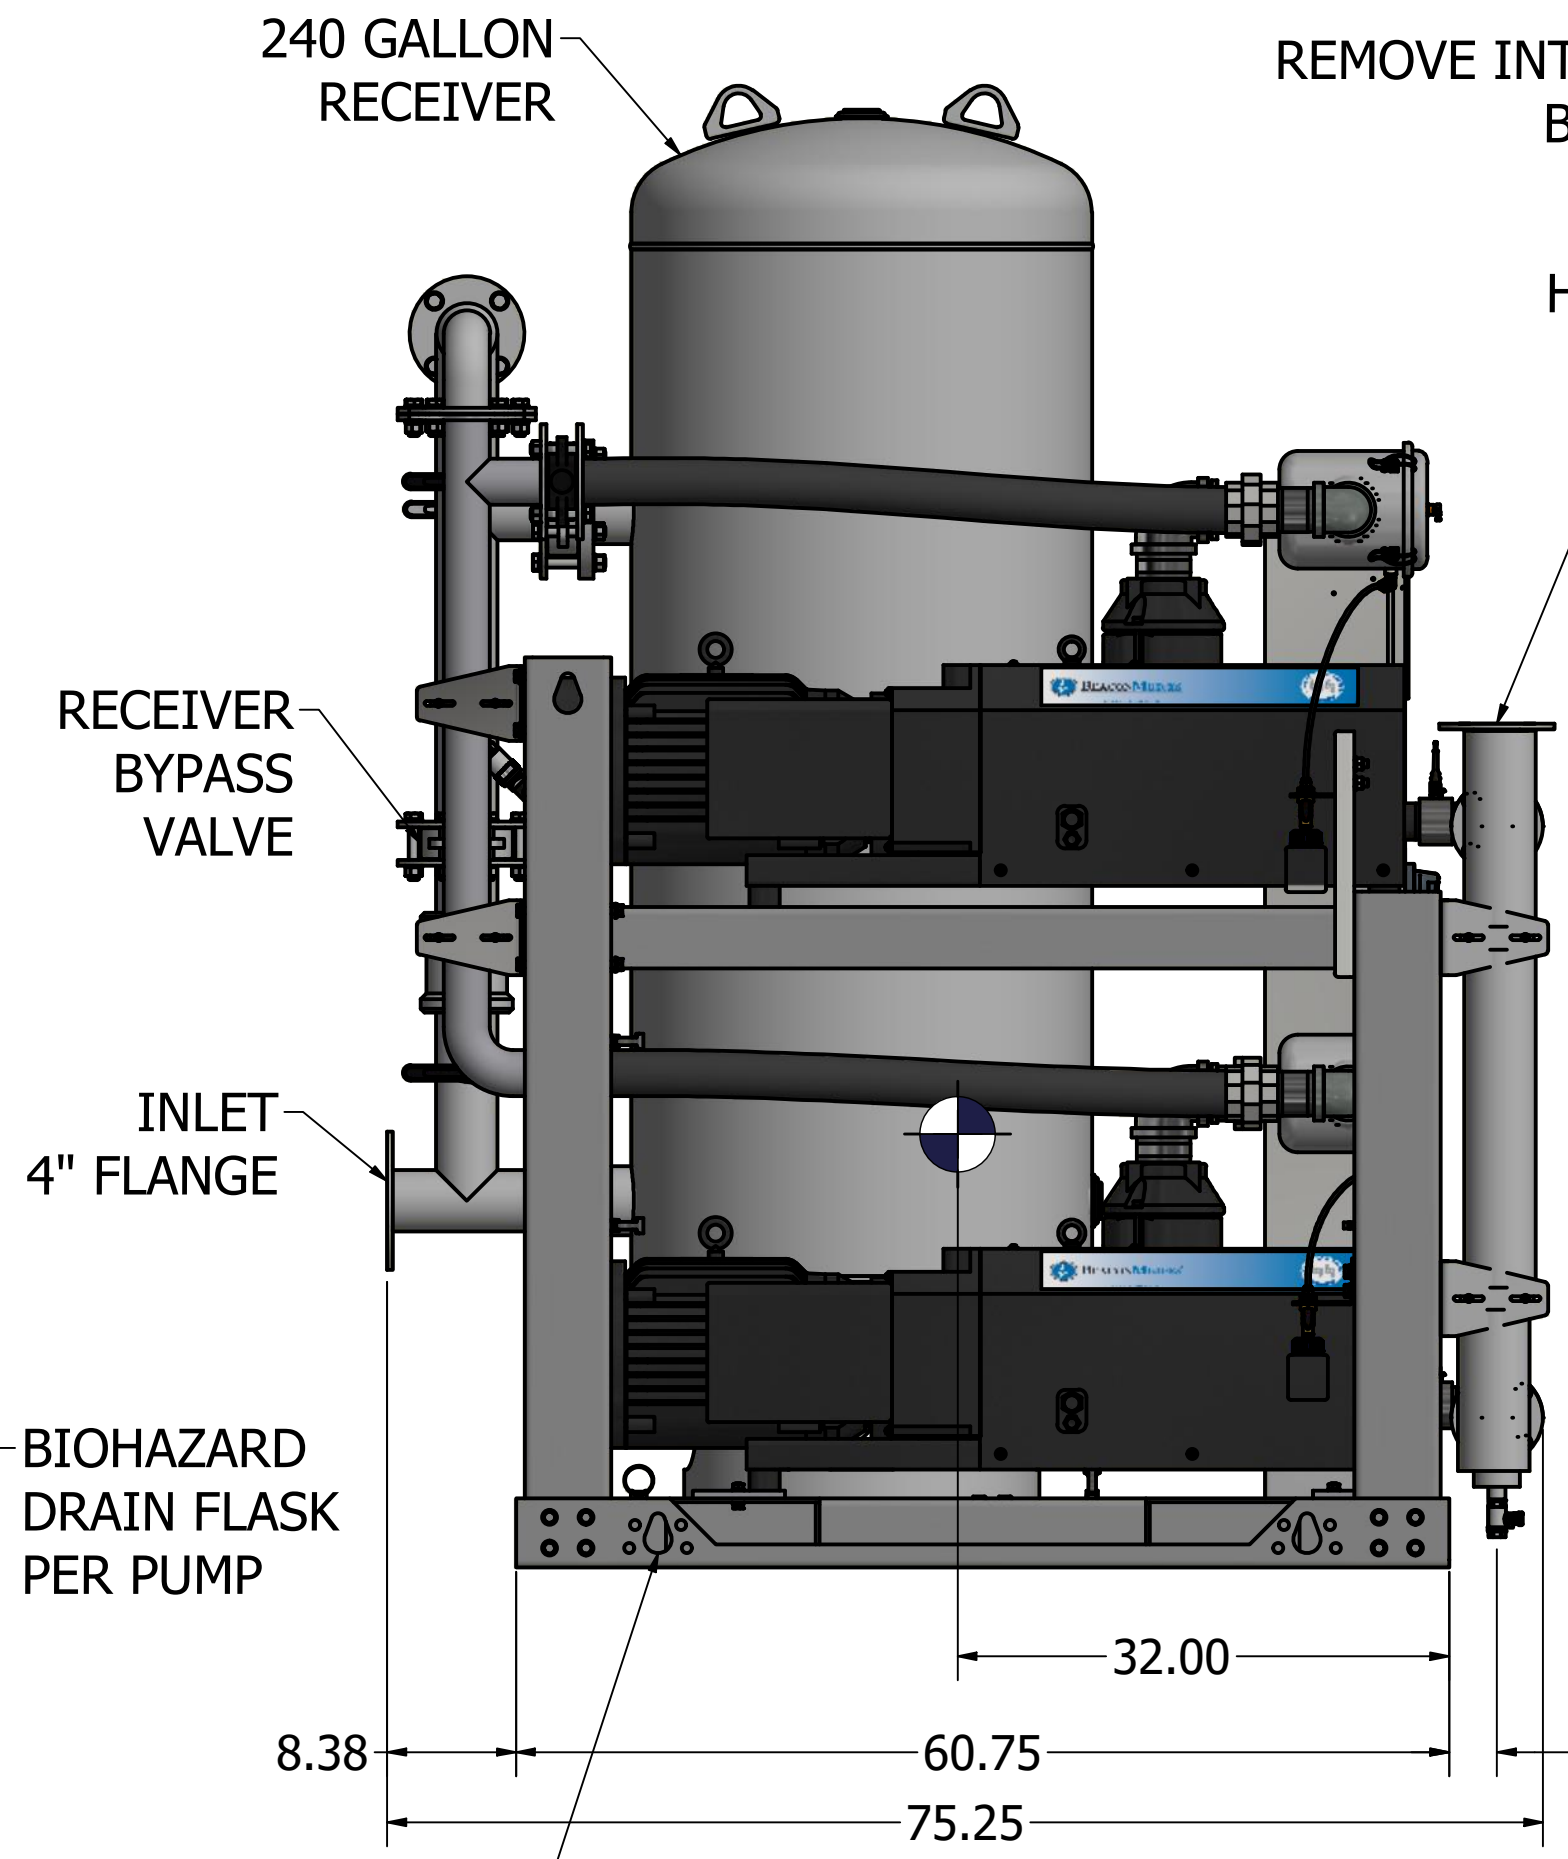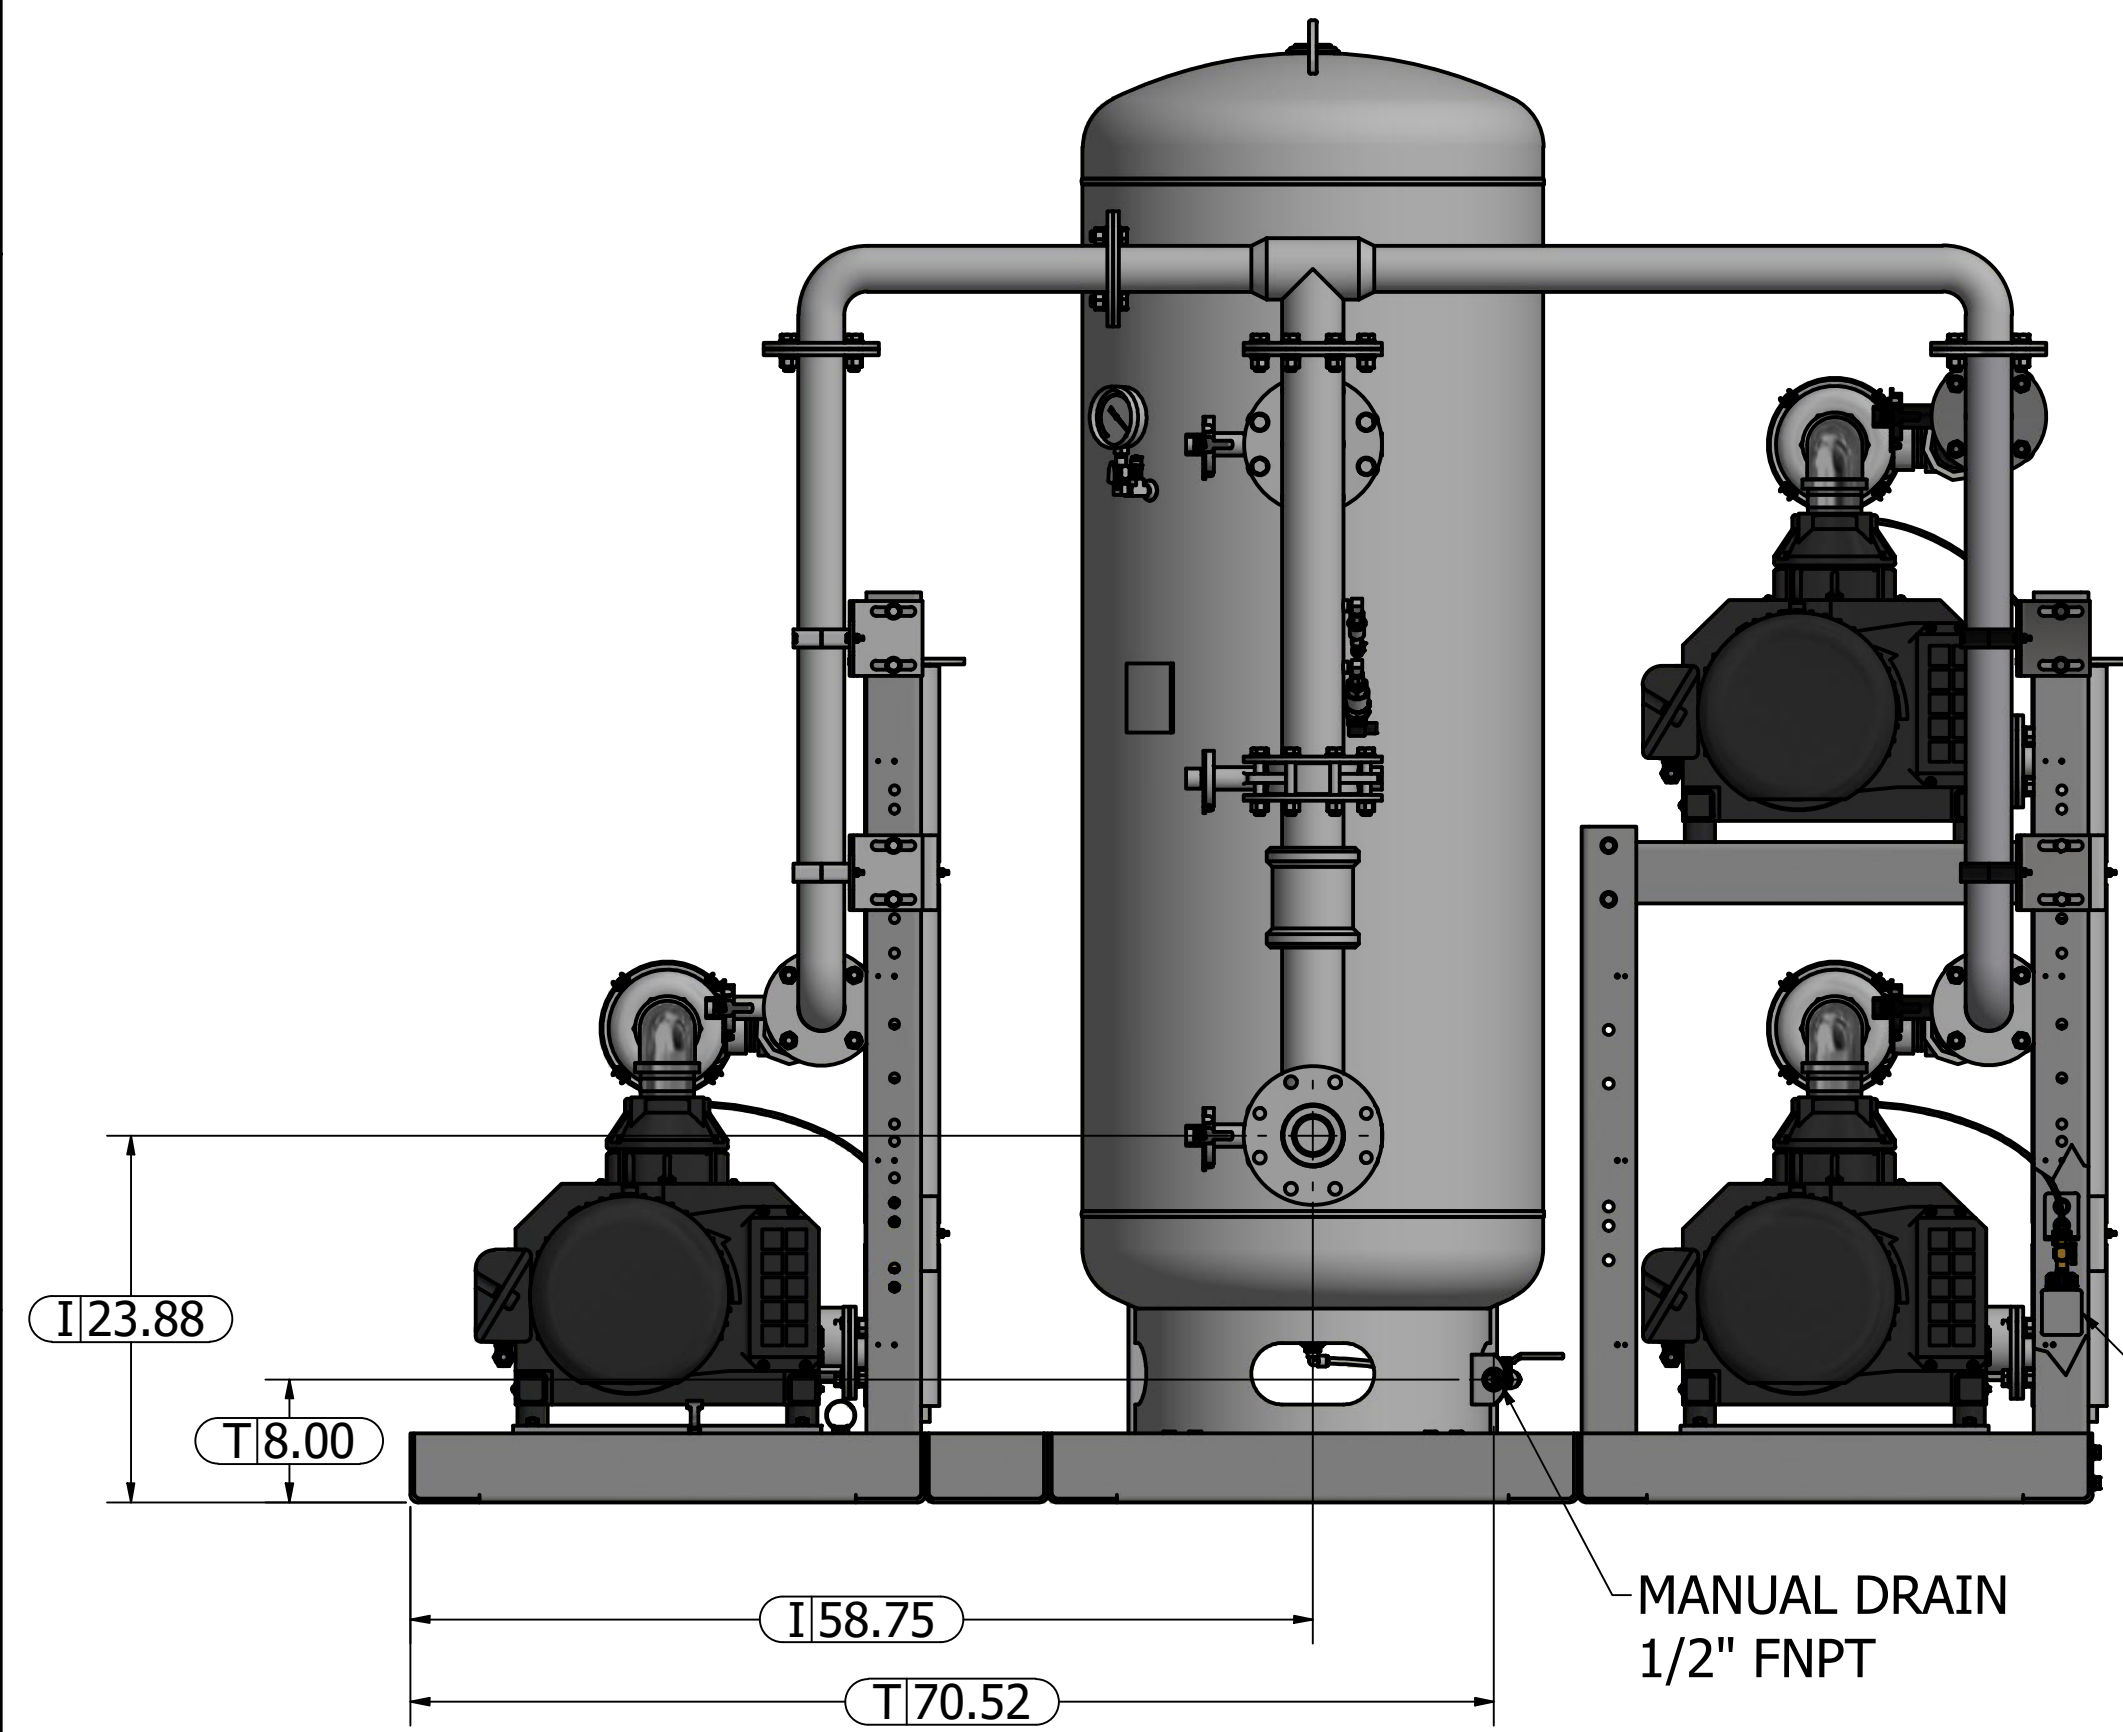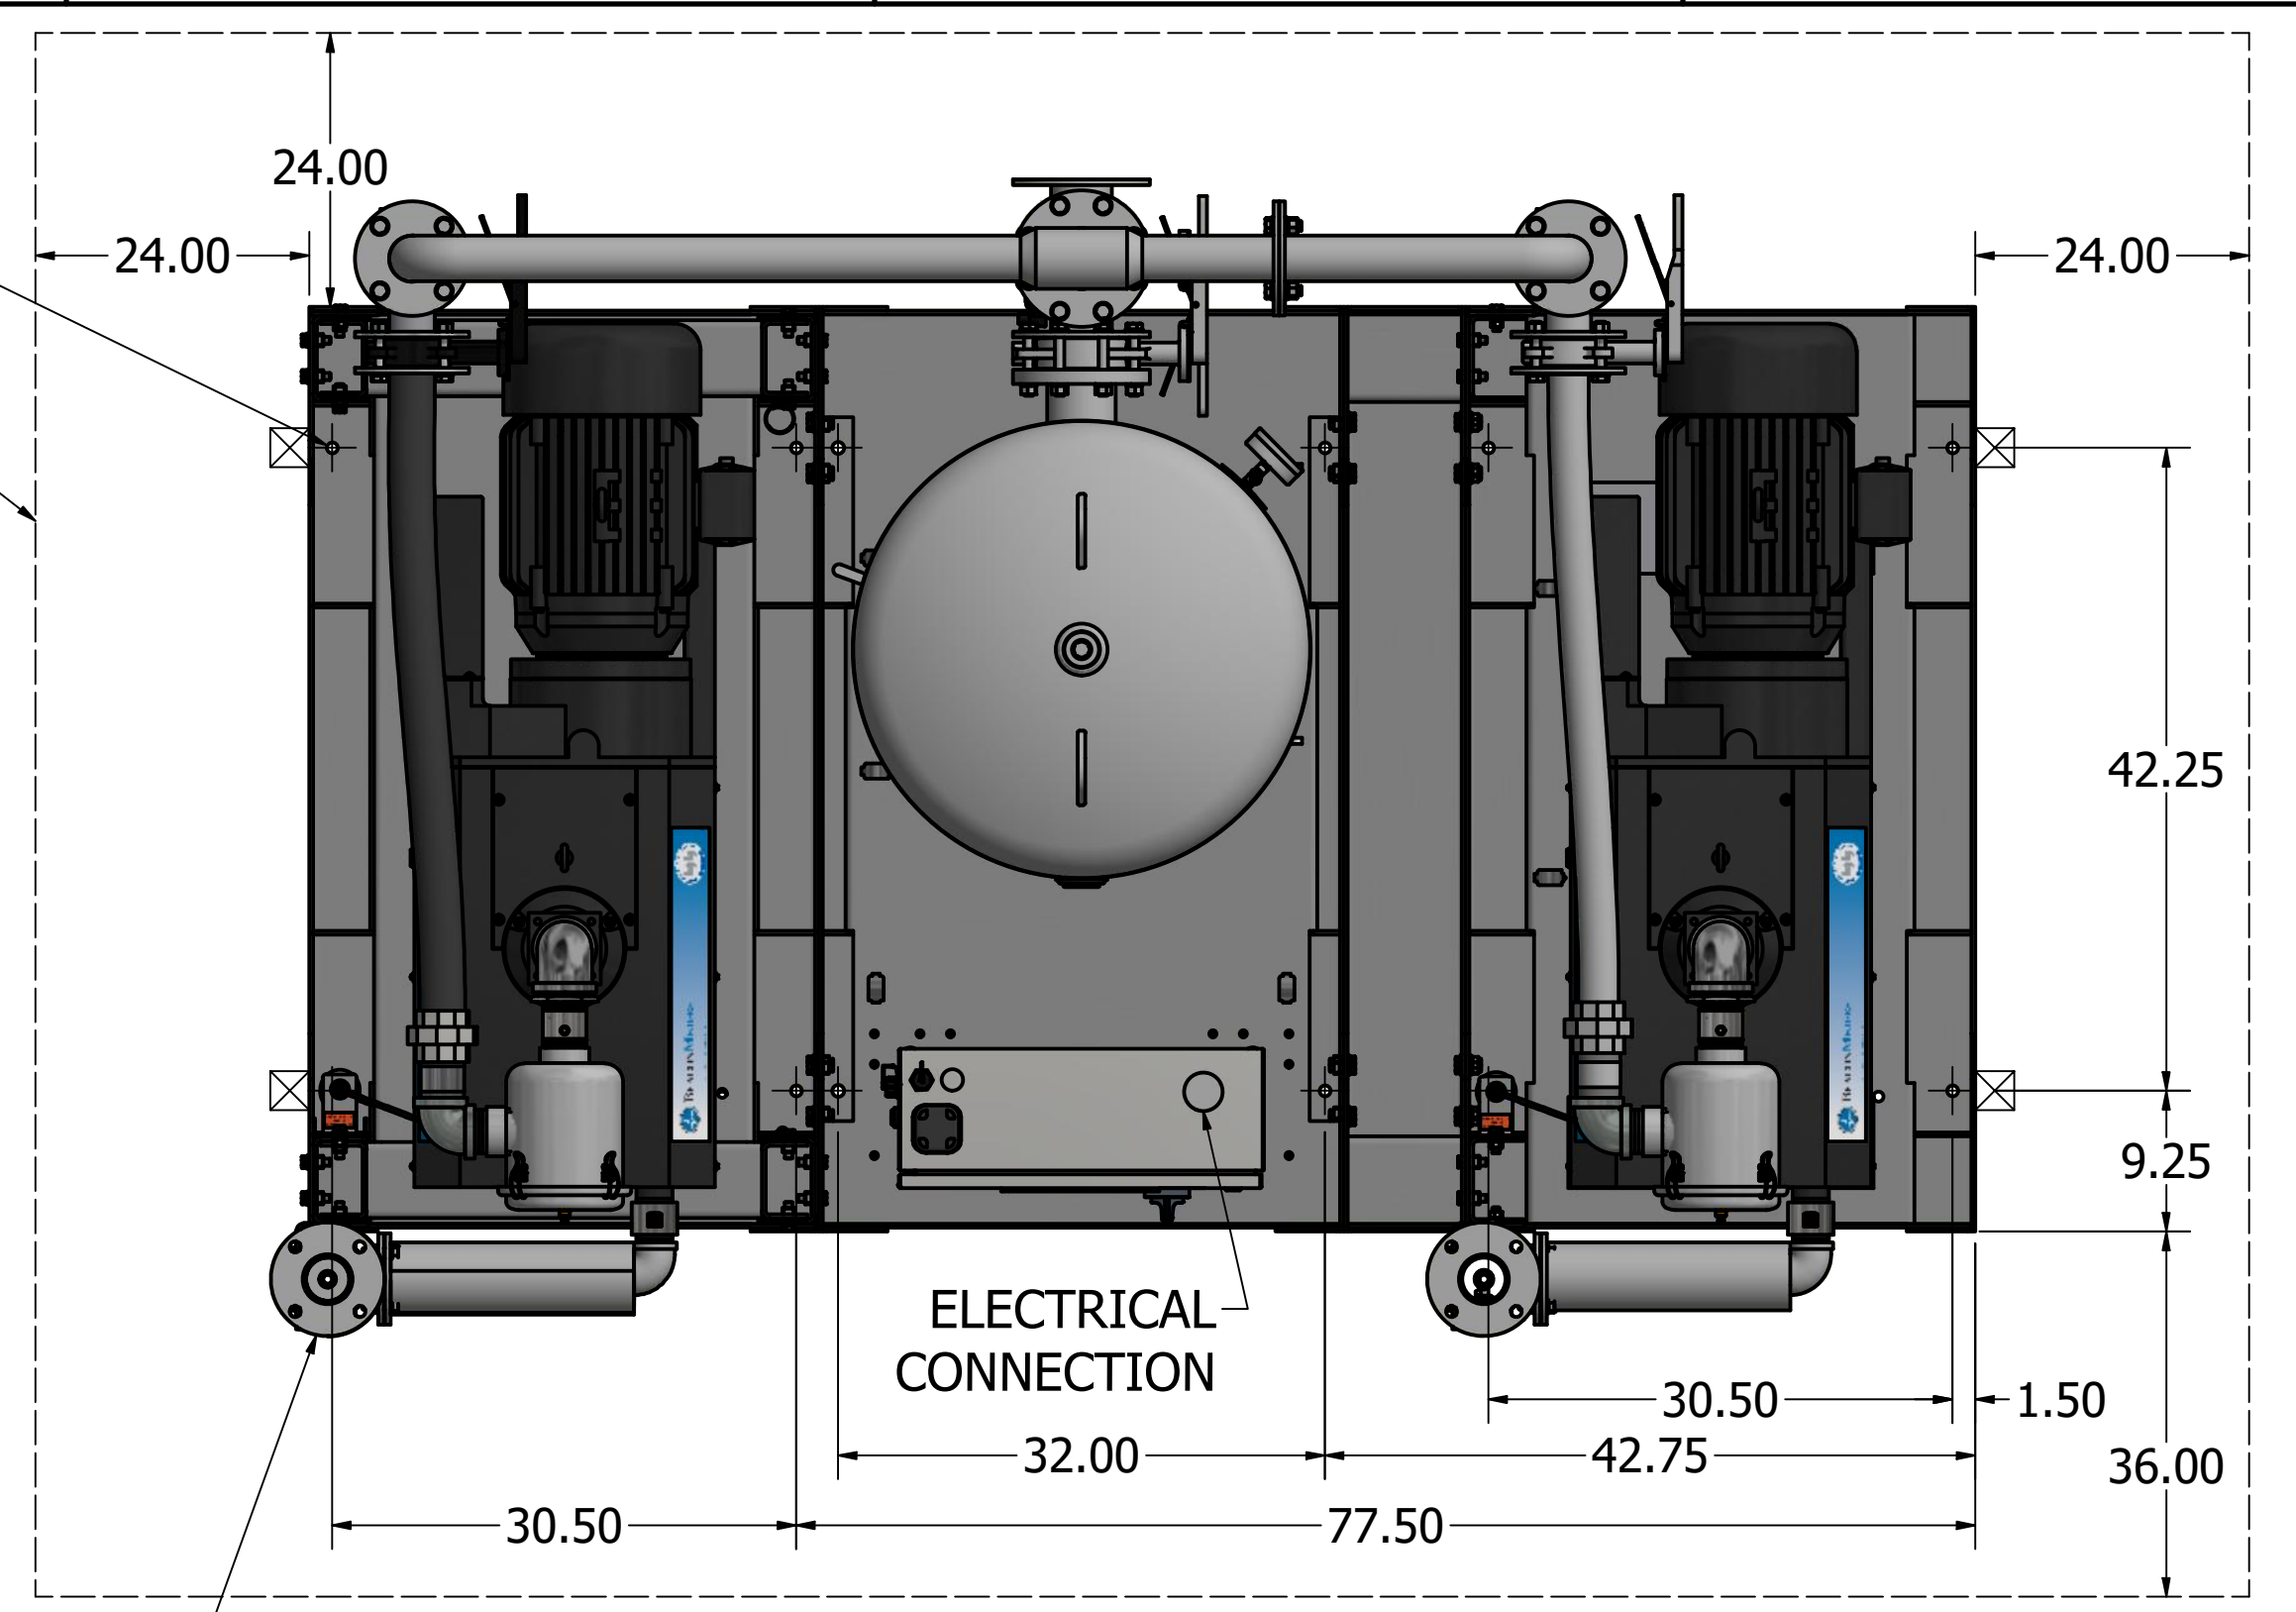

REMOVE INTAKE MANIFOLD  
BEFORE LIFTING

HEPA INTAKE FILTER  
PER PUMP

DISCHARGE  
3" FLANGE  
(2 PLACES)

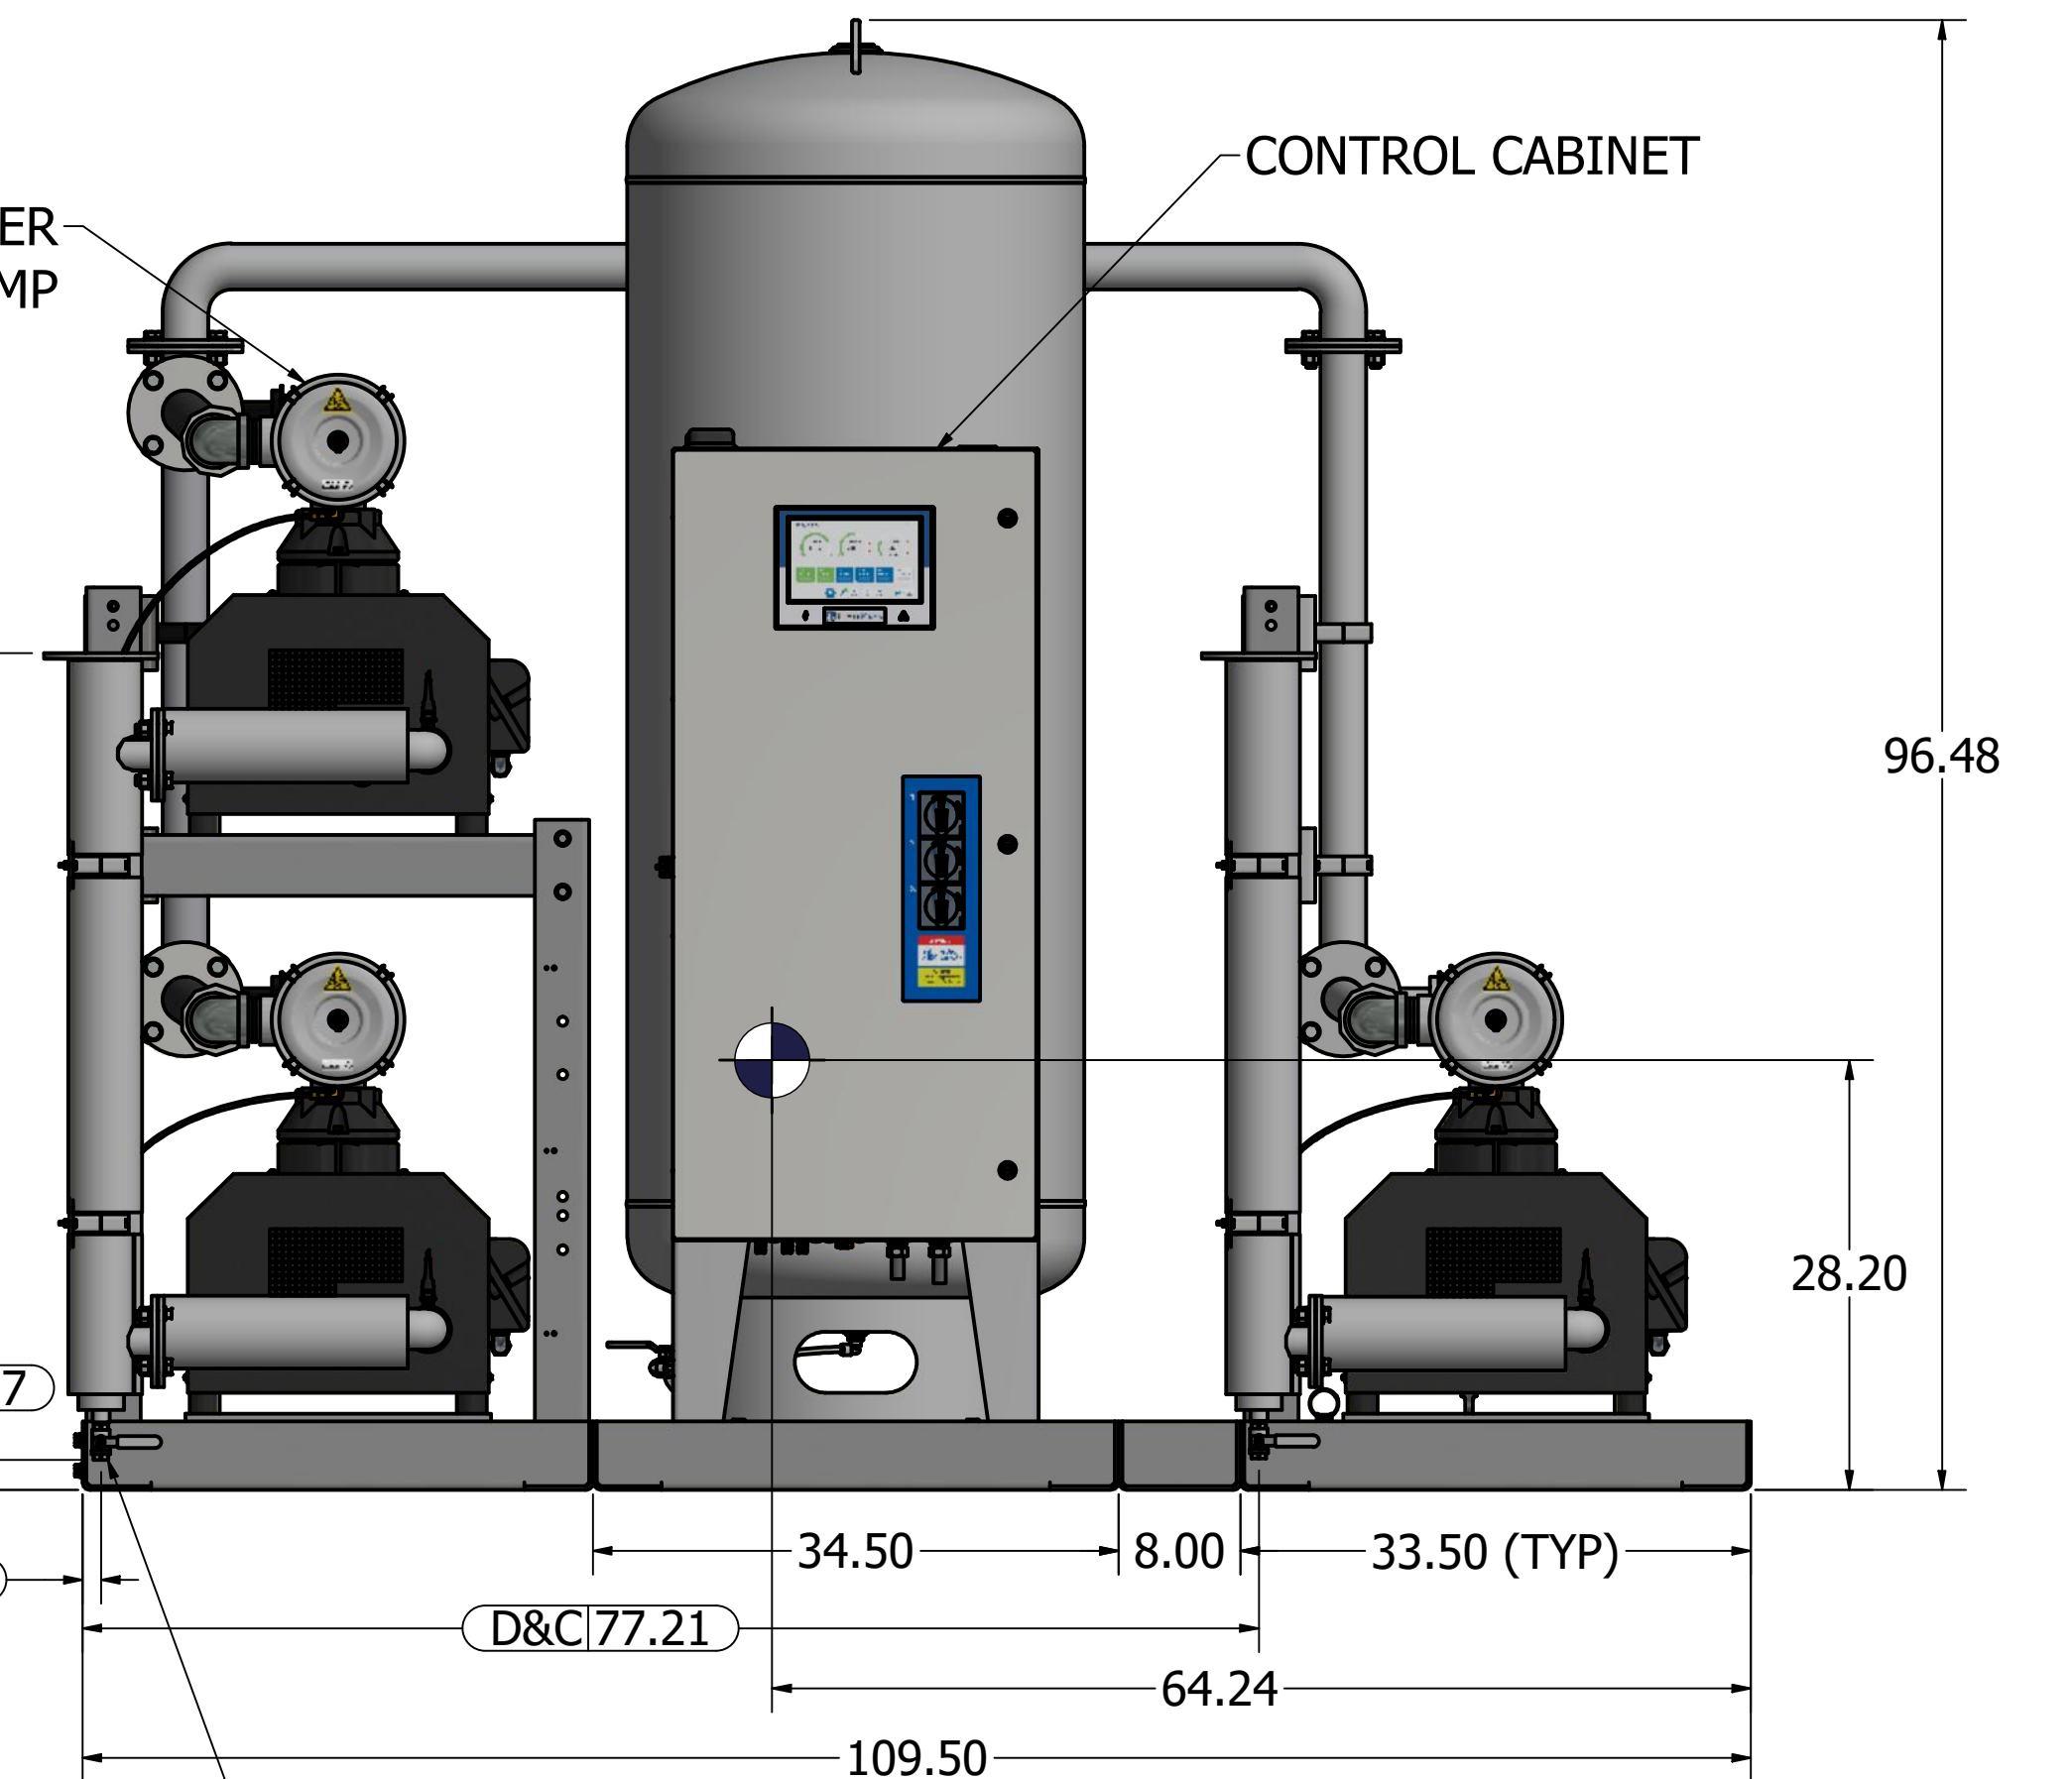

Revised: APS	Date: 1/24/2023	Drawn: JWO	Date: 2/10/2014
		This drawing and the information contained herein remain the property of BeaconMedes and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedes Engineering.	
Description: GENERAL ASSEMBLY 15HP TX CLAW VAC SPC 240G RECEIVER		Part Number: 4107 8549 15	Rev: 03
Sheet 1 of 1		DO NOT SCALE THIS DOCUMENT	