


Notes:

- 1. MAIN DISCONNECT PROVIDED BY OTHERS
- 2. FIELD POWER WIRING TO BE COPPER RATED FOR 75°C MINIMUM.
- 3. - - - - INDICATES FIELD WIRING OUTSIDE OF BOX.
- 4. SIGNAL INPUTS (UP TO 7) FROM GAS SENSOR MODULES.
- 5. RELAY OUTPUT CONTACT RATED 500mA / 30VDC MAX.

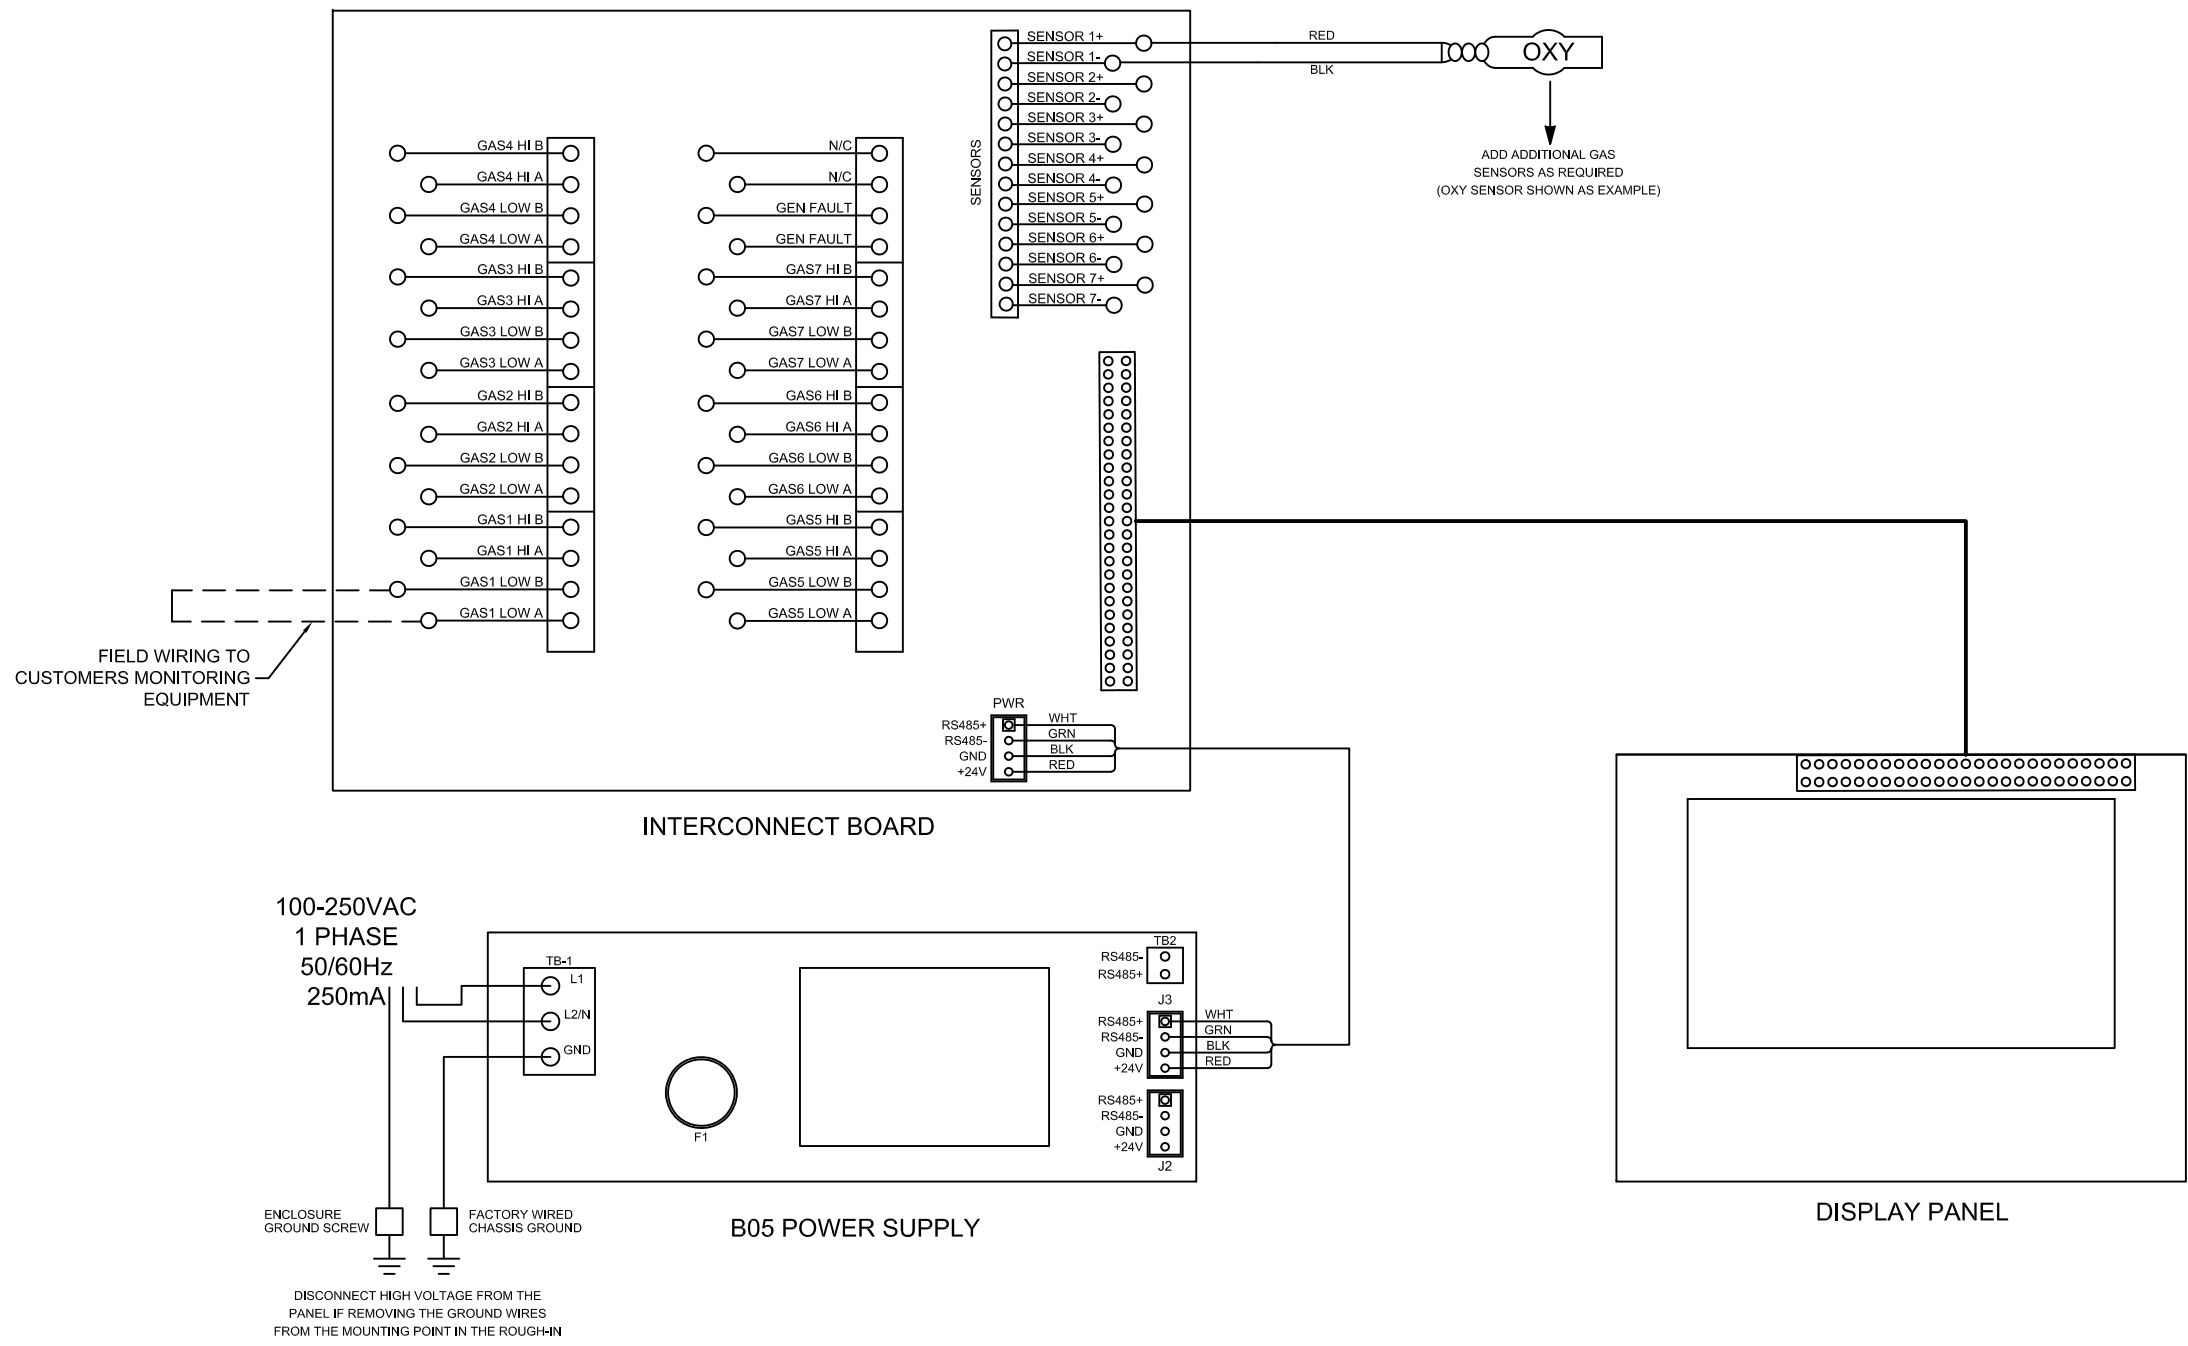

Revised:	Date:	Drawn:	MDB	Date:	12/03/20
		<small>This drawing and the information contained thereon remain the property of BeaconMedics and may not be used for other than the purpose for which it is loaned without the expressed written permission from BeaconMedics Engineering.</small>		Scale:	NTS
Description:			Part Number:		
DWG ALARM ZONE VALVE BOX WIRING DIAGRAM			4107 8574 52		
DN:	HOP200648	Rev:	00		
Sheet 1 of 1			DO NOT SCALE THIS DOCUMENT		